MOUNTING AND OPERATING INSTRUCTIONS



EB 5578 EN

Translation of original instructions



TROVIS 5578 Heating and District Heating Controller

With graphics display

CE

Note on these mounting and operating instructions

These mounting and operating instructions assist you in mounting and operating the device safely. The instructions are binding for handling SAMSON devices. The images shown in these instructions are for illustration purposes only. The actual product may vary.

- → For the safe and proper use of these instructions, read them carefully and keep them for later reference.
- → If you have any questions about these instructions, contact SAMSON's After-sales Service (aftersalesservice@samsongroup.com).



Documents relating to the device, such as the mounting and operating instructions, are available on our website at www.samsongroup.com > Service & Support > Downloads > Documentation.

Definition of signal words

DANGER

Hazardous situations which, if not avoided, will result in death or serious injury

A WARNING

Hazardous situations which, if not avoided, could result in death or serious injury



NOTICE

Property damage message or malfunction



Additional information



Recommended action

1	Safety instructions and measures	1-1
1.1	Notes on possible severe personal injury	1-3
1.2	Notes on possible property damage	1-3
2	Markings on the device	2-1
2.1	Nameplate	2-1
2.2	Firmware versions	2-1
3	Design and principle of operation	3-1
3.1	Configuration using the TROVIS-VIEW software	
3.2	Connection to SAM DISTRICT ENERGY	
3.3	Technical data	3-3
3.4	Dimensions	3-4
3.5	Values for resistance thermometers	3-5
4	Shipment and on-site transport	4-1
4.1	Accepting the delivered goods	
4.2	Removing the packaging from the controller	
4.3	Transporting the heating controller	
4.4	Storing the controller	4-1
5	Installation	5-1
5.1	Installation conditions	
5.2	Preparation for installation	
5.3	Mounting the controller	5-1
5.4	Electrical connection	
6	Operation	6-1
6.1	Operating controls	
6.2	Interfaces	
6.2.1	M-bus interface	6-2
6.2.2	Device bus interface RS-485	6-2
6.2.3	Optional interfaces	6-2
6.2.4	Accessories	6-3
7	Start-up and configuration	7-1
7.1	Altering the display contrast	
7.2	Changing the display language	7-3
7.3	Setting the system code number	
7.4	Activating and deactivating functions	
7.5	Changing parameters	
7.6	Calibrating sensors	7-8

Contents

7.6.1	Special values	7-11
7.7	Entering customized key number	7-12
8	Setup	8-1
8.1	Selecting the operating mode	8-1
8.2	Schedules	8-3
8.2.1	Setting the time and date	8-3
8.2.2	Setting the times-of-use	8-5
8.2.3	Setting the party timer (special time-of-use)	8-7
8.2.4	Programming public holidays (special times-of-use)	8-8
8.2.5	Programming vacation periods (special times-of-use)	8-9
8.3	Entering day and night set points	8-12
8.4	Reset to default settings	8-14
8.5	Reading information	8-14
8.5.1	Adapting the Trend-Viewer	8-19
8.6	Operating the controller in manual mode	8-21
9	Malfunctions	9-1
9.1	Error list	9-2
9.2	Sensor failure	9-2
9.3	Temperature monitoring	9-3
9.4	Fault alarm output	9-3
9.5	Error status register	9-4
10	Servicing	10-1
11	Decommissioning	11-1
12	Removal	12-1
13	Repairs	13-1
13.1	Returning devices to SAMSON	
14	Disposal	14-1
15	Certificates	15-1
16	Annex A (configuration instructions)	16-1
16.1	Systems	
16.2	Functions of the heating circuit	
16.2.1	Outdoor-temperature-compensated control	
16.2.1.1	Outdoor temperature received or sent as 0 to 10 V signal	
16.2.1.2	Outdoor temperature received or sent over the device bus	
16.2.1.3	Gradient characteristic	16-180
16.2.1.4	Four-point characteristic	16-182

16.2.2	Fixed set point control.	16-183
16.2.3	Underfloor heating/drying of jointless floors	16-184
16.2.4	Night set-back	
16.2.4.1	Outdoor temperature for continuous day mode	16-186
16.2.4.2	Variable night set-back	
16.2.5	Buffer tank systems	
16.2.6	Summer mode	
16.2.7	Delayed outdoor temperature adaptation	16-192
16.2.8	Remote operation	16-192
16.2.9	Optimization	16-193
16.2.10	Flash adaptation	16-194
16.2.10.1	Flash adaptation without outdoor sensor (based on room temperature)	16-195
16.2.11	Adaptation	16-196
16.2.12	Cooling control	16-196
16.2.13	Differential temperature control	16-198
16.3	Functions of the DHW circuit	16-199
16.3.1	DHW heating in the storage tank system	16-199
16.3.1.1	DHW circuit additionally controlled by a globe valve	16-201
16.3.2	DHW heating in the storage tank charging system	16-202
16.3.2.1	Cold charging protection	16-205
16.3.3	DHW heating in instantaneous heating system	16-205
16.3.4	Domestic hot water heating with solar system	16-206
16.3.5	Intermediate heating	16-207
16.3.6	Parallel pump operation	
16.3.7	Circulation pump during storage tank charging	16-208
16.3.8	Priority circuit	16-208
16.3.8.1	Reverse control	16-208
16.3.8.2	Set-back operation	16-209
16.3.9	Forced charging of DHW storage tank	16-209
16.3.10	Thermal disinfection of DHW storage tank	16-210
16.4	System-wide functions	
16.4.1	Automatic summer/standard time switchover	16-212
16.4.2	Frost protection	16-212
16.4.3	Forced pump operation	16-213
16.4.4	Return flow temperature limitation	16-213
16.4.5	Condensate accumulation control	16-215
16.4.6	Three-step control	
16.4.7	On/off control	16-216

Contents

16.4.8	Continuous control in control circuit HC1	16-216
16.4.9	Releasing a control circuit/controller with binary input	16-217
16.4.10	Speed control of the charging pump	16-217
16.4.11	Processing an external demand	16-218
16.4.12	External demand using a 0 to 10 V signal	16-220
16.4.13	Capacity limitation in RK1	
16.4.14	Creep feed rate limitation with a binary input	16-222
16.4.15	Device bus	
16.4.15.1	Requesting and processing an external demand	16-223
16.4.15.2	Sending and receiving outdoor temperatures	16-225
	Synchronizing the clock	
16.4.15.4	Priority over all controllers	16-226
16.4.15.5	Display error messages issued by the device bus	16-226
16.4.16	Activating TROVIS I/O expansion modules	16-227
16.4.17	Connecting potentiometers for valve position input	
16.4.18	Locking manual level	16-228
16.4.19	Locking the rotary switch	16-228
16.4.20	Feeder pump operation	
16.4.21	Speed control of the circulation pump (DHW)	
16.4.22	External demand for heat due to insufficient heat supply	
16.5	Communication	16-230
16.5.1	RS-485 communication module	16-230
16.5.2	Meter bus	
16.5.2.1	Activating the meter bus	
16.5.2.2	Flow rate and/or capacity limitation with meter bus	16-232
16.5.3	Return flow temperature limitation based on capacity	
16.5.4	Memory module/mini module	16-235
16.5.5	Data logging	
16.6	Function block lists	
16.7	Parameter lists	16-267
16.8	Customer-specific data	16-276
17	Annex B	
1 <i>7</i> .1	Accessories	
17.2	After-sales service	17-2

1 Safety instructions and measures

Intended use

The TROVIS 5578 Heating and District Heating Controller is used to control up to three control circuits:

- Control of a primary heat exchanger or boiler with up to two mixing heating circuit and one non-mixing heating circuit (both outdoor-temperature-compensated) and control of DHW heating in the secondary circuit
- Outdoor-temperature-compensated buffer storage tank control with up to two mixing heating circuits and continuous-flow hot water module
- Control of two outdoor-temperature-compensated heating circuits and a DHW heating with three valves in the primary circuit
- Control of three outdoor-temperature-compensated heating circuits with three valves in the primary circuit
- Applications with up to 6 control circuits are possible using optional TROVIS I/O expansion modules (linked by device bus).

The controller is designed to operate under exactly defined conditions. Therefore, operators must ensure that the controller is only used in operating conditions that meet the specifications used at the ordering stage. In case operators intend to use the heating and district heating controller in applications or conditions other than those specified, contact SAMSON.

SAMSON does not assume any liability for damage resulting from the failure to use the device for its intended purpose or for damage caused by external forces or any other external factors.

→ Refer to the technical data for limits and fields of application as well as possible uses.

Reasonably foreseeable misuse

The controller is not suitable for the following applications:

Use outside the limits defined during sizing and by the technical data
 Furthermore, the following activities do not comply with the intended use:

- Use of non-original spare parts
- Performing service and repair work not described

EB 5578 EN 1-1

Safety instructions and measures

Qualifications of operating personnel

The controller must be mounted, started up, serviced and repaired by fully trained and qualified personnel only; the accepted industry codes and practices must be observed. According to these mounting and operating instructions, trained personnel refers to individuals who are able to judge the work they are assigned to and recognize possible hazards due to their specialized training, their knowledge and experience as well as their knowledge of the applicable standards.

Personal protective equipment

No personal protective equipment is required for the direct handling of the controller.

Revisions and other modifications

Revisions, conversions or other modifications of the product are not authorized by SAMSON. They are performed at the user's own risk and may lead to safety hazards, for example. Furthermore, the product may no longer meet the requirements for its intended use.

Warning against residual hazards

The controller has direct influence on controlled components of the heating system (e.g. control valves and pumps). To avoid personal injury or property damage, plant operators and operating personnel must prevent hazards that could be caused in the plant components by the process medium, the operating pressure, the signal pressure or by moving parts by taking appropriate precautions. Plant operators and operating personnel must observe all hazard statements, warnings and caution notes in the referenced documents.

Responsibilities of the operator

Operators are responsible for proper use and compliance with the safety regulations. Operators are obliged to provide these mounting and operating instructions as well as the referenced documents to the operating personnel and to instruct them in proper operation. Furthermore, operators must ensure that operating personnel or third parties are not exposed to any danger.

Responsibilities of operating personnel

Operating personnel must read and understand these mounting and operating instructions as well as the referenced documents and observe the specified hazard statements, warnings and caution notes. Furthermore, operating personnel must be familiar with the applicable health, safety and accident prevention regulations and comply with them.

1-2 EB 5578 EN

Referenced standards, directives and regulations

The TROVIS 5578 Heating and District Heating Controller fulfills the requirements of the Directives 2014/30/EU, 2014/35/EU and 2011/65/EU. The declaration of conformity includes information about the applied conformity assessment procedure.

The controller is designed for use in low voltage installations.

→ For wiring, maintenance and repair, observe the relevant safety regulations.

1.1 Notes on possible severe personal injury

▲ DANGER

Risk of fatal injury due to electric shock.

- → Before connecting wiring, performing any work on the controller or opening the controller, disconnect the supply voltage and protect it against unintentional reconnection.
- → Only use power interruption devices that can be protected against unintentional reconnection of the power supply.
- → Do not remove any covers to perform adjustment work on live parts.

1.2 Notes on possible property damage

NOTICE

Risk of damage to the controller due to the supply voltage exceeding the permissible tolerances.

The controller is designed for use in low voltage installations.

→ Observe the permissible tolerances of the supply voltage.

EB 5578 EN 1-3

Safety instructions and measures

Malfunction due to a configuration that does not meet the requirements of the application.

The controller is configured for specific applications by setting functions and parameters. Function and parameter settings have a direct effect on final control elements.

→ Perform the configuration for the specific application.

Manipulation of the configuration due to unauthorized access.

The controller can be protected against unauthorized access through entering a key number. The key number for first start-up can be found at the back of these mounting and operating instructions.

→ Do not pass the key number on to unauthorized persons. Keep it in a safe place inaccessible to unauthorized persons.

Risk of controller damage due to large differences in temperature.

→ Before start-up, wait until the controller has reached the ambient temperature.

System damage caused by frost.

Frost protection is deactivated in the manual mode.


→ Do not run the heating during cold weather in the manual mode for long periods of time.

1-4 EB 5578 EN

2 Markings on the device

2.1 Nameplate

The nameplate shown was up to date at the time of publication of this document. The nameplate on the device may differ from the one shown.



- 1 Type designation
- 2 Model number
- 3 Firmware version
- 4 Serial number
- 5 Fuse protection
- 6 Supply voltage
- 7 Date of manufacture

2.2 Firmware versions

Firmwar	Firmware revisions					
Old	New					
2.20	2.24					
	New systems Anl 1.9-1 and 1.9-2					
2.24	2.26					
	New function: Error message (CO5 -> F07)					
	OT with 0-10 V function (CO5 -> F23) extended Outdoor temperatures can be received or sent using a 0 to 10 V signal.					
2.26	2.28					
	New system Anl 11.5					
	Alarm and event lists each with the last 100 entries					

EB 5578 EN 2-1

Markings on the device

Firmwar	e revisions
Old	New
2.28	2.30
	It is possible to connect PTC or Ni 1000 sensors (Pt 1000 sensors only possible below this firmware version)
2.30	2.41
	Connected sensor inputs not relevant for closed-loop control are displayed on the 'Special values' screen in the controller's operating level
	New buffer tank systems 3.9, 5.9, 17.1 and 17.8
	New functions and parameters for buffer tank systems: - CO1 -> F22: SLP depending on return flow temperature - CO4 -> F23: Electric heating cartridge - CO5 -> F25: AA1 reverse - CO5 -> F26: AA2 reverse - CO5 -> F31: AE1 zero shift - PA1 -> P16: Minimum set point to charge buffer tank - PA1 -> P17: Stop charging of the buffer tank - PA1 -> P18: Charging temperature boost - PA1 -> P19: Lag time of charging pump - PA4 -> P13: Maximum buffer tank temperature - PA4 -> P21: Return flow temperature limit, layering at top New differential temperature control function (CO1 -> F23) in systems Anl 1.0 and 16.0
	TROVIS 5570 Room Panel no longer available.
	Restrictions when a mini module (order no. 1400-7436) is used
2.41	2.45
	An active cold charging protection function allows the valve position to be determined between 1 and 100 % (default 10 %).
2.45	2.48
	Internal revisions

2-2 EB 5578 EN

Firmware re	evisions					
Old	New					
2.48	2.51					
	New systems Anl 6.1 and 18.1 implemented					
	Systems Anl 9.1 and 9.2 now with feeder pump UP1					
	Configuration of up to three TROVIS I/O expansion modules possible					
	Operating status reading of DHW circuit in the operating level					
	Only the values that are not assigned to a partial plant scheme are shown the overall plant scheme: this now includes the demand to be processed.					
	Meaning of CO1, CO2, CO3 -> F02 F02 - 1 = Outdoor-temperature-compensated control active					
	Buffer tank systems: the measured value SF1 is now also relevant to end charging					
	Discharging protection for DHW tank and buffer tank					
	Separate boost adjustable for underfloor heating circuits					
	No restart, instead the drying of jointless floors continues after a power supply failure					
	Heating circuits can be configured to be circuits only processing demand with the settings CO1 -> F24 - 1, CO2 -> F24 - 1, CO3 -> F24 - 1					
	Transmission range setting for 0 to 10 V signal to process external demand changed to CO5 -> F31					
	Default setting of heating characteristic 1.2 (0.5 for underfloor heating)					
	Default setting of the maximum flow temperature: 70 °C					
	Delayed outdoor temperature adaptation adjustable in steps of 0.1 °C					
	Return flow temperature limitation based on capacity configurable					
	Default setting of heat meter mode: 'Continuous'					

EB 5578 EN 2-3

Markings on the device

Firmware	e revisions				
Old	New				
2.51	2.61				
	New function Variable night set-back can be configured separately for each heating circuit (setting: CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 1)				
	Function blocks CO1 -> F27 and CO4 -> F27 introduced to activate the discharging protection				
	Storage tank bottom sensor RüF2 can be configured as sensor to switch off the thermal disinfection (setting: CO4 -> F24 - 1)				
	Free analog output assignment: configure CO5 -> F34 and F35 to determine which output signals are to be issued at AA1 and AA2.				
	The values of analog outputs AA1 and AA2 are saved with 0 to 100% in the overall scheme diagram.				
	The analog outputs AA1 and AA2 are available in manual mode.				
	Additional buffer tank bottom sensor SF3 can be configured in CO1 -> F25 - 1 setting. It can be changed to be based on the outdoor temperature.				
	Another sensor can be configured as SF2 for speed control of the SLP (storage tank charging pump).				
	New function: speed-controlled DHW circulation pump for control the circulation return flow temperature using sensor RüF4/AF2				
	Device bus addresses in the range between 11 and 19 are available for addressing the TROVIS I/O expansion modules.				
2.61	2.63				
	New option configurable: 3 V supply for analog outputs				

2-4 EB 5578 EN

3 Design and principle of operation

The TROVIS 5578 Heating and District Heating Controller is used to control up to three control circuits.

- Control of a primary heat exchanger or boiler with up to two mixing heating circuit and one non-mixing heating circuit (both outdoor-temperaturecompensated) and control of DHW heating in the secondary circuit
- Outdoor-temperature-compensated buffer storage tank control with up to two mixing heating circuits and continuousflow hot water module
- Control of two outdoor-temperaturecompensated heating circuits and a DHW heating with three valves in the primary circuit
- Control of three outdoor-temperaturecompensated heating circuits with three valves in the primary circuit
- Applications with up to 6 control circuits are possible using optional TROVIS I/O expansion modules (linked by device bus).

The TROVIS 5578 Heating and District Heating Controller is adapted to the specific system by setting the appropriate system code number. Additional sensors and/or functions which are not part of the system's basic configuration can be selected over function blocks. The switch positions and entry of the key number allow access to the corresponding levels. For trained staff, the configuration

levels used to set function blocks are indicated by "CO" and the parameter levels are indicated by "PA". Data is retrieved and entered at the controller using a rotary pushbutton. This process is facilitated by icons and plain text displayed on the LCD. The rotary switch is used to set the operating mode and the parameters required for each circuit.

M-bus interface

A maximum of three meters conforming to EN 1434-3 can be connected for data transfer. In addition, heat meters for each control circuit are available for flow rate and/or capacity limitation. Various limits can be adjusted for the different operating modes "Heating control only", "Heating control with DHW heating" and "DHW heating only" in control circuit RK1. Outdoor-temperature-compensated flow rate or capacity limitation can also be implemented.

3.1 Configuration using the TROVIS-VIEW software

The controller can be configured with the TROVIS-VIFW software

In this case, the TROVIS 5578 Heating and District Heating Controller is connected to the computer at the RJ-45 jack on the side of the controller

The TROVIS-VIEW software enables the user to easily configure the controller as well as view process parameters online.

EB 5578 EN 3-1

i Note

TROVIS-VIEW provides a uniform user interface that allows users to configure and parameterize various SAMSON devices using device-specific database modules. The device module can be downloaded free of charge from our website at

www.samsongroup.com > SERVICE & SUPPORT > Downloads > TROVIS-VIEW . Further information on TROVIS-VIEW (e.g. system requirements) is available on our website and in the Data Sheet ► T 6661.

i Note

SAM DISTRICT ENERGY is a web-based solution for managing, controlling and optimizing heating systems in the local heat supply and district heating networks. You can find more information and test SAM DISTRICT ENERGY using a demo account on our website at www.samsongroup.com > Products & Applications > Digital solutions > SAM DISTRICT ENERGY.

3.2 Connection to SAM DISTRICT ENERGY

The controller can be configured and operated on a computer, smartphone or tablet computer using the SAM DISTRICT ENERGY industry-specific application.

The controller is connected to SAM DISTRICT ENERGY over the Modbus interface using a communication gateway.

SAM DISTRICT ENERGY allows remote startup and set-up of the controllers. Key information of the controller and entire heating system is clearly visualized at one central location.


3-2 EB 5578 EN

3.3 Technical data

Weight	Approx. 0.5 kg
Conformity	C€
Noise emission	According to EN 61000-6-3
Noise immunity	According to EN 61000-6-1
Overvoltage category	Il according to EN 60664
Degree of contamination	2 according to EN 61010-1
Class of protection	Il according to EN 61140
Degree of protection	IP 40 according to EN 60529
Permissible ambient tem- perature range	0 to 40 °C (operation), -10 to +60 °C (storage and transport)
Supply voltage	165 to 250 V, 48 to 62 Hz, max. 7 VA
Optional interfaces	Modbus RS-485 interface for two-wire bus using RS-485 communication module (Modbus RTU protocol, data format 8N1, RJ-45 connector socket at the side)
Interfaces	M-bus for up to three M-bus units, protocol according to EN 1434-3 Device bus interface (RS-485) for max. 32 bus devices (two-wire bus, reverse polarity protection)
Outputs	3x three-step signal: rating max. 250 V AC, 2 A, alternatively 3x on/off signal: rating max. 250 V AC, 2 A 5x pump output: rating max. 250 V AC, 2 A; all outputs are relay outputs with varistor suppression 1x 0 to 10 V output (e.g. for continuous closed loop control, outdoor temperature, signal for external demand or pump speed control), load >5 k Ω 1x 0 to 10 V output for PWM signal for pump speed control
Inputs	17x Pt 1000, PTC or Ni 1000 sensor inputs, alternatively configurable for binary inputs 1x 0 to 10 V input (e.g. for external demand or outdoor temperature signal) Input 17 for a pulse signal (3 to 800 pulses/h) of a heat meter for capacity limitation in RK1
Innuts	17x Pt 1000 PTC or Ni 1000 sensor inputs alternatively configurable for

EB 5578 EN 3-3

3.4 Dimensions

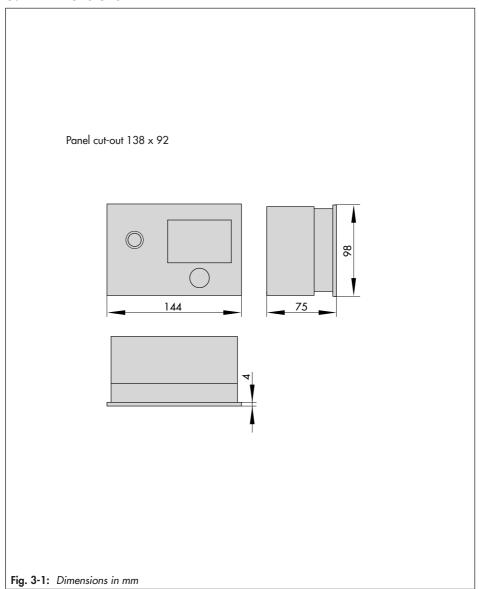

3-4 EB 5578 EN

3.5 Values for resistance thermometers

Pt 1000 sensors

Temperature °C	-35	-30	-25	-20	-15	-10	-5	0	+5	+10	+15	+20
Resistance Ω	862.5	882.2	901.9	921.6	941.2	960.9	980.4	1000.0	1019.5	1039.0	1058.5	1077.9
Temperature °C	+25	+30	+35	+40	+45	+50	+55	+60	+65	+70	+75	+80
Resistance Ω	1097.3	1116.7	1136.1	1155.4	1174.7	1194.0	1213.2	1232.4	1251.6	1270.8	1289.9	1309.0
Temperature °C	. 0.5	. 00	+95	+100	. 105	110	115	100	105			
icinperatore C	+85	+90	+93	+100	+105	+110	+115	+120	+125	+130	+135	+140
Resistance Ω												+140 1535.8
	1328.1											

PTC sensor

Temperature °C	-20	-10	0	+10	+20	+30	+40	+50
Resistance Ω	693	756	824	896	971	1050	1133	1220
Temperature °C	+60	+70	+80	+90	+100	+110	+120	
Resistance Ω	1311	1406	1505	1606	1713	1819	1925	

Type 5244 (remote control unit)

Switch position ①, terminals 1 and 2

Temperature °C	10	15	20	25	30
Resistance Ω	679	699	720	741	762

Ni 1000 sensors

Temp. °C	-60	-50	-40	-30	-20	-10	0	+10	+20	+30	+40
Resistance Ω	695	743	791	841	893	946	1000	1056	1112	1171	1230
Temp. °C	+50	+60	+70	+80	+90	+100	+110	+120	+130	+140	+150
Resistance Ω	1291	1353	1417	1483	1549	1618	1688	1760	1833	1909	1986
Temp. °C	+160	+170	+180	+190	+200	+210	+220	+230	+240	+250	
Resistance Ω	2066	2148	2232	2318	2407	2498	2592	2689	2789	2892	

EB 5578 EN 3-5

3-6 EB 5578 EN

4 Shipment and on-site transport

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

4.1 Accepting the delivered goods

After receiving the shipment, proceed as follows:

- Compare the shipment received with the delivery note.
- Check the shipment for transportation damage. Report any damage to SAMSON and the forwarding agent (refer to delivery note).

4.2 Removing the packaging from the controller

i Note

Do not remove the packaging until immediately before mounting and start-up.

- Remove the packaging from the controller
- 2. Check scope of delivery (see Fig. 4-1).
- Dispose and recycle the packaging in accordance with the local regulations.

- 1x TROVIS 5578 Heating and District Heating Controller
- 1x Document IP 5578 (Important Product Information)

Fig. 4-1: Scope of delivery

4.3 Transporting the heating controller

Transport instructions

- Protect the controller against external influences (e.g. impact).
- Protect the controller against moisture and dirt.
- Observe transport temperature depending on the permissible ambient temperature (see the 'Design and principle of operation' section).

4.4 Storing the controller

NOTICE

Risk of controller damage due to improper storage.

- → Observe the storage instructions.
- → Avoid long storage times.
- → Contact SAMSON in case of different storage conditions.

i Note

We recommend to regularly check the controller and the prevailing storage conditions during long storage periods.

EB 5578 EN 4-1

Shipment and on-site transport

Storage instructions

- Protect the controller against external influences (e.g. impact).
- Protect the controller against moisture and dirt. Store it at a relative humidity of less than 75 %. In damp spaces, prevent condensation. If necessary, use a drying agent or heating.
- Make sure that the ambient air is free of acids or other corrosive media.
- Observe transport temperature depending on the permissible ambient temperature (see the 'Design and principle of operation' section).
- Do not place any objects on the controller.

4-2 EB 5578 EN

5 Installation

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

5.1 Installation conditions

Work position

The work position for the controller is the front view onto the operating controls on the controller seen from the position of operating personnel.

Operators must ensure that, after installation of the controller, the operating personnel can perform all necessary work safely and easily access the device from the work position.

5.2 Preparation for installation

Before installation, make sure the following conditions are met:

- The controller is not damaged.

Proceed as follows:

Lay out the necessary material and tools to have them ready during installation work.

5.3 Mounting the controller

The controller consists of the housing with the electronics and the base with the terminals. It is suitable for panel, wall and rail mounting (see Fig. 5-1).

Panel mounting

- 1. Undo the two screws (1).
- Pull apart the controller housing and the base.
- Make panel cut-out with the dimensions 138 x 92 mm (W x H).
- 4. Push the controller housing through the panel cut-out.
- Tighten the two screws (2) to clamp the controller housing against the control panel.
- 6. Perform electric wiring on the base as described in section 5.4.
- 7. Remount the controller housing.
- 8. Tighten the two screws (1).


Wall mounting

- 1. Undo the two screws (1).
- Pull apart the controller housing and the base.
- If necessary, drill holes with the specified dimensions in the appropriate places.
 Fasten the base with four screws.
- 4. Perform electric wiring on the base as described in section 5.4.
- 5. Remount the controller housing.
- 6. Tighten the two screws (1).

Rail mounting

- Fasten the spring-loaded hook (4) at the bottom of the top hat rail (3).
- Slightly push the controller upwards and pull the top hook (5) over the top hat rail. Undo the two screws (1).

EB 5578 EN 5-1

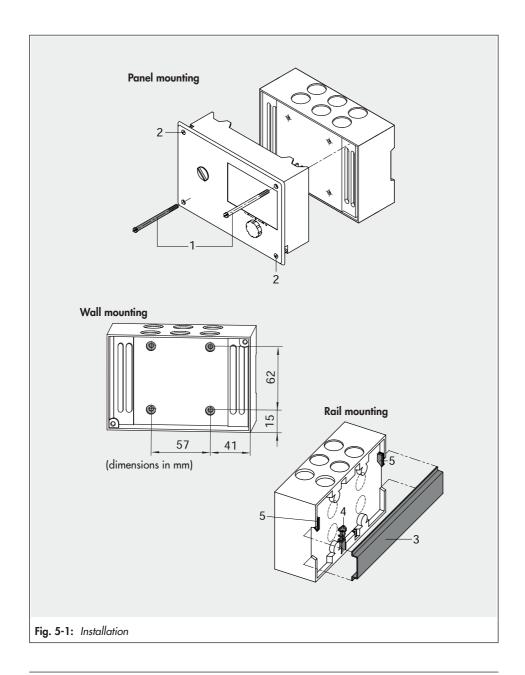

5-2 EB 5578 EN

- Pull apart the controller housing and the base.
- 4. Perform electric wiring on the base as described in section 5.4.
- Remount the controller housing.
- 6. Tighten the two screws (1).

5.4 Electrical connection

A DANGER

Risk of fatal injury due to electric shock.

- For electrical installation, you are required to observe the relevant electrotechnical regulations of the country of use as well as the regulations of the local power suppliers. Therefore, such work must be performed by trained and experienced personnel
- The terminals 33, 39, 42 and 45 allow the integration of safety equipment which have a direct influence on individual electric actuators and pumps. If this is not the case, connect a jumper from terminal 31 to terminals 33, 39, 42 and 45. Do not connect ELV cables (according to VDE 0100) to these terminals.
- Before performing any work on the terminals, disconnect the voltage supply from the heating controller.

Notes on electric wiring

- → Install the 230 V power supply lines and the signal lines separately and away from each other.
- → To increase immunity, keep a minimum distance of 10 cm between the lines.

- Make sure the minimum distance is also kept when the lines are installed in a cabinet.
- → Install the lines for digital signals (bus lines) and analog signals (sensor lines, analog outputs) separately and away from each other.
- → In plants with a high electromagnetic noise level, we recommend using shielded cables for the analog signal lines.
- → Ground the shield at one side, either at the control cabinet inlet or outlet, using the largest possible cross-section. Connect the central grounding point and the PE grounding conductor with a cable with at least 10 mm² wire cross-section using the shortest route.
- → Inductances in the control cabinet, e.g. contactor coils, must be equipped with suitable interference suppressors (RC elements).
- → Shield control cabinet elements with high field strength, e.g. transformers or frequency converters, with separators providing a good connection to the PE grounding conductor.
- → Use wires with wire cross-sections as listed in Table 5-1 for terminals

Overvoltage protection

- If the signal lines are installed outside buildings or over large distances, make sure appropriate surge or overvoltage protection measures are taken. Such measures are indispensable for bus lines.
- The shield of signal lines installed outside buildings must have current conducting

EB 5578 EN 5-3

Installation

- capacity and must be grounded on both sides.
- Surge diverters must be installed at the control cabinet inlet.

Connecting the heating controller

- → If the controller housing and the base have not yet been separated: unscrew the screws on the bottom left and top right of the housing to open it to connect the wiring.
- → To feed through cables, make holes in the marked locations at the top, bottom or back of the base of the housing and fit suitable grommets or cable glands.
- → For wall mounting: ensure that the lines are not subject to torsion or bending by taking suitable precautions, e.g. a cable duct, before inserting them into the base.
- → Connect as shown in Fig. 5-2.

Connecting sensors

The wire cross-section of the sensor cables must not be smaller than 0.5 mm².

Wiring of a room panel

→ Connect as shown in Fig. 5-3.

Connecting the water flow sensor

→ Connect as shown in Fig. 5-4.

Connecting actuators

 0 to 10 V control output: use cables with a minimum wire cross-section of 0.5 mm². Three-step or on/off outputs: connect cables with a minimum wire cross-section of 1.5 mm² suitable for damp locations to the terminals of the controller output. We recommend checking the operating direction on start-up.

Connecting pumps

Connect all cables with a minimum 1.5 mm² wire cross-section to the terminals of the heating controller as illustrated in the wiring diagram.

i Note

The electric actuators and pumps are not automatically supplied with a voltage by the heating controller. They can be connected over terminals 33, 39, 42 and 45 to an external voltage source. For an internal power supply, place a jumper from terminal 31 to terminals 33, 39, 42 and 45.

5-4 EB 5578 EN

A DANGER


Risk of fatal injury as a result of failing to observe the permissible touch voltage.

Separation of the circuits is absolutely essential when SELV equipment is connected to terminals 33, 39, 42 and 45 as this equipment has a different intended use of the supply voltage than specified in the technical data (230 V AC).

The creepage and clearance present in the base and controller do not guarantee the required dielectric strength and the safe separation of the 230 V supply voltage and the other circuits.

- → Take appropriate safety precautions (e.g. by using coupling relays for the control of electric actuators operated with 24 V or for ELV fault signaling contacts).
- → Only connect 230 V equipment.

EB 5578 EN 5-5

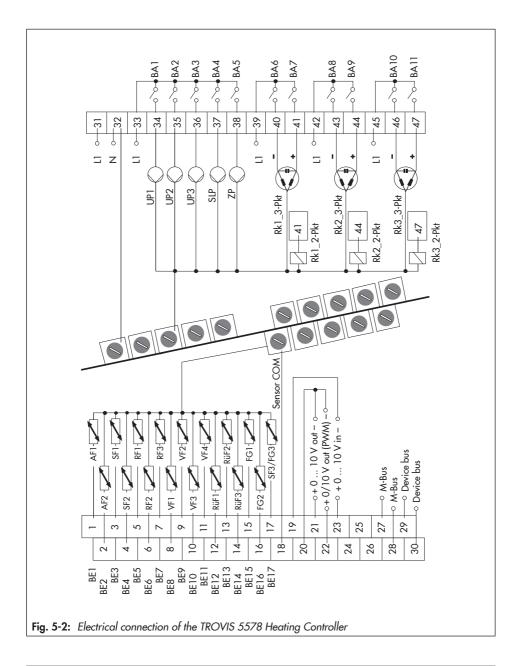

5-6 EB 5578 EN

Legend for Fig. 5-2:

AF	Outdoor sensor	RüF	Return flow sensor	UP	Circulation pump
BA	Binary output	SF	Storage tank sensor		(heating)
BE	Binary input	VF	Flow sensor	SLP	Storage tank
FG	Potentiometer	RK	Control circuit		charging pump
RF	Room sensor			ZΡ	Circulation pump
					(DHW)


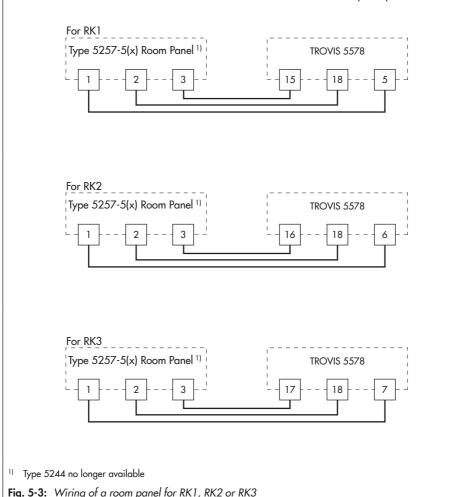


Fig. 5-3: Wiring of a room panel for RK1, RK2 or RK3

EB 5578 EN 5-7

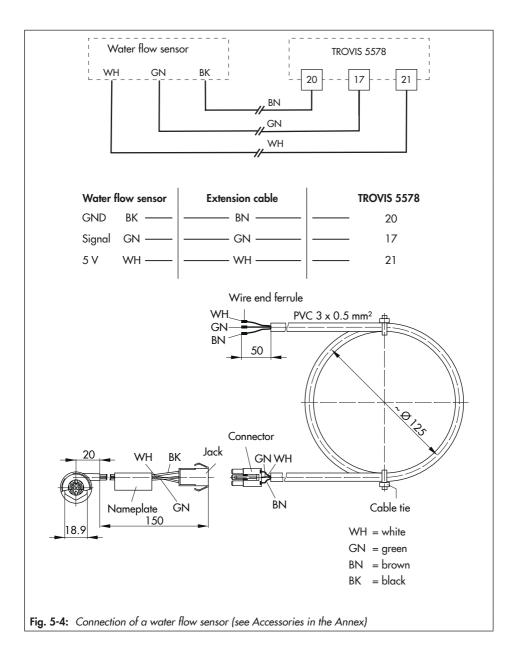

5-8 EB 5578 EN

NOTICE

A flow rate measurement is not performed when the wrong model of the water flow sensor is used.

→ Only use the sensor model specified in the Annex.

Table 5-1: Permissible wire cross-section for terminals

Cable	Wire cross-section
Single-wire	0.33 to 2 mm ²
Multi-wire	0.33 to 2 mm ²

Length of insulation to be stripped off wire ends: 6 mm

EB 5578 EN 5-9

Installation

5-10 EB 5578 EN


6 Operation

The heating controller is operated on site using the operating controls on the front.

Operating controls

The operating controls are located in the front panel of the controller.

Rotary pushbutton



Turn [()]:

Select readings, parameters and function blocks

Press [*]:

Confirm adjusted selection or settings

Rotary switch

The rotary switch is used to set the operating mode and the relevant parameters for each control circuit.





Operating level

○ (**Operating modes)

Manual level



- ♣ Day set point (rated room temperature)
- Night set point (reduced room temperature)
- 也馬 Times-of-use for heating/DHW
 - Special time-of-use
- Time/date
- Settings

EB 5578 EN 6-1

6.2 Interfaces

6.2.1 M-bus interface

Data transmission of max. three meters according to EN 1434-3. See Annex A (configuration instructions).

6.2.2 Device bus interface RS-485

Connection of max. 32 bus devices (two-wire bus)

6.2.3 Optional interfaces


Modbus interface RS-485

Communication module

Using the optional RS-485 communication module (Modbus RTU interface for two-wire bus networks), the TROVIS 5578 Heating Controller can communicate with a control system. In combination with a suitable software for process visualization and communication, a complete control system can be implemented.

i Note

The operating software can be updated over a data cable, provided Modbus has been activated (CO6 -> F01 - 1). See Annex A (configuration instructions).



6-2 EB 5578 EN

Two-wire bus system

The optional RS-485 to computer communication module (order no. 8812-2002) is required to connect the controller to a two-wire bus network for Modbus RTU communication with a process control system.

Modbus-TCP/IP communication and SAM DISTRICT ENERGY web application

The SAM MOBILE, SAM LAN or SAM HOME Gateway is required for Modbus-TCP/IP communication and for connection to the SAM DISTRICT ENERGY web application.


6.2.4 Accessories

TROVIS I/O (expansion module)	Order no. 1000062999			
Memory module	Order no. 1400-9379			
Mini module	Order no. 1400-7436			
Data logging module	Order no. 1400-9378			
USB converter 3 together with data log viewer software	Order no. 1400-9377			
TROVIS-VIEW software (free of charge)	Link to download at: ▶ www.samsongroup.com > SERVICE & SUPPORT > Downloads > TROVIS-VIEW			
RS-485 communication module	Order no. 8812-2002			
Surge arrester SA 5000	Order no. 1400-9868			
SAM HOME Gateway for communication over Ethernet	Type 5660			
SAM MOBILE Gateway for communication using mobile phone networks	Type 5655			
SAM-LAN Gateway for communication using unlicensed radio frequency bands	Type 5650			

EB 5578 EN 6-3

6-4 EB 5578 EN

7 Start-up and configuration

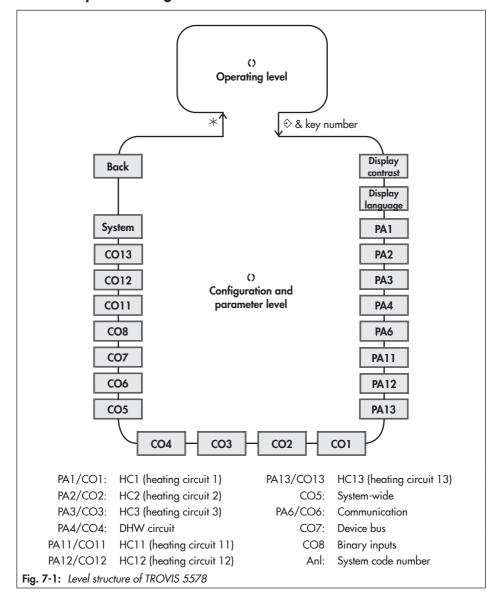

Start-up and configuration

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

Before start-up, make sure the following conditions are met:

- The controller is properly mounted according to the instructions.
- The electrical connection is properly performed.

The controller is adapted to its control task by performing start-up. Start-up usually involves performing several steps:

- 1. Change the contrast of the display to adapt it to the installation conditions (see section 7.1).
- 2. Change the display language as required for the operating personnel (see section 7.2).
- 3. Select the hydraulic system (see section 7.3).
- 4. Change functions and parameters to adapt the system (see sections 7.4 and 7.5).
- 5. Calibrate the sensors (see section 7.6).

The settings during start-up can only be performed after the valid key number has been entered.

The valid key number for first start-up can be found at the back of these mounting and operating instructions. To avoid unauthorized use of the service key number, remove the page or make the key number unreadable. In addition, it is possible to enter a new, customized key number (see section 7.7).

7-2 EB 5578 EN

7.1 Altering the display contrast

The contrast of the display can be changed to adapt it to the installation conditions.

Settings	
Display contrast	50
Display language	English
PA1	
PA4	
Contrast setting of	display

Turn the rotary switch to ♦ (settings).

- () Enter the currently valid key number.
- * Confirm key number.
- O Select 'Display contrast'.
- * Activate editing mode for the display contrast.

 The current setting is shown inverted on the display.
- O Set the display contrast
- * Confirm setting.

Turn the rotary switch back to \square (operating level).

7.2 Changing the display language

The default display language is German. The setting can be changed to English.

Settings	
Display contrast	50
Display language	English
PA1	
PA4	
Open display langu	age menu


Turn the rotary switch to ♦ (settings).

- () Enter the currently valid key number.
- * Confirm key number.
- Select 'Display language'.
- * Activate editing mode for the language setting. The currently valid language is selected.
- O Change the language setting accordingly.
- * Confirm setting.

Turn the rotary switch back to (operating level).


7.3 Setting the system code number

Different hydraulic schematics are available. Each hydraulic schematic is represented by a system code number. The systems together with their ready-configured functions are shown in Annex A (configuration instructions). A system is adapted to individual requirements by setting the functions and parameters. Changing the system code number resets previously adjusted function blocks to their default settings (WE). Function block parameters and parameter level settings remain unchanged. The system code number is set in the configuration and parameter level.




Turn the rotary switch to ♦ (settings).

- () Enter the currently valid key number.
- * Confirm key number.




- () Select 'System'.
- * Open 'System'.



O Select the required system (see Annex A).

7-4 EB 5578 EN




- * Confirm the system selected.
- () Select 'Back'.
- * Exit menu.

Turn the rotary switch to \diamondsuit (settings).


7.4 Activating and deactivating functions

A function is activated or deactivated in the associated function block. Annex A (configuration instructions) contains a detailed description of all functions.



Turn the rotary switch to ♦ (settings).

- () Enter the currently valid key number.
- * Confirm key number.




- 3 Select the required configuration level.
 - CO1: Heating circuit HC1
 - CO2: Heating circuit HC2
 - CO3: Heating circuit HC3
 - CO11: Heating circuit HC11
 - CO12: Heating circuit HC12
 - CO13: Heating circuit HC13
 - CO4: Domestic hot water heating (DHW)
 - CO5: System-wide functions
 - CO6: Modbus communication

Active function blocks are indicated by the black squares.

→ Only those configuration levels are available for selection which can be controlled by the selected system.

Start-up and configuration



FO5 Underfloor heating
FO5 1
Start temperature 25.0°C
Hold (days) 0
Underfloor heating/drying

- * Open configuration level.

 The first function block is selected (marked gray).
- Select the required function.

Functions without function block parameters:

- * Activate editing mode for the function. The currently active configuration '0' or '1' is shown inverted on the display.
- Activate function (1) or deactivate function (0).
- * Confirm configuration.

Functions with function block parameters:

- * Open function.
- Select configuration.
- * Activate editing mode for configuration.

 The currently active configuration '0' or '1' is shown inverted on the display.
- Activate function (1) or deactivate function (0).
- * Confirm configuration.
- Select function block parameter.
- * Activate editing mode for function block parameter. The current setting is shown inverted on the display.
- Set function block parameter.

Proceed in the same manner to set further function blocks.

F17 Binary demand 0 F18 Requesting demand 0 F20 Ext. heat demand 0 Back

Exit menu

Exit configuration level:

- O Select 'Back'
- : Exit configuration level.

To adjust further function blocks in other configuration levels, repeat steps with gray background.

Turn the rotary switch back to (operating level).


7-6 EB 5578 EN



All function block settings are saved in a non-volatile memory in the controller.


7.5 Changing parameters

Depending on the system code number selected and the activated functions, not all parameters might be available. Annex A (configuration instructions) contains a detailed description of all parameters.




Turn the rotary switch to ♦ (settings).


- () Enter the currently valid key number.
- * Confirm key number.



- () Select the required parameter level.
 - PA1: Heating circuit HC1
 - PA2: Heating circuit HC2
 - PA3: Heating circuit HC3
 - PA11: Heating circuit HC11
 - PA12: Heating circuit HC12
 - PA13: Heating circuit HC13
 - PA4: Domestic hot water heating (DHW)
 - PA5: Boiler circuit of buffer tank systems
 - PA6: Modbus communication
- → Only those parameter levels are available for selection which can be controlled by the selected system.

Start-up and configuration





- * Open parameter level.

 The first parameter is selected (marked gray).
- Select parameter.
- * Activate editing mode for the parameter.

 The current setting is shown inverted on the display.
- () Set the parameter.
- * Confirm setting.
- * Proceed in the same manner to change further parameters.

Exit parameter level.

- () Select 'Back'.
- () Exit configuration level.

To adjust further function blocks in other configuration levels, repeat steps with gray background.

Turn the rotary switch back to (operating level).

i Note

All parameter settings are saved in a non-volatile memory in the controller.


7.6 Calibrating sensors

Various temperatures are measured by temperature sensors which are connected to the controller. The controller is designed for connection of Pt1000, PTC and Ni1000 sensors.

- CO5 -> F01 1, F02 0: Pt 1000
- CO5 -> F01 0, F02 0: PTC
- CO5 -> F01 1, F02 1: Ni 1000
- → The sensor resistance values are listed in the 'Design and principle of operation' section.


7-8 EB 5578 EN

If the temperature values displayed at the controller differ from the actual temperatures, the measured values of all connected sensors can be recalibrated. To calibrate a sensor, the currently displayed sensor value must be changed such that it matches the temperature (reference temperature) measured directly at the point of measurement. Sensor calibration is activated in CO5 in F20 function block. An incorrect sensor calibration can be deleted by setting F20 - 0.



Turn the rotary switch to \diamondsuit (settings).


- () Enter the currently valid key number.
- * Confirm key number.



- * Select CO5 configuration level.
- * Open CO5 configuration level.
- * Select function block F20.
- * Activate editing mode for F20 function block.
- Select F20 configuration.
- * Activate editing mode for configuration.

 The currently active configuration '0' or '1' is shown inverted on the display.
- Activate function block ('1').
- * Confirm activation.

Start-up and configuration



- * Select the temperature that you want to calibrate.
- * Open calibration.

 The temperature is shown inverted on the display.
- * Correct measured value.

 Read the actual temperature directly from the thermometer at the point of measurement and enter this value as the reference temperature.
- * Confirm corrected measured value.
- * Proceed in the same manner to calibrate further sensors.

Exit configuration level:

- () Select 'Back'.
- () Exit configuration level.

Turn the rotary switch back to (operating level).

7-10 EB 5578 EN

7.6.1 Special values

Special values		
0-10 V meas. v.	0.0	
Measured v. 2	39.3	
Measured v. 3	63.9	
Measured v. 8	14.4	


If sensor inputs not relevant for closed-loop control are connected, the 'Special values' screen is automatically displayed in the controller's operating level. A maximum of five measured values (sensor inputs or 0 to 10 V input) can be displayed. These readings are displayed without a unit. '°C' is the unit for all sensor inputs. The value originating from the 0 to 10 V input with the CO5 -> F25 - 1 setting is displayed as a percentage.

Measured value number	Terminal number
1	1
2	2
3	3
4	4
5	5
6	6
7	8
8	9
9	10

Measured value number	Terminal number
10	11
11	12
12	13
13	15
14	16
15	17
16	7
17	14

7.7 Entering customized key number

To prevent the function and parameter settings being changed by unauthorized users, a customized key number can be added to the fixed service key number. You can set the customized key number to be between 0100 and 1900.



Turn the rotary switch to ♦ (settings).

- () Enter key number 1995.
- * Confirm key number.
- O Enter valid key number.
- * Confirm key number.
- () Enter customized key number.
- * Confirm customized key number.
 This number is the new key number.

Turn the rotary switch back to \square (operating level).

7-12 EB 5578 EN

8 Setup

8.1 Selecting the operating mode

The controller can be operated in the following modes:

Day mode (rated operation): regardless of the programmed times-of-use and summer mode, the set points relevant for rated operation are used by the controller. Icon: ※※


Night mode (reduced operation): regardless of the programmed times-of-use, the set points relevant for reduced operation are used by the controller. Icon:)

Control operation deactivated: regardless of the programmed times-of-use, control operation of the heating circuits and DHW heating remains deactivated. The frost protection is activated, if need be. Icon: \bullet

Icons when the frost protection is activated: HC 🕹 🕽, DHW 💩 🛠

Automatic mode: During the programmed times-of-use, the controller works in day mode. Outside these times-of-use, the controller is in night mode, unless control operation is deactivated depending on the outdoor temperature. The controller switches automatically between both operating modes. Icon within the times-of-use: ⑤芳, icon outside the times-of-use: ⑤  )


Manual mode: valves and pumps can be controlled manually. For further details, see section 8.6




Turn the rotary switch to OC (operating modes). The operating states of all system control circuits are displayed:

- Heating circuit HC1
- Heating circuit HC2
- Heating circuit HC3
- Heating circuit HC11
- Heating circuit HC12
- Heating circuit HC13
- DHW heating
- → Only those control circuits are available for selection which can be controlled by the selected system.
- Select the control circuit.

Setup





- * Activate editing mode for the control circuit. The operating mode is shown inverted on the display.
- Select the operating mode:
 - Automatic mode
 - 業 Day mode
 - Night mode
 - System deactivated
- * Confirm the operating mode.

The controller is usually in automatic mode.

8-2 EB 5578 EN

8.2 Schedules

The controller operates according to the schedules in automatic mode.

8.2.1 Setting the time and date

The current time and date need to be set immediately after start-up and after a power failure lasting more than 24 hours. This is the case when the time blinks on the display.

Time/date	
Time	08:23
Date (dd.mm.)	21.01.
Year	2015
Auto summertime	ON

Turn the rotary switch to \bigcirc (time/date). The current time is selected (gray background).

Time/date	
Time	08:23
Date (dd.mm.)	21.01.
Year	2015
Auto summertime	ON

- Activate editing mode for the time. The time reading is inverted.
- () Change the time.
- * Confirm the time setting.
- Time/date

 Time
 08:44

 Date (dd.mm.)
 21.01.

 Year
 2015

 Auto summertime
 ON
- O Select 'Date' (dd.mm) [O].

- Time/date

 Time
 08:44

 Date (dd.mm.)
 21.01.

 Year
 2015

 Auto summertime
 ON
- * Activate editing mode for the date. The date reading is inverted.
- O Change date (day.month).
- * Confirm the date setting.

Setup

Time/date	
Time	08:45
Date (dd.mm.)	05.02.
Year	2010
Auto summertime	ON

() Select 'Year'.

Time/date	
Time	08:45
Date (dd.mm.)	05.02.
Year	2010
Auto summertime	ON

- * Activate editing mode for the year. The year reading is inverted.
- O Change the year.
- * Confirm the year setting.

Deactivate or activate the automatic summer/standard time switchover as required.

() Select 'Auto summertime'.

Time/date	
Time	08:45
Date (dd.mm.)	05.02.
Year	2015
Auto summertime	ON

- Time/date

 Time
 08:45

 Date (dd.mm.)
 05.02.

 Year
 2015

 Auto summertime
 0N
- * Activate the editing mode for automatic summer/standard time switchover. The current setting is shown inverted on the display:
 - ON = Summer/standard time switchover active
 - OFF = Summer/standard time switchover not active
- Deactivate or activate the automatic summer/standard time switchover.
- * Confirm deactivation/activation.

Turn the rotary switch back to 🖵 (operating level).

i Note


The correct time is guaranteed after a power failure of 24 hours. Normally, the correct time is still retained at least 48 hours after a power failure.

8-4 EB 5578 EN

8.2.2 Setting the times-of-use


Three times-of-use can be set for each day of the week.


Parameters	WE		Value range
	HC1, HC2, HC3, HC11, HC12, HC13	DHW, CP	
Start first time-of-use	06:00	00:00	
Stop first time-of-use	22:00	24:00	
Start second time-of-use	:	:	00:00 to 24:00 h
Stop second time-of-use	:	:	in steps of 15 minutes
Start third time-of-use	:	:	
Stop third time-of-use	:	:	




Turn the rotary switch to \mathbb{E} (times-of-use). The first control circuit is displayed together with its programmed times-of-use.

- O Program the times-of-use of another control circuit, if required:
 - Heating circuit HC2
 - Heating circuit HC3
 - Heating circuit HC11
 - Heating circuit HC12
 - Heating circuit HC13
 - DHW heating
 - Circulation pump ZP
- → Only those control circuits are available for selection which can be controlled by the selected system.
- * Activate editing mode for the control circuit. The timesof-use for Monday are displayed.





C) Select period/day for which the times-of-use are to be valid. The times-of-use can be programmed for individual days or for a block of days, e.g. Monday to Friday, Saturday and Sunday or Monday to Sunday. The selected days are shown inverted on the display.



* Activate editing mode for the period/day.


The start time of the first time-of-use period can now be edited (inverted reading).

Change start time.The time is set in steps of 15 minutes.

* Confirm the start time. The stop time of the first time-of-use period can now be edited

C) End stop time.The time is set in steps of 15 minutes.

* Confirm the stop time.
The start time of the second time-of-use period can now be edited




To set the second and third times-of-use periods, repeat steps with gray background. If no further times-of-use are to be programmed for the selected time period/day, exit the menu by confirming the indicated start time twice (2x *). Proceed in the same manner to program further periods/days.

After setting all times-of-use:

- () Select 'Back'.
- * Exit the times-of-use setting.

Turn the rotary switch back to (operating level).



8.2.3 Setting the party timer (special time-of-use)


Rated operation in the corresponding control circuit (HC1, HC2, HC3 or DHW) is started or continued for the time period set in the party mode. When the party timer has elapsed, the party timer returns to --:--.

Parameters	WE	Value range
HC1 party timer	: h	0 to 48 h; in steps of 15 minutes
HC2 party timer	: h	0 to 48 h; in steps of 15 minutes
HC3 party timer	: h	0 to 48 h; in steps of 15 minutes
DHW party timer	: h	0 to 48 h; in steps of 15 minutes

Special use HC1 Party timer --:-- h DHW Party timer --:-- h Public holidays ---Vacations --.--

Turn the rotary switch to #x (special times-of-use). The party timer for the first control circuit is now selected.

- O Set time for party mode of another control circuit, if required:
 - Heating circuit HC2
 - Heating circuit HC3
 - DHW heating
- → Only those control circuits are available for selection which can be controlled by the selected system.
- * Activate editing mode for the party timer. The party timer is now in the editing mode (inverted display).
- Extend day operation as required.
 The time is set in steps of 15 minutes.





* Confirm setting.

After setting the party timer:

Turn the rotary switch back to \square (operating level).



The party timer runs down in steps of 15 minutes.

8.2.4 Programming public holidays (special times-of-use)

On public holidays, the times-of-use specified for Sunday apply.


A maximum of 20 public holidays may be entered.

Parameters	WE	Value range
Public holidays	:	01.01 to 31.12

Special use HC1 Party timer --:-- h DHW Party timer --:-- h Public holidays ---Vacations --.--


Turn the rotary switch to ** (special times-of-use). The party timer for the first control circuit is now selected.

Select 'Public holidays'.



- * Start the public holiday setting. The first public holiday setting is now selected. --:-- is displayed if no public holidays (default setting) have been programmed.
- O Select --:-, if applicable.

8-8 EB 5578 EN




- * Activate editing mode for public holidays.
- () Set the date of the public holiday.
- * Confirm the date.

Proceed in the same manner to program further public holidays.

Deleting a public holiday:

- () Select the holiday you wish to delete.
- * Confirm the date.
- () Select '--:-' setting
- * Confirm setting.
 The public holiday is deleted.



After programming all public holidays:

- () Select 'Back'.
- * Exit the public holiday setting.

Turn the rotary switch back to (operating level).



Public holidays that are not assigned to a specific date should be deleted by the end of the year so that they are not carried on into the following year.

8.2.5 Programming vacation periods (special times-of-use)

The system runs constantly in reduced mode during vacation periods. A maximum of ten vacation periods can be entered. Each vacation period can be separately assigned to the heating circuits HC1, HC2, HC3 and DHW circuit or to all control circuits.




If a vacation period is programmed to apply to all control circuits, it also applies to control circuits HC11, HC12 and HC13.

Parameters	Default	Value range
Vacation period	,,	01.01 to 31.12

Special use HC1 Party timer --:-- h DHW Party timer --:-- h Public holidays --- Vacations --.--.


Turn the rotary switch to Mr (special times-of-use). The party timer for the first control circuit is now selected.

O Select 'Vacations'.



* Start the vacations setting. The first vacations setting is now selected. --.-- is displayed if no vacations (default setting) have been programmed.


() Select --.--



Activate editing mode for vacations.
 The start date can now be edited (inverted reading).

- O Set the start date.
- Confirm the start date.
 The end date can now be edited.
- O Set the end date.

8-10 EB 5578 EN



- Confirm the year setting. 'All' is selected. The vacation period then applies to all control circuits.
- () If the vacation period is to be only valid for one control circuit, select the required control circuit:
 - Heating circuit HC1
 - Heating circuit HC2
 - Heating circuit HC3
 - DHW heating

available.

- → Only those control circuits are available for selection which can be controlled by the selected system.
 The control circuits HC11, HC12 and HC13 are not
- * Confirm the control circuit.


i Note

An active vacation period is indicated on the display by the \succeq icon.

Proceed in the same manner to program further vacations.

Deleting vacation periods:

- O Select the start date of the period you wish to delete.
- * Confirm vacation period.
- () Select --.--.
- * Confirm setting.
 The vacation period is deleted.



After programming all vacation periods:

- () Select 'Back'.
- * Exit the vacations setting.

Turn the rotary switch back to (operating level).



Vacations should be deleted by the end of the year so that they are not carried on into the following year.

8.3 Entering day and night set points

The day set points apply during day mode (rated operation) and during times-of-use programmed for automatic mode.

The night set points apply during night mode (reduced operation) and outside the times-ofuse programmed for automatic mode.

The desired room temperature for the day and night set points can be programmed.

Switch position ♣

Parameters	Default	Value range
HC1 room temperature	20.0 °C	0.0 to 40.0 °C
HC2 room temperature	20.0 °C	0.0 to 40.0 °C
HC3 room temperature	20.0 °C	0.0 to 40.0 °C
HC11 room temperature	20.0 °C	0.0 to 40.0 °C
HC12 room temperature	20.0 °C	0.0 to 40.0 °C
HC13 room temperature	20.0 °C	0.0 to 40.0 °C
DHW temperature	60.0 °C	Min. to max. DHW temperature
HC1 OT deactivation value	22.0 °C	0.0 to 50.0 °C
HC2 OT deactivation value	22.0 °C	0.0 to 50.0 °C
HC3 OT deactivation value	22.0 °C	0.0 to 50.0 °C
HC11 OT deactivation value	22.0 °C	0.0 to 50.0 °C
HC12 OT deactivation value	22.0 °C	0.0 to 50.0 °C
HC13 OT deactivation value	22.0 °C	0.0 to 50.0 °C

8-12 EB 5578 EN

Switch position • (

Parameters	Default	Value range
HC1 room temperature	15.0 °C	0.0 to 40.0 °C
HC2 room temperature	15.0 °C	0.0 to 40.0 °C
HC3 room temperature	15.0 °C	0.0 to 40.0 °C
HC11 room temperature	15.0 °C	0.0 to 40.0 °C
HC12 room temperature	15.0 °C	0.0 to 40.0 °C
HC13 room temperature	15.0 °C	0.0 to 40.0 °C
DHW temperature	40.0 °C	Min. to max. DHW temperature
HC1 OT deactivation value	15.0 °C	−50.0 to 50.0 °C
HC2 OT deactivation value	15.0 °C	−50.0 to 50.0 °C
HC3 OT deactivation value	15.0 °C	−50.0 to 50.0 °C
HC11 OT deactivation value	15.0 °C	−50.0 to 50.0 °C
HC12 OT deactivation value	15.0 °C	−50.0 to 50.0 °C
HC13 OT deactivation value	15.0 °C	−50.0 to 50.0 °C

Day set points HC1 Room temp. 20.0°C DHW DHW temp. 60.0°C HC1 OT deact. 22.0°C

Turn the rotary switch to ♣☼ (day set point) or ♣ℂ (night set point). The day or night set points appear on the display one after the other.

→ Only those day and night set points are available for selection which can be controlled by the selected system.

i Note

The deactivation values are located in a separate menu (deactivation values) for systems with three control circuits.

O Select the set point.

Night set points		
HC1 Room temp.	15.0°€	
DHW DHW temp.	40.0°C	
HC1 OT deac. da	15.0°C	

- * Activate editing mode for set point.
- () Adjust the set point.
- * Confirm setting.


Proceed in the same manner to adjust further set points.

After adjusting all the set points:

Turn the rotary switch back to (operating level).

8.4 Reset to default settings

All parameters set over the rotary switch as well as parameters in the PA1 and PA2 parameter levels can be reset to their default settings (WE). This does not apply to the maximum flow temperature and the return flow temperature limits in PA1 and PA2.



Turn the rotary switch to ♦ (settings).

- () Enter key number 1991.
- Confirm key number.
 The settings are reset when the following icon appears on the controller display:



8.5 Reading information

Different kinds of information can read off the controller display during operation. The controller display usually shows the date, time and the actual temperature when the rotary switch is switched to the 'Operating level' position.

 ${\bf Outdoor\text{-}temperature\text{-}compensated\ control\cdot Current\ temperature\text{-}=outdoor\ temperature}$





Deactivation depending on outdoor temperature active)




Vacations active

8-14 EB 5578 EN

Fixed set point control · Current temperature = Flow temperature




Further information can be obtained by turning the rotary pushbutton:





Operating state

The following applies for heating circuits HC1, HC2, HC3, HC11, HC12 and HC13:




The following applies for DHW heating:






Selected system code number

See Annex A (configuration instructions) for further information.



* Key measured values for the entire system (e.g. measured values and limits of a flow rate or capacity limitation or the demand to be processed) are shown, if activated



O Times-of-use (depending on system code number)

- Heating circuit HC1
- Heating circuit HC2
- Heating circuit HC3
- Heating circuit HC11
- Heating circuit HC12
- Heating circuit HC13
- DHW heating

The day mode times is highlighted in black on the time chart

Night mode and deactivation times are highlighted in gray on the time chart.

* Measured values, set points and limits of the system section shown are displayed.

DHW Values p.1/1
Betrieb: Zwischenheizen
St. tnk temp.1 39.3°C
St. tank SP 1 60.0°C

The 'DHW values' page also includes information on the operating state of the DHW heating.

The following messages are generated:

- 'Standby'
- 'Monitoring'
- 'Circulation' (= circulation losses are compensated for)
- 'Demand'
- 'Charging'
- Lag time'
- Intermediate heating'
- 'Discharging protection'

8-16 EB 5578 EN

Alarm list


15:45 Sensor failure 28.10. Start with defaults

14.12.2021 15:45 - Failed

Event list

18:04 CO5-F24=0 18:01 System=4.1 18:01 HC1 Automatic 17:59 HC1 Stand-by

14.12.2021 18:04 - Functio



- Alarm list
 The last four alarm entries are listed.
- * Open the alarm list and select further alarm entries (O). Further information on an alarm (including time and date when it occurred) runs across the display.
- Event list
 The last four event entries are listed.
- * Open the event list and select further event entries (1). Further information on an event (including time and date when it occurred) runs across the display.
- Trend-Viewer The standard graph shows the data measured at the outdoor sensor AF1 and flow sensor VF1 plotted over time.

Extended operating level

Information	
Modbus ID	5578
Serial number	4378
Software version	2.50
Hardware version	1.75

Information	p.1/3
Modbus station	255
Logging memory	OFF
Solar operation	0 h
Flow rate 1	0
Special flags	3840

Information	p.2/3
VF1-RüF1	°C
Y1 avg mth bfr lst	10240
Y1 avg last month	0
Y1 avg this month	0
Binary inputs	00000

Information	p.3/3
Reason for reset	SW

The following details on the controller version (device identification, serial number, software and hardware versions) and meter bus are displayed in the extended operating level

Turn the rotary switch to ♦ (settings).

- () Enter code number 1999.
- * Confirm key number.

 Turn the rotary switch to
 (operating level).
- Select 'Information'.

The additional "meter" page is displayed with connection status and further meter data for meters 1 to 3 in the "extended operating level" mode when the meter bus is activated (see Annex A). In addition, the respective measuring and limit values are displayed after confirming the plant scheme when the flow rate and/or capacity limitation is active.


i Note

- The additional information is hidden when the key number 1999 is entered again.
- The key number 1999 cannot be used to change the controller configuration and parameterization. A separate key number exists for configuration and parameterization (see the 'Start-up and configuration' section).

8-18 EB 5578 EN

8.5.1 Adapting the Trend-Viewer


The standard graph shows the data measured at the outdoor sensor AF1 and flow sensor VF1 plotted over time.



* Open the Trend-Viewer.


Adding measuring data

- O Select - on the display.
- * Activate editing mode for sensor selection.
- Select the sensor.
- * Confirm setting.



Deleting measured data:


- Select the sensor whose measured data are no longer to be displayed.
- * Activate editing mode for sensor.
- () Select - on the display.
- * Confirm deletion.




Shifting the time line:

- O Select 'Scroll'.
- * Activate editing mode for scroll function.
- AF1=5.3 16:51 VF1=-0.5 2021 Zoom RuF1=40.9 Back
- () Shift the time line.
- * Confirm time display.

Setup





Zooming in/out

- Select 'Zoom'.
- * Open zoom function.
- () Zoom in or out.
- * Confirm display.

Closing the Trend-Viewer

- () Select 'Back'.
- * Close the Trend-Viewer

8-20 EB 5578 EN

8.6 Operating the controller in manual mode

Switch to manual mode to configure all controller outputs.




System damage caused by frost when manual operating mode is active!

The frost protection function is deactivated in the manual operating mode.

→ Do not run the heating during cold weather in the manual mode for long periods of time.

Manually changing the positioning value/switching state:



Turn the rotary switch to \mathbb{T} (manual mode). The outputs of the configured system are listed on the display.

- Select the output
 - Positioning value
 - O Circulation pump (heating)
 - Storage tank charging pump

 - Solar circuit pump
- Activate editing mode for the output.
- c) Change the positioning value/switching state.
- Confirm the positioning value/switching state. The modified values remain active as long as the controller is in manual mode.

Turn the rotary switch to otin
ot

i Note

8-22 EB 5578 EN

9 Malfunctions

A malfunction is indicated by the blinking Δ icon on the display. Additionally, the display is illuminated for one second every 10 seconds upon sensor failure. Press the rotary pushbutton to open the error level. As long as an malfunction exits, the error message is included in the reading loop, even when it has not been opened by pressing the rotary pushbutton.

In the error level, the error message is displayed as specified in the following list (see section 9.1).

A DANGER

Risk of electric shock while performing electrical connection.

For electrical installation, you are required to observe the relevant electrotechnical regulations of the country of use as well as the regulations of the local power suppliers.

→ Only allow properly trained and experienced personnel perform the wiring.

NOTICE

Risk of damage to the heating controller due to incorrectly performed work.

→ Only properly trained personnel appropriately qualified to carry out such tasks must be allowed to perform corrective action.

i Note

After the system code number has been changed or after restarting the heating controller, any error messages are suppressed for approx. three minutes.

9.1 Error list

Sensor failure = Sensor failure (see section 9.2)

Err TROVIS I/O = TROVIS I/O communication error

Disinfection = Disinfection temperature not reached. See 'Thermal disin-

fection of DHW storage tank' function in Annex A (con-

figuration instructions).

Max. charging temp. = Max. charging temperature reached. See 'DHW heating

in the storage tank charging system' function in Annex A

(configuration instructions).

External = Error message from device bus

Temp. monitoring = Temperature monitor alarm

Unauthorized access = Unauthorized access occurred (see section 9.4)

Binary alarm = Error message of a binary input

Meter bus = Meter bus communication error

Heat meter = Heat meter error registered

i Note

If the error messages or indications that can be confirmed are included in the list shown, you can decide whether you want to confirm these error messages on exiting the error list.

9.2 Sensor failure

As described in the error list, sensor failures are indicated by the 'Sensor failure' error message in the error level. For detailed information, exit the error level and view the different temperature values in the information level: each sensor icon displayed together with three dashes instead of the measured value indicates a defective sensor. The following list explains how the heating controller responds to the failure of the different sensors.

Outdoor sensor AF1/2: when the outdoor sensor fails, the controller uses a flow temperature set point of 50 °C or the 'Max. flow temperature' when the max. flow temperature (PA1, 2, 3 -> P07) is lower than 50 °C. With the setting CO1, 2, 3 -> F05 - 1 (underfloor heating), the flow temperature set point is 30 °C in the event of a malfunction.

9-2 EB 5578 EN

- Flow sensor(s) in heating circuit(s): when the flow sensors in the heating circuits are defective, the associated valve moves to 30 % travel. DHW heating which use such a sensor to measure the charging temperature is suspended. DHW heating which use such a sensor to measure the charging temperature is suspended.
- Flow sensors in the DHW circuit with control valve: when the DHW circuit has two
 charging temperature sensors VF2 and VF4, the controller behaves as if VF4 sensor has
 not been configured if it is defective. As soon as the control of the charging temperature
 using the VF2 sensor or the DHW temperature becomes impossible, the associated valve
 is closed
- Return flow sensor: when the return flow sensor fails, the controller continues operation without return flow temperature limitation.
- Room sensor RF: when the room sensor fails, the controller uses the settings for operation
 without room sensor. The controller, for example switches from optimizing mode to reduced operation. The adaptation mode is canceled. The last determined heating characteristic remains unchanged.
- Storage tank sensors SF1/2: when one of the two sensors fails, the storage tank is no longer charged (exception: solar system).
- Solar circuit sensors SF, VF/RüF: when one of the two sensors fails, the storage tank in the solar circuit is no longer charged.

9.3 Temperature monitoring

When a system deviation greater than 10 °C persists in a control circuit for 30 minutes, the 'Temp. monitoring' message is generated.

Functions	WE	Configuration
Monitoring	0	CO5 -> F19 - 1

9.4 Fault alarm output

With the setting CO5 -> F07 - 1, the output at terminals 37, 38, 43 or the output at terminal 46 is used for fault indication (specific terminals listed in the table of each system). The fault alarm output is activated (bA = 1 setting) or deactivated (bA = 0 setting) when at least one of the errors from the error list (bold) occurs.

This function is not available for systems Anl 5.1, 5.2, 5.9, 6.1, 9.1, 9.2, 9.5, 9.6, 12.1, 12.2, 13.1, 13.2, 13.6, 15.1, 15.2, 15.3, 17.8, 21.1 and 21.2.

EB 5578 EN 9-3

Malfunctions

Functions	WE	Configuration
Fault alarm output at terminal 37,	0	CO5 -> F07 - 1
38, 43 or 46 (depending on the system selected)	1	bA = 1, 0

9.5 Error status register

The error status register is used to indicate controller or system errors. The error messages which cause a change in the state of the configured fault alarm output (CO5 -> F07 - 1) are highlighted in the following table (bold).

The function blocks in the CO8 configuration level allow single controller inputs that are not used to be added to the error status register as binary inputs. Either an open or closed binary input can be configured to indicate an error. The controller indicates 'Binary alarm' when at least one of the inputs configured in this way registers an error.

i Note

If free inputs are to issue binary signals to a building control station without affecting the error status register, activate the corresponding function block in the CO8 configuration level and select 'None' as the function block parameter.

Error message	Decimal value	
Sensor failure	1	1
TROVIS I/O failure	2	
Disinfection	4	
Max. charging temp.	8	
External	16	
Temp. monitoring	32	32
Unauthorized access	64	
Binary alarm	128	
Meter bus	256	
Heat meter	512	
		Total
Example: Value of error status register when a sensor fails and a temperature monitoring alarm =		33

9-4 EB 5578 EN

10 Servicing

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

We recommend inspection and testing according to Table 10-1.

Table 10-1: Recommended inspection and testing

Inspection and testing	Action to be taken in the event of a negative result
Check the markings, labels and nameplates on the controller for their readability and	→ Immediately renew damaged, missing or incorrect nameplates or labels.
completeness.	→ Clean any inscriptions that are covered with dirt and are illegible.
Check the electric wiring.	→ If any wires are loose, open the controller housing and tighten the terminal screws (see the 'Installation' section).
	→ Renew damaged wires.
Compare the temperature values displayed at the controller with the actual temperatures at the point of measurement.	→ If the displayed and actual temperatures differ, calibrate the sensors (see the' Start-up and configuration' section).

10-2 EB 5578 EN

11 Decommissioning

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

▲ DANGER

Risk of fatal injury due to electric shock.

→ Before disconnecting live wires, switch off the supply voltage at the controller and protect it against unintentional reconnection.

To put the controller out of operation, the controller must be disconnected from the voltage supply:

- → Controller connected to a control station: log the controller off from the control station and remove the communication module from the RJ-45 jack.
- Controller connected to TROVIS-VIEW: remove the connecting cable from the RJ-45 jack.
- → If a memory module/mini module or logging module is used: save data and remove the memory module/mini module or logging module from the the RJ-45 jack.
- Disconnect the supply voltage and protect it against unintentional reconnection.
- Unscrew the top left and right screws on the front of the controller to open the controller housing.

- → Disconnect the electrical wires from the terminals
- → Pull the wires out of the cable ducts.

11-2 EB 5578 EN

12 Removal

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

Panel mounting

- 1. Put the controller out of operation (see the 'Decommissioning' section).
- Unscrew the top left and bottom right screws to unfasten the controller housing from the control panel.

Wall mounting

- Put the controller out of operation (see the 'Decommissioning' section).
- Unscrew the fastening screws and remove the back of the housing from the wall.

Rail mounting

- Put the controller out of operation (see the 'Decommissioning' section).
- Unscrew the top left and bottom right screws to unfasten the controller housing from the top-hat rail.

12-2 EB 5578 EN

13 Repairs

A defective controller must be repaired or replaced.

NOTICE

Risk of controller damage due to incorrect service or repair work.

- → Do not perform any repair work on your own.
- → Contact SAMSON's After-sales Service for service and repair work.

13.1 Returning devices to SAMSON

Defective controllers can be returned to SAMSON for repair.

Proceed as follows to return devices to SAMSON:

- 1. Put the controller out of operation (see the 'Decommissioning' section).
- Remove the controller (see the 'Removal' section).
- 3. Proceed as described on the Returning goods page of our website
 - www.samsongroup.com > Service & Support > After-sales Service > Returning goods

13-2 EB 5578 EN

14 Disposal



SAMSON is a producer registered at the following European institution

https://www.ewrn.org/national-registers.
WEEE reg. no.:
DE 62194439/FR 025665

- → Observe local, national and international refuse regulations.
- → Do not dispose of components, lubricants and hazardous substances together with your other household waste.

i Note

We can provide you with a recycling passport according to PAS 1049 on request. Simply e-mail us at aftersalesservice@samsongroup.com giving details of your company address.

-∵Ö- Tip

On request, we can appoint a service provider to dismantle and recycle the product.

14-2 EB 5578 EN

15 Certificates

The following certificate is shown on the next page:

- EU declaration of conformity

The certificate shown was up to date at the time of publishing. The latest certificates can be found on our website:

 \blacktriangleright www.samsongroup.com > Products & Applications > Product selector > Automation Systems > 5578

EU declaration of conformity

SMART IN FLOW CONTROL



EU Konformitätserklärung/EU Declaration of Conformity/ Déclaration UE de conformité

Die alleinige Verantwortung für die Ausstellung dieser Konformitätserklärung trägt der Hersteller/ This declaration of conformity is issued under the sole responsibility of the manufacturer/ La présente déclaration de conformité est établie sous la seule responsabilité du fabricant. Für das folgende Produkt/For the following product/Nous certifions que le produit

Heizungs- und Fernheizungsregler / Heating and District Heating Controller /
Régulateur de chauffage et de chauffage à distance
Typ/Type/Type TROVIS 5578

wird die Konformität mit den einschlägigen Harmonisierungsrechtsvorschriften der Union bestätigt / the conformity with the relevant Union harmonisation legislation is declared with/ est conforme à la législation d'harmonisation de l'Union applicable selon les normes:

EMC 2014/30/EU EN 61000-6-3:2007

+A1:2011

LVD 2014/35/EU EN 60730-1:2016
RoHS 2011/65/EU EN 50581:2012

Hersteller / Manufacturer / Fabricant

SAMSON AKTIENGESELLSCHAFT Weismüllerstraße 3 D-60314 Frankfurt am Main Deutschland/Germany/Allemagne

Frankfurt / Francfort, 2017-07-29

Im Namen des Herstellers/ On behalf of the Manufacturer/ Au nom du fabricant.

i.V. best parles

Zentralabteilungsleiter/Head of Department/Chef du département Entwicklung Automation und Integrationstechnologien/ Development Automation and Integration Technologies iv. H. Erge

Hanno Zager Leiter Qualitätssicherung/Head of Quality Managment/ Responsable de l'assurance de la qualité

SAMSON AKTIENGESELLSCHAFT Weismüllerstraße 3 60314 Frankfurt am Main Telefon: 069 4009-0 · Telefax: 069 4009-1507 E-Mail: samson@samson.de Revison 07

This annex contains information on the configuration of the controller.


16.1 Systems

Different hydraulic schematics are available. The system images on the display show the structure of the hydraulic system.


Boiler systems:

Single-stage boiler systems can be configured to include any system whose heating circuits and DHW circuit include just one heat exchanger. These systems are 1.0-1, 1.5-1, 1.6-1, 1.6-2, 1.7-1, 1.8-1, 1.8-2, 1.9, 2.x, 3.x, 4.x, 5.x, 6.0, 7.x, 8.x, 9.x, 11.1-3, 14.x, 15.x, 16.x and 17.x.

The boiler can be controlled by an on/off output (CO1 -> F12 - 0).

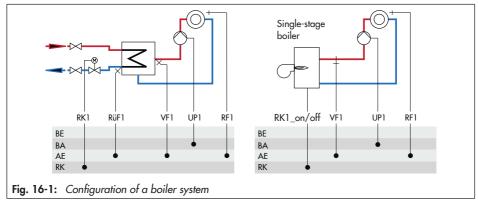


System Anl 1.0-1

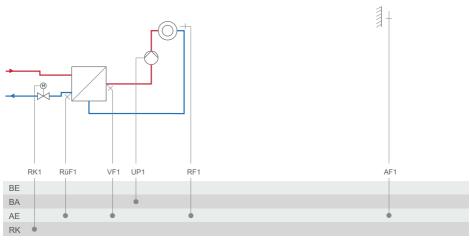

System	1.0-1	
	Anlage 1.0 - 1	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	Control signal Y1 (RK1)	
	 Differential temperature control 	When CO1 -> F23 - 1
	 External demand 	When CO1 -> F18 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1 Direction = Output


16-2 EB 5578 EN

System Anl 1.0-2

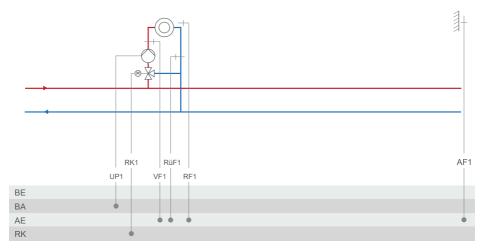

System	1.0-2	
	Aniaue 1.0 - 2	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM): - Control signal Y1 (RK1) - Differential temperature control - External demand	When CO1 -> F23 - 1 When CO1 -> F18 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1 Direction = Output


System Anl 1.1-1

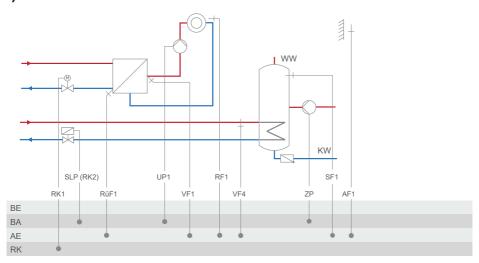

System	1.1-1	
	Anlage HK1 TW STORY STORY TW TW TW TW TW TW TW TW TW T	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-4 EB 5578 EN

System Anl 1.1-2

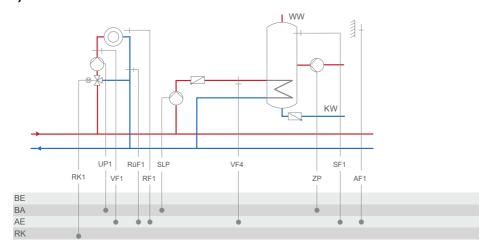

System	1.1-2	
	Anlaue HK1 TW	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 1.2

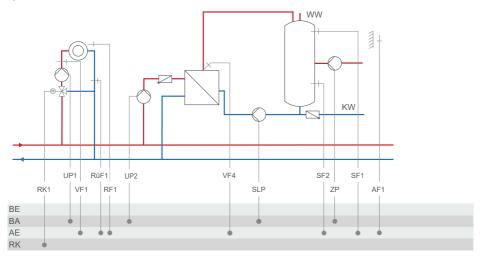

System	1.2	
	Anlage HK1 TW G	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 External demand 	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-6 EB 5578 EN

System Anl 1.3-1

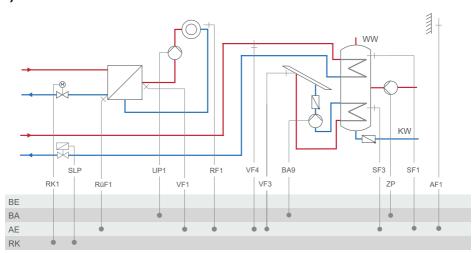

System	1.3-1	
	Anlaue HK1 TW C	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	– Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 1.3-2

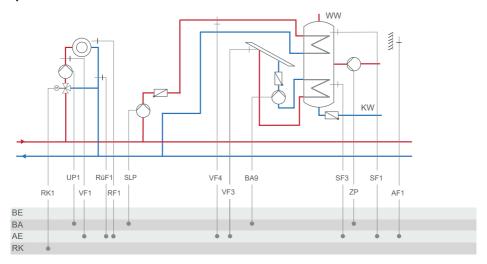

System	1.3-2	
	Anlage HK1 TW G	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-8 EB 5578 EN

System Anl 1.4

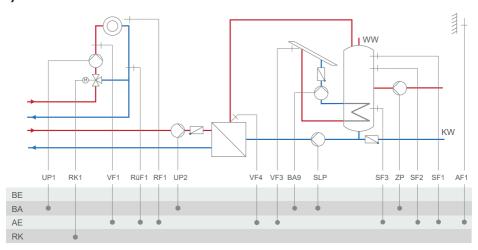

System	1.4	
	Anlage HK1 TW G G G G G G G G G G G G G	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1 Direction = Output


System Anl 1.5-1

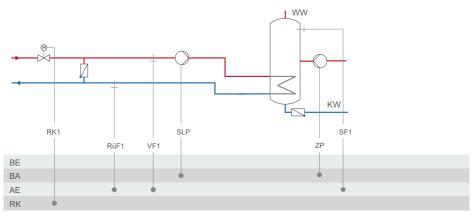

System	1.5-1	
	Anlage 1.5 - 1	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


16-10 EB 5578 EN

System Anl 1.5-2

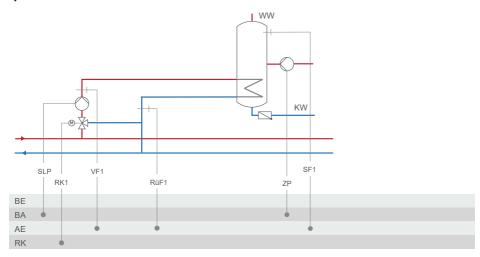

System	1.5-2	
	Anlaue 1.5 - 2	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM): - Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


System Anl 1.6-1

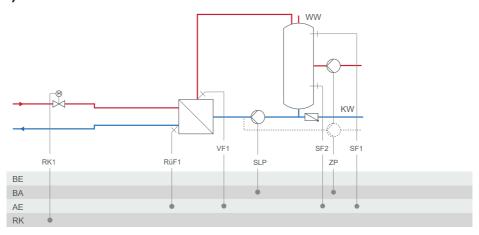

System	1.6-1	
	Anlaue I.G TW	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


16-12 EB 5578 EN

System Anl 1.6-2

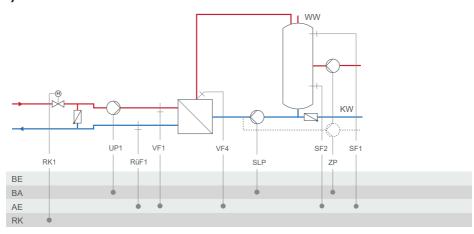

System	1.6-2	
	Anlaue 1.5 - 2 HK 1 TW [7]	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	- 0 (without VF4; in this case, VF1 usually installed at the point of measurement of VF4)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


System Anl 1.6-3

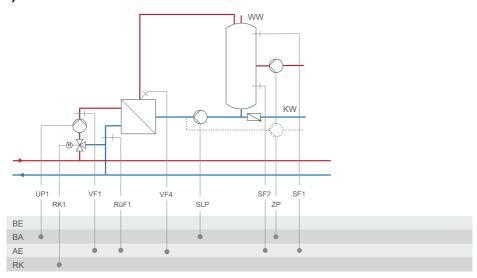

System	1.6-3
	Anlarue 1.6 - 5 HX1 TWI SEC. SE
Default setting	·
CO1 -> F03	- 1 (with RüF1)
CO4 -> F01	- 1 (with SF1)
CO4 -> F02	- 1 (with SF2)
CO4 -> F05	 O (without VF4; in this case, VF1 usually installed at the point of measure ment of VF4)
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)
CO5 -> F07	- 0 (without error message at terminal 43)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	- Control signal Y1 (RK1)
	- External demand When CO1 -> F18 - 1
	- SLP speed When CO4 -> F21 - 1
	 ZP speed When CO4 -> F25 - 1


16-14 EB 5578 EN

System Anl 1.7-1

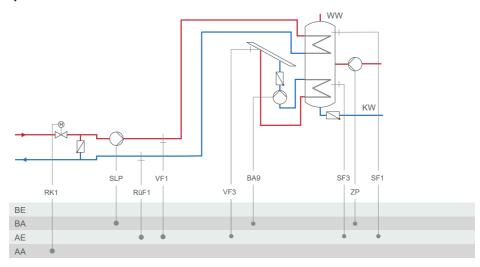

System	1.7-1	
	Anlage HK1 TW S C TW TW TW TW TW TW TW TW TW	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


System Anl 1.7-2

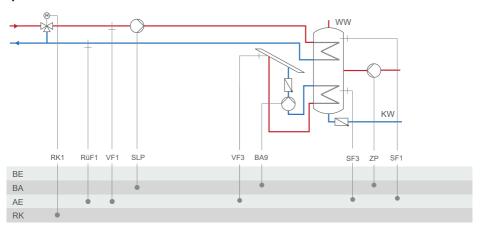

System	1.7-2	
	Anlage HK1 TW G	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


16-16 EB 5578 EN

System Anl 1.8-1

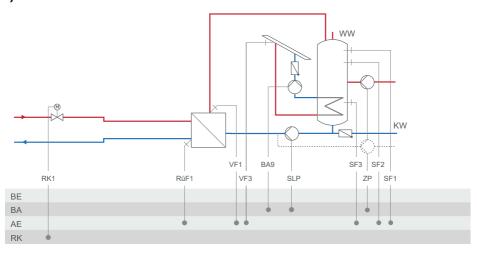

System	1.8-1	
	Anlage HK1 TWA S C S C TWA TWA TWA TWA TWA TWA TWA	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	– External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


System Anl 1.8-2

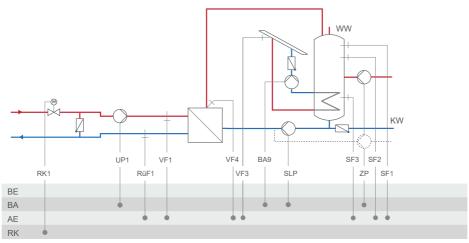

System	1.8-2	
	Anlage 18-2 HK1 TNJ 2 1-21	
Default setting		
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	O (without VF4; in this case, VF1 usually installed at the point of measurement of VF4)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 External demand 	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


16-18 EB 5578 EN

System Anl 1.8-3

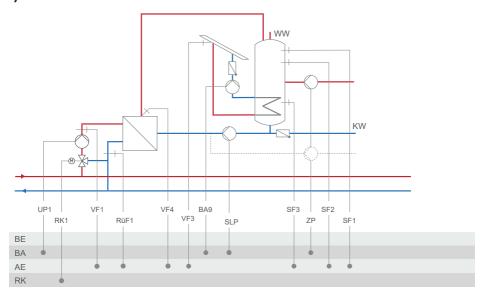

System	1.8-3		
	Anlaue HK1 TM G G KB		
Default setting			
CO1 -> F03	- 1 (with RüF1)		
CO4 -> F01	- 1 (with SF1)	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)		
CO4 -> F05	- 0 (without VF4; in this case, VF1 usually installed at the point of measurement of VF4)		
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)		
CO5 -> F07	- 0 (without error message at terminal 43)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	– ZP speed	When CO4 -> F25 - 1	


System Anl 1.9-1

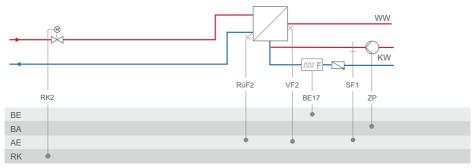

System	1.9-1	
	Anlage 1.9 Two	
Default setting		
CO4 -> F01	- 0 (without SF1)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F04	- 0 (without flow rate sensor)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y2 (RK2)	
	- 10 V supply	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1


16-20 EB 5578 EN

System Anl 1.9-2

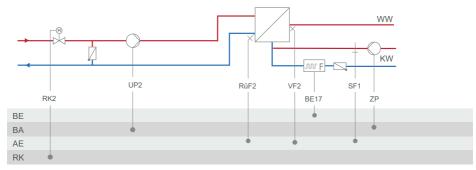

System	1.9-2	
	Anlage 1.9 - 2 TW Z	
Default setting		
CO4 -> F01	- 0 (without SF1)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F04	- 0 (without flow rate sensor)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y2 (RK2)	
	- 10 V supply	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1


System Anl 2.0

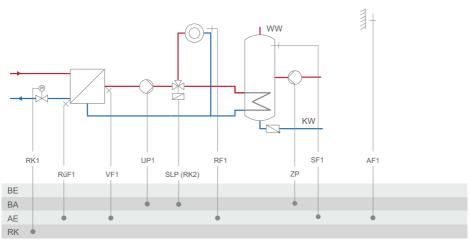

System	2.0	
	Anlaue Z.O TW	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-22 EB 5578 EN

System Anl 2.1

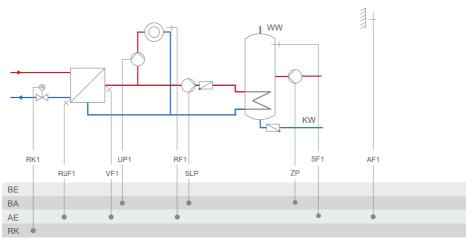

System	2.1	
	Anlage HK1 TW S S S S S S S S S S S S S	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 2.2

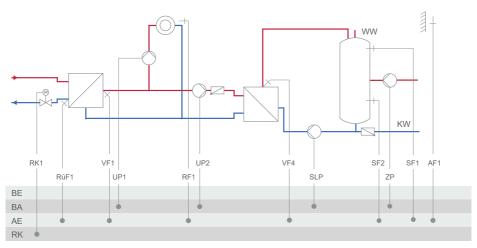

System	2.2	
	Anlage 22	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-24 EB 5578 EN

System Anl 2.3

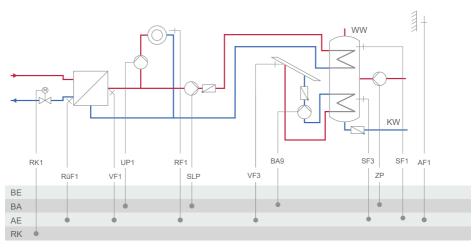

System	2.3	
	Anlaue 2.5	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	– Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 2.4

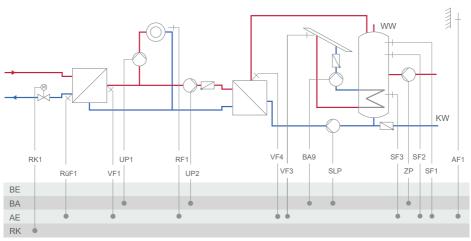

System	2.4	
	Aniaue ZXI	
Default setting	·	
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-26 EB 5578 EN

System Anl 3.0

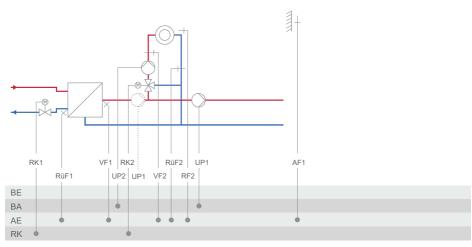

System	3.0	
	Anlage 3.0 HK1 HK2 \$\frac{1}{2} \times \frac{1}{2} \times \frac{1}{2	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F14	- 0 (UP1 only active during the processing for an	external demand)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 3.1

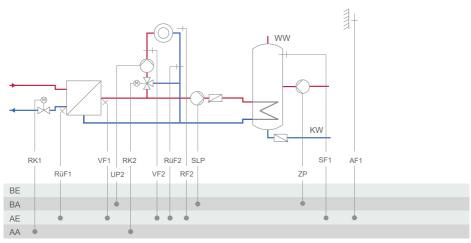

System	3.1	
	Anlarue TWA SCHOOL STAND	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand When CO1	-> F18 - 1
	- SLP speed When CO4	-> F21 - 1
	- ZP speed When CO4	-> F25 - 1
	Outdoor temperature When CO5Direction =	

16-28 EB 5578 EN


System Anl 3.2

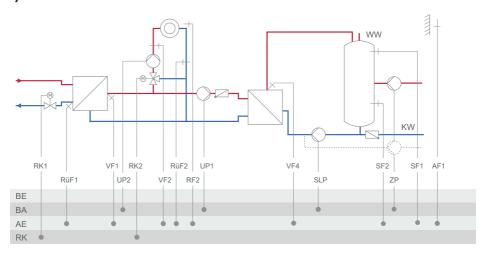

System	3.2	
	Anlage 3.2	
	HICH HIZ TW	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	- 0 (without VF4)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1
		Direction = Output


16-30 EB 5578 EN

System Anl 3.3

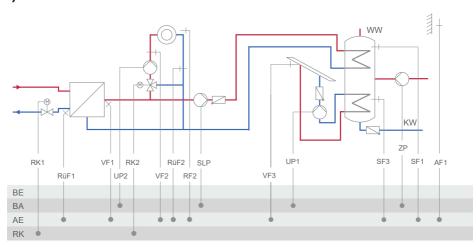

System	3.3	
	Anlage TNA PC C C C C C C C C C C C C C C C C C C	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 3.4

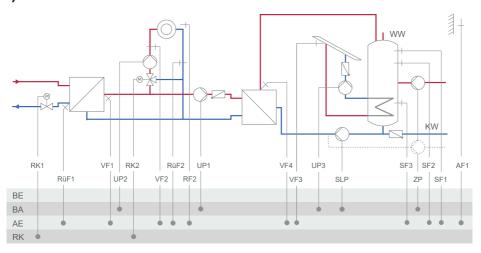

16-32 EB 5578 EN

System	3.4	
	Anlage 3.4	
	WAR-O	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 3.5

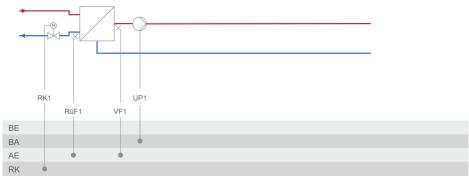

System	3.5	
	Anlage 3.5 80.121-⊙—	
Note:	Closed control circuit and UP1 are only active during the processing for an external demand.	
Default settings		
CO1 -> F03	- 1 (with RüF1)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- External demand When CO1 -> F18 - 1	

16-34 EB 5578 EN


System Anl 3.9

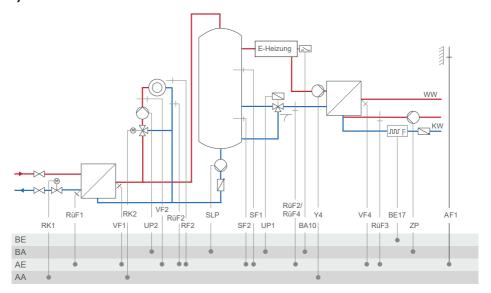

System	3.9	
	Anlage 3.9 HK1 HK2 TW TW SCI 27-0	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2 in RK2)	
CO4 -> F03	- 0 (without RüF2/RüF4)	
CO4 -> F04	- 0 (without flow switch)	
CO4 -> F14	- 0 (without RüF3)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	 Control signal Y4 	
	- SLP speed	When CO1 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-36 EB 5578 EN

System Anl 4.0

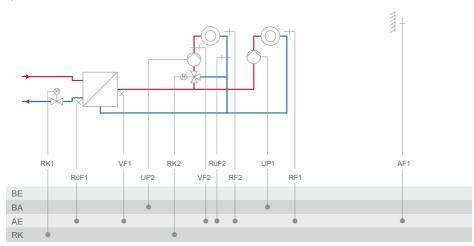

System	4.0	
	Anlage 4.0	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 4.1

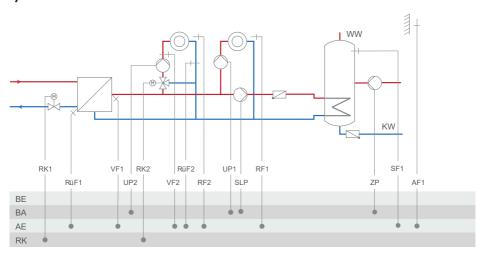

System	4.1	
	Anlaue HKI HKE KE KE KE KE KE KE KE KE KE	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-38 EB 5578 EN


System Anl 4.2

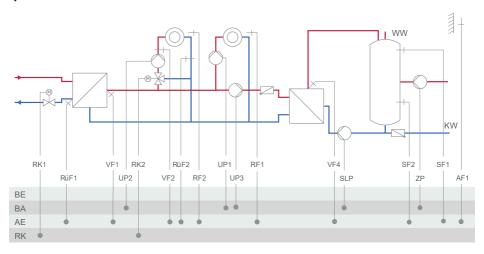

System	4.2	
	Anlage HKL HK2 TNU OK S	
	& _Z	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand When CO1 ->	F18 - 1
	- SLP speed When CO4 ->	F21 - 1
	- ZP speed When CO4 ->	F25 - 1
	 Outdoor temperature When CO5 -> Direction = Out 	


16-40 EB 5578 EN

System Anl 4.3

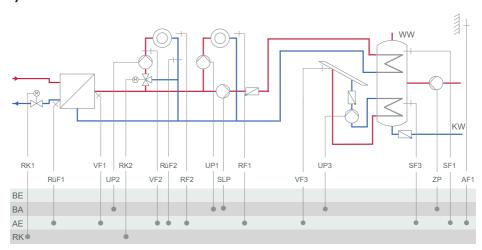

System	4.3	
	Anlage HKI HKE V KE TW SAG	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 4.5

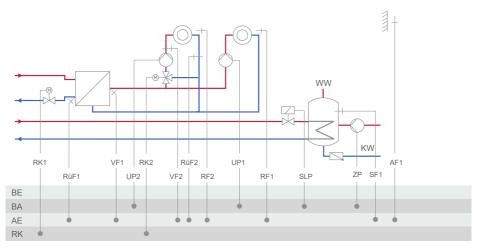

System	4.5	
	Anlaue 155	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-42 EB 5578 EN

System Anl 5.0

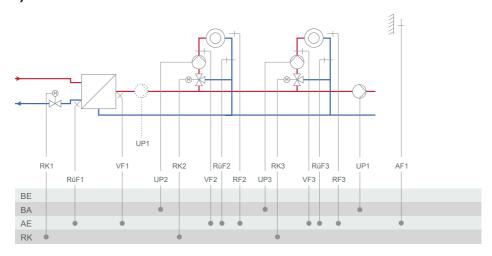

System	5.0		
	Anlage 5.0 HK1 HK2 HK3		
control with AF1; CO2 -> F02 - 1, select RK3: CO3 -> F02 - 0 = Fixed set point of	RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO2 -> F01	- 0 (without RF2)		
CO2 -> F02	- 1 (with AF1)		
CO2 -> F03	- 0 (without RüF2)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F14	- 0 (UP1 only active during the processing for an external demand)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	- Control signal Y2 (RK2)		
	- Control signal Y3 (RK3)		
	- External demand When CO1 -> F18 - 1		
	I and the second		


- Outdoor temperature

When CO5 -> F23 - 1

Direction = Output

16-44 EB 5578 EN

System Anl 5.1

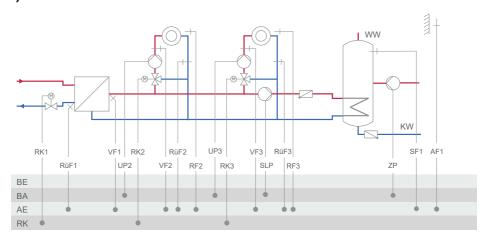


System	5.1	
	Anlage HK1 HK2 HK3 TW AND AND AND AND AND AND AND AN	
control with AF1; CO2 -> F02 - RK3: CO3 -> F02 - 0 = Fixed set	point control; CO2 -> F02 - 1, select AF1 = Outdoo 1, select AF2 = Outdoor-temperature-compensated point control; CO3 -> F02 - 1, select AF1 = Outdoo 1, select AF2 = Outdoor-temperature-compensated	control with AF2 or-temperature-compensated
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO3 -> F01	- 0 (without RF2)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)
	- Control signal Y2 (RK2)
	- Control signal Y3 (RK3)
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1

16-46 EB 5578 EN

Direction = Output

System Anl 5.2

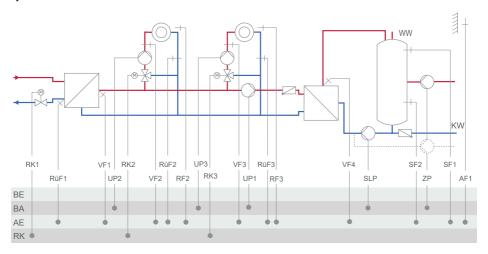


System	5.2		
	Anlage 52 HK1 HK2 HK3 TW SA Z		
control with AF1; CO2 -> F02 - 1, se RK3: CO3 -> F02 - 0 = Fixed set poi	nt control; CO2 -> F02 - 1, select AF1 = Outdoor-te elect AF2 = Outdoor-temperature-compensated con nt control; CO3 -> F02 - 1, select AF1 = Outdoor-te elect AF2 = Outdoor-temperature-compensated con	trol with AF2 emperature-compensated	
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO2 -> F01	- 0 (without RF2)		
CO2 -> F02	- 1 (with AF1)	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	- 0 (without RüF2)	
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 1 (with SF2)		
CO4 -> F05	- 0 (without VF4)		
CO4 -> F10	- 0 (DHW circulation return flow in storage tar	nk)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	 Control signal Y2 (RK2) 		
	 Control signal Y3 (RK3) 		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	 Outdoor temperature 	When CO5 -> F23 - 1	

16-48 EB 5578 EN

Direction = Output

System Anl 5.9

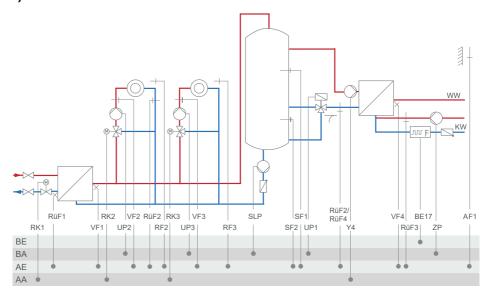


System	5.9	
	Anlaue 5.9 HIC1 HIC2 FINAL	
RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2 in RK2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO4 -> F03	- 0 (without RüF2/RüF4)	
CO4 -> F04	- 0 (without flow switch)	
CO4 -> F14	- 0 (without RüF3)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM): - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - Control signal Y4	ud co. ro. i
	- SLP speed	When CO1 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- External demand	When CO1 -> F18 - 1

16-50 EB 5578 EN

- Outdoor temperature

When CO5 -> F23 - 1 Direction = Output

System Anl 6.0

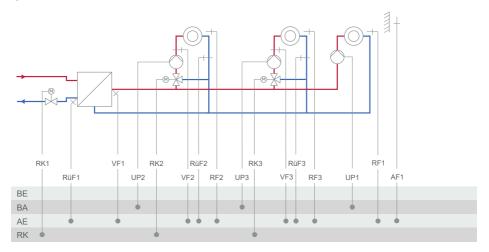


System	6.0	
	Anlaue HICL HICE HICE O O O CRICKI	
RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM): - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3)	
	- External demand When CO1 -> F18 - 1	
	 Outdoor temperature When CO5 -> F23 - 1 	

Direction = Output

16-52 EB 5578 EN

System Anl 6.1

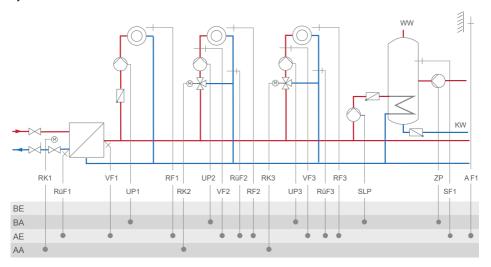


System	6.1	
	Anlage HK1 HK2 HK3 TUM ST S	
RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1

16-54 EB 5578 EN


Direction = Output

System Anl 7.1

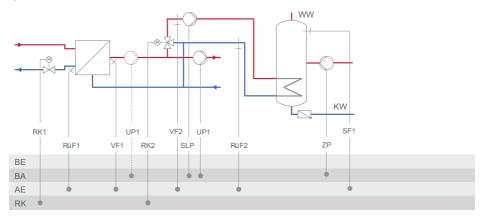

System	7.1	
	Anlage 7.4	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 0 (without AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F14	- 0 (UP1 only active during the processing for a	n external demand)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	– Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1


System Anl 7.2

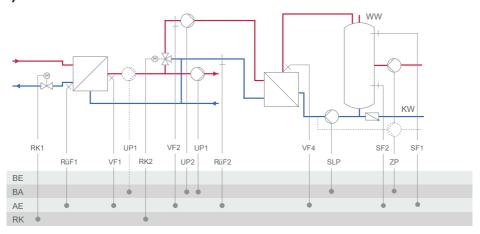

System	7.2		
	Anlage 7.2 HK1 TW G Sc 2-0		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 0 (without AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO4 -> F01	- 1 (with SF1)	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually instalment of VF4)	lled at the point of measure-	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank	k)	
CO5 -> F07	- 0 (without error message at terminal 46)		
CO5 -> F14	- 0 (UP1 only active during the processing for a	ın external demand)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	- Control signal Y2 (RK2)		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	


16-56 EB 5578 EN

System Anl 8.1

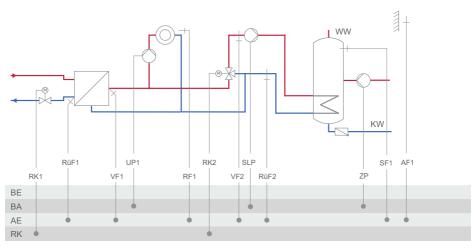

System	8.1		
	Anlaue 8.1		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 0 (without SF2)		
CO4 -> F03	- 0 (without RüF2)		
CO5 -> F07	- 0 (without error message at terminal 46)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	– Control signal Y1 (RK1)		
	– Control signal Y2 (RK2)		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	– Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	


System Anl 8.2

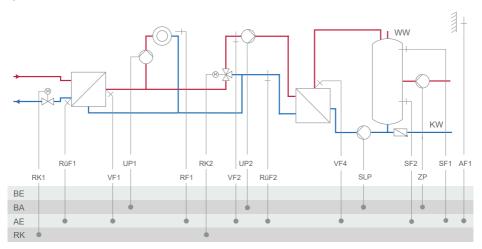

System	8.2		
	Anlage 8.2		
	%d 20		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 1 (with SF2)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4)		
CO5 -> F07	- 0 (without error message at terminal 46)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	Control signal Y1 (RK1)		
	 Control signal Y2 (RK2) 		
	 External demand 	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	

16-58 EB 5578 EN


System Anl 9.1

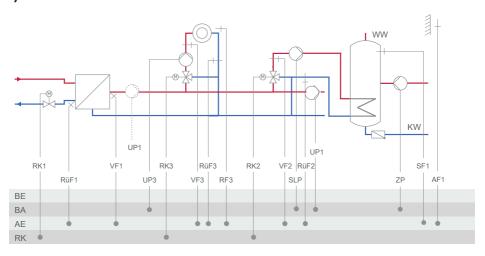

System	9.1	
	Anlaue 9.1	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-ter tt AF2 = Outdoor-temperature-compensated contr	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F14	- 0 (UP1 only active during the processing for a	n external demand)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-60 EB 5578 EN


System Anl 9.2

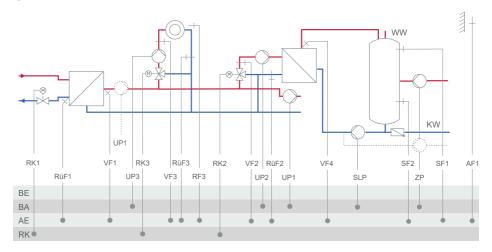

System	9.2	
	Anlaue 92 HKI HKS TW AND	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-temp tt AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually installed ment of VF4)	d at the point of measure-
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F14	- 0 (UP1 only active during the processing for an	external demand)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-62 EB 5578 EN


System Anl 9.5

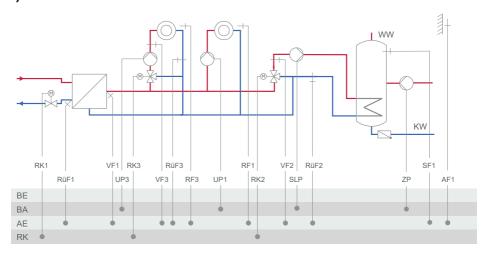

System	9.5	
	Anlage 9.5	
	SV2	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-ten t AF2 = Outdoor-temperature-compensated contro	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	-1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-64 EB 5578 EN


System Anl 9.6

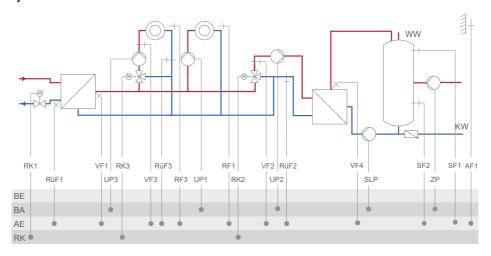

System	9.6	
	Anlage 9.6 HK1 HK2 TWU	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-ten t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually install ment of VF4)	ed at the point of measure-
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-66 EB 5578 EN

System Anl 10.0-1

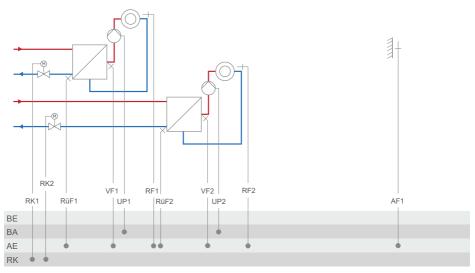


System	10.0-1
	Anlage 10.0 - 1
	WITH HIS

RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2

Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 1 (with RüF2)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 10.0-2

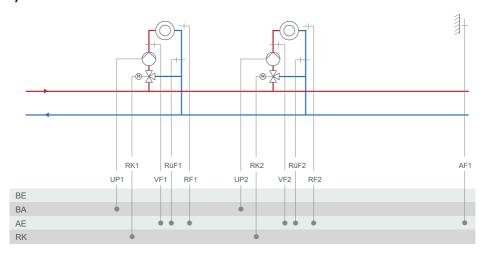

System	10.0-2	
	Anlaue HK HC PC CRICKI	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-temp t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 1 (with RüF2)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	– Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-68 EB 5578 EN


System Anl 10.1-1

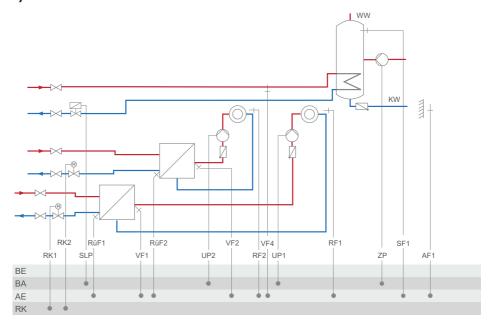

System	10.1-1	
	Anlage HK1 HK2 TNW KS12 KS12	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-ten t AF2 = Outdoor-temperature-compensated contro	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-70 EB 5578 EN


System Anl 10.1-2

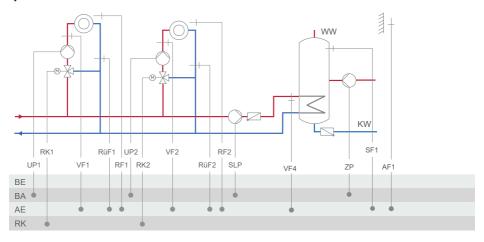

System	10.1-2	
	Anlaue 10.1 - 2	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-temp tt AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-72 EB 5578 EN


System Anl 10.2

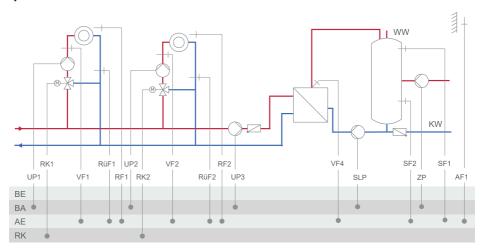

System	10.2	
	Aniaue 10.2 HICLI HICE TWA REAL HI	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-tem ct AF2 = Outdoor-temperature-compensated contro	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-74 EB 5578 EN


System Anl 10.3-1

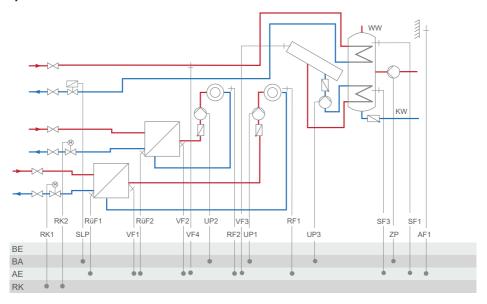

System	10.3-1	
	Anlaue HK1 HK2 TW AND AND AND AND AND AND AND AN	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-tempt t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	– Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-76 EB 5578 EN


System Anl 10.3-2

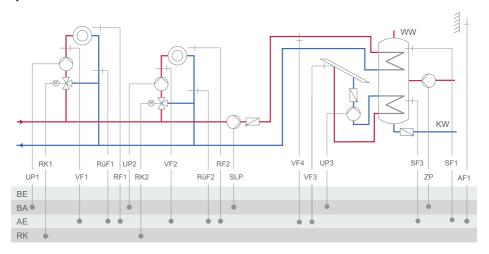


System	10.3-2	
	Anlaue HK I HKZ ANL ANL ANL ANL ANL ANL ANL AN	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-temp t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F05	- 0 (without VF4)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-78 EB 5578 EN

System Anl 10.5

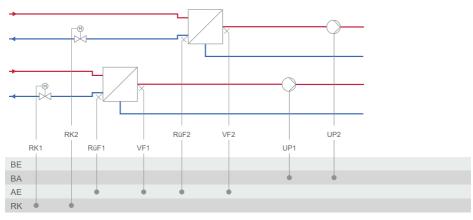

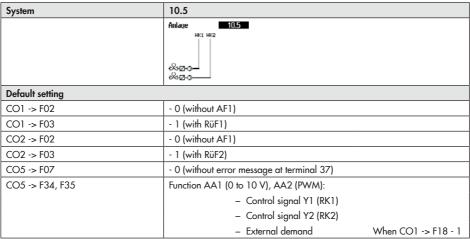


System Anl 11.0

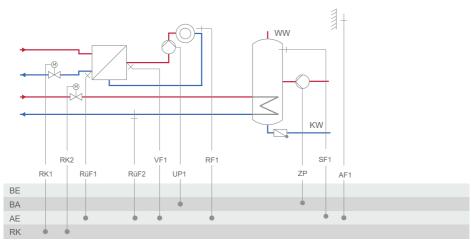

System	11.0	
	Anlaue 11.0	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-80 EB 5578 EN

System Anl 11.1-1

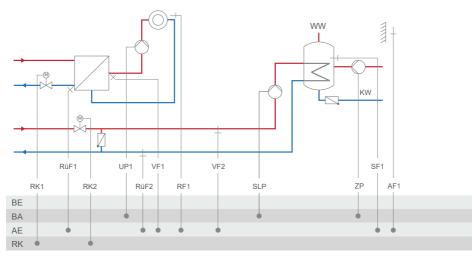

System	11.1-1	
	Anlaue 11.1 - TW	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 11.1-2

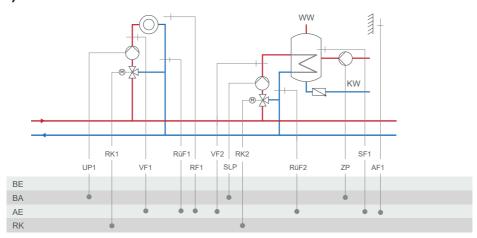

System	11.1-2	
	Anlaue TW PK:1	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	– Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-82 EB 5578 EN

System Anl 11.1-3

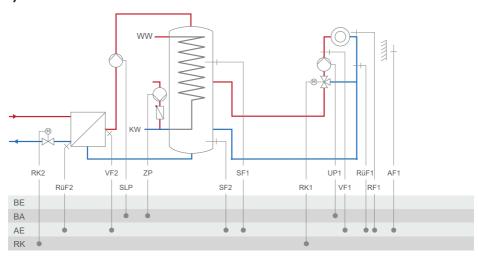

System	11.1-3	
	Anlaue HK1 TW St-12-0	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	– Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 11.2-1

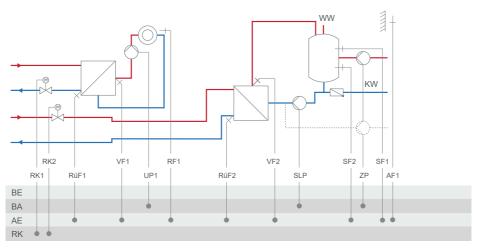

System	11.2-1	
	Anlaue 11.2-1	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 Control signal Y2 (RK2) 	
	 External demand 	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-84 EB 5578 EN

System Anl 11.2-2

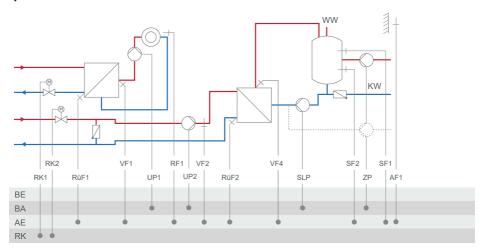

System	11.2-2	
	Anlage HK1 TW SHOLL SHOLL	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually installed ment of VF4)	d at the point of measure-
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 11.2-3

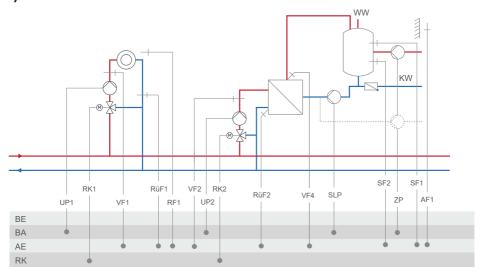

16-86 EB 5578 EN

System	11.2-3	
	Anlage 11.2 - 3	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually instal ment of VF4)	led at the point of measure-
CO4 -> F10	- 0 (DHW circulation return flow in storage tank	()
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 Control signal Y2 (RK2) 	
	 External demand 	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 11.3

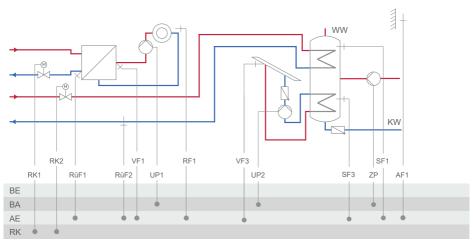

System	11.3	
	Anlage Hist TW Start Sta	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-88 EB 5578 EN

System Anl 11.4

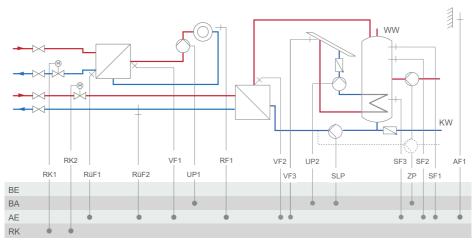

System	11.4	
	Anlage II.A. PK.1 TW STORY STORY STORY THE STORY	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1 Direction = Output


System Anl 11.5

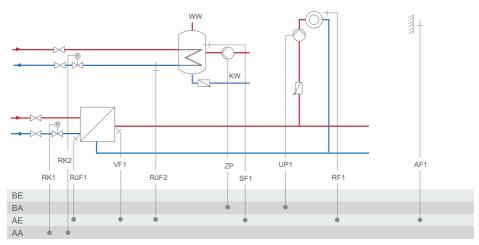

System	11.5
	Anlage 11.5
	A COLUMN TO THE STATE OF THE ST
Note:	DHW circuit with adjustable valve position for storage tank charging in absolute priority operation. By using RüF2, the ready-adjusted valve position is subject to the return flow temperature limitation.
Default setting	
CO1 -> F01	- 0 (without RF1)
CO1 -> F02	- 1 (with AF1)
CO4 -> F02	- 0 (without SF2)
CO4 -> F03	- 1 (with RüF2)
CO5 -> F07	- 0 (without error message at terminal 46)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	- Control signal Y1 (RK1)
	 Control signal Y2 (RK2)
	- External demand When CO1 -> F18 - 1
	- ZP speed When CO4 -> F25 - 1
	 Outdoor temperature When CO5 -> F23 - 1 Direction = Output


16-90 EB 5578 EN

System Anl 11.6-1

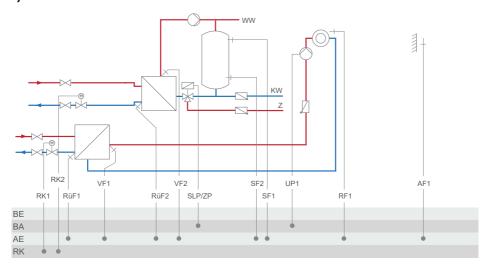

System	11.6-1
	Anlage Anlage
Note:	Install a continuously running pump in the DHW circuit and connect it directly to the voltage supply.
Default setting	
CO1 -> F01	- 0 (without RF1)
CO1 -> F02	- 1 (with AF1)
CO1 -> F03	- 1 (with RÜF1)
CO4 -> F01	- 1 (with SF1)
CO4 -> F02	- 1 (with SF2)
CO4 -> F03	- 0 (without RüF2)
CO5 -> F07	- 0 (without error message at terminal 46)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	- Control signal Y1 (RK1)
	- Control signal Y2 (RK2)
	- External demand When CO1 -> F18 - 1
	 Outdoor temperature When CO5 -> F23 - 1 Direction = Output


System Anl 11.6-2

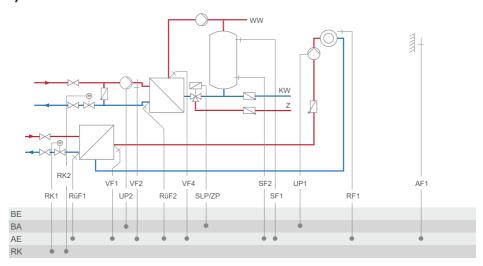

System	11.6-2
	Anlage HKC1 TW Style="border: 2px solid black; border: 2px solid black
Note:	Install a continuously running pump in the DHW circuit and connect it directly to the voltage supply.
Default setting	
CO1 -> F01	- 0 (without RF1)
CO1 -> F02	- 1 (with AF1)
CO1 -> F03	- 1 (with RÜF1)
CO4 -> F01	- 1 (with SF1)
CO4 -> F02	- 1 (with SF2)
CO4 -> F03	- 0 (without RüF2)
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4)
CO5 -> F07	- 0 (without error message at terminal 46)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	- Control signal Y1 (RK1)
	- Control signal Y2 (RK2)
	- External demand When CO1 -> F18 - 1
	- Outdoor temperature When CO5 -> F23 - 1 Direction = Output


16-92 EB 5578 EN

System Anl 11.9-1

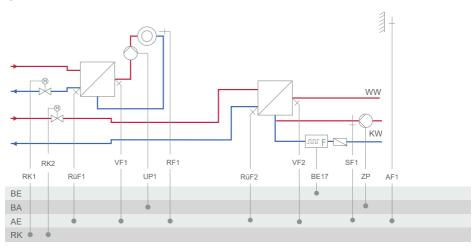

System	11.9-1		
	Anlaue HK1 TW		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO4 -> F01	- 0 (without SF1)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F04	- 0 (without flow rate sensor)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	- Control signal Y2 (RK2)		
	- 10 V supply		
	 External demand 	When CO1 -> F18 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	


System Anl 11.9-2

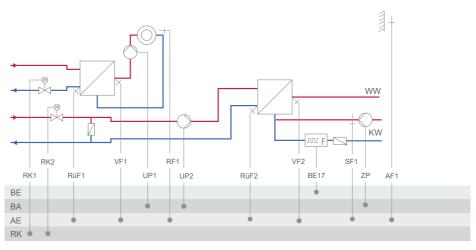

System	11.9-2		
	Anlage 11.9 = 4		
	& Z Z Z Z Z Z Z Z Z Z Z Z Z Z Z Z Z Z Z		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO4 -> F01	- 0 (without SF1)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F04	- 0 (without flow rate sensor)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	- Control signal Y2 (RK2)		
	- 10 V supply		
	- External demand	When CO1 -> F18 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	

16-94 EB 5578 EN

System Anl 12.0

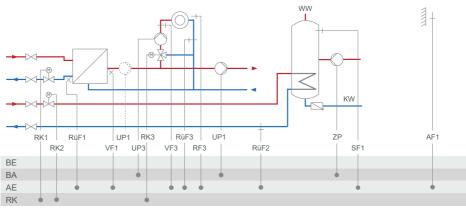

RK • •			
System	12.0		
System	Anlane 12.0		
	Story		
	RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting			
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RÜF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		
CO4 -> F03	- 0 (without RüF2)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F14	- 0 (UP1 only active during the processing for an external demand)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	– Control signal Y1 (RK1)		

EB 5578 EN 16-95

Control signal Y2 (RK2)Control signal Y3 (RK3)External demand

- Outdoor temperature

- ZP speed

When CO1 -> F18 - 1

When CO4 -> F25 - 1

When CO5 -> F23 - 1 Direction = Output


System Anl 12.1

CO4 -> F01

CO4 -> F02

CO4 -> F03

CO5 -> F34, F35

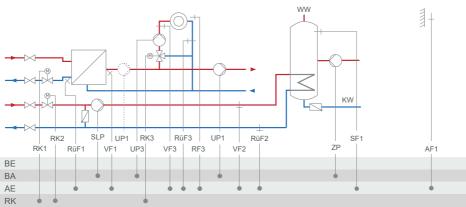

System	12.1		
	Anlage HK1 HK2 TMM SAIZHO SAIZHO AND		
RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2			
Default setting	Default setting		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		

- 1 (with SF1)

- 0 (without SF2)

16-96 EB 5578 EN

Function AA1 (0 to 10 V), AA2 (PWM):

SLP speedZP speed

- 0 (UP1 only active during the processing for an external demand)

When CO1 -> F18 - 1 When CO4 -> F21 - 1


When CO4 -> F25 - 1

When CO5 -> F23 - 1 Direction = Output

Control signal Y1 (RK1)Control signal Y2 (RK2)Control signal Y3 (RK3)External demand

- Outdoor temperature


System Anl 12.2-1

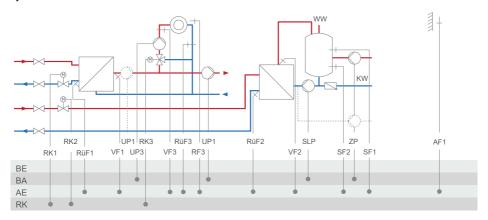

System	12.2-1	
	Anlage #2.2 Tw HX1 HX2 TW \$\frac{\text{\tint{\text{\tint{\text{\tint{\text{\tinte\text{\text{\text{\text{\text{\ti}\text{\texi}\text{\text{\text{\text{\text{\text{\text{\texi{\texi\tinte\text{\texi}\text{\text{\texit{\text{\text{\text{\texi}\text{\text{\texit{\t	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-te ct AF2 = Outdoor-temperature-compensated cont	
Default setting	_	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tan	k)
CO5 -> F14	- 0 (UP1 only active during the processing for a	an external demand)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-98 EB 5578 EN


System Anl 12.2-2

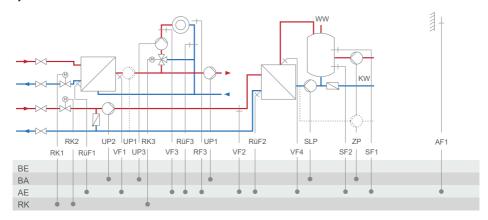

System	12.2-2		
	Anlage HC1 HC3 TW SEZ-2 AND		
	nt control; CO3 -> F02 - 1, select AF1 = Outdoor-t elect AF2 = Outdoor-temperature-compensated con		
Default setting			
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 1 (with SF2)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually instr ment of VF4)	- 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tai	nk)	
CO5 -> F14	- 0 (UP1 only active during the processing for	an external demand)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	 Control signal Y1 (RK1) 		
	 Control signal Y2 (RK2) 	- Control signal Y2 (RK2)	
	 Control signal Y3 (RK3) 		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	

16-100 EB 5578 EN


System Anl 12.9-1

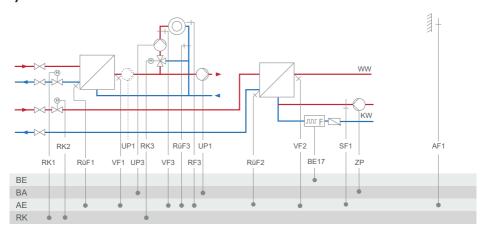

System	12.9-1	
	Anlage HK1 HK2 TWW	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-ten tt AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 0 (without SF1)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F04	- 0 (without flow rate sensor)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F14	- 0 (UP1 only active during the processing for ar	n external demand)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- 10 V supply	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-102 EB 5578 EN


System Anl 12.9-2

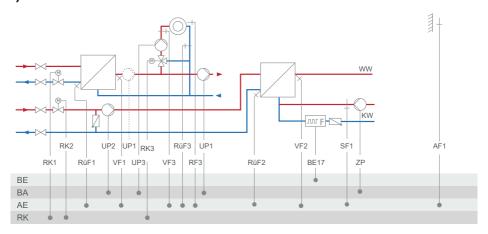

System	12.9-2		
	Anlage #29 - 2		
	control; CO3 -> F02 - 1, select AF1 = Outdoor-te ct AF2 = Outdoor-temperature-compensated cont		
Default setting			
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)		
CO4 -> F01	- 0 (without SF1)	- 0 (without SF1)	
CO4 -> F03	- 0 (without RüF2)	- 0 (without RüF2)	
CO4 -> F04	- 0 (without flow rate sensor)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F14	- 0 (UP1 only active during the processing for an external demand)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	 Control signal Y1 (RK1) 		
	 Control signal Y2 (RK2) 		
	 Control signal Y3 (RK3) 		
	- 10 V supply		
	 External demand 	When CO1 -> F18 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	

16-104 EB 5578 EN

System Anl 13.0

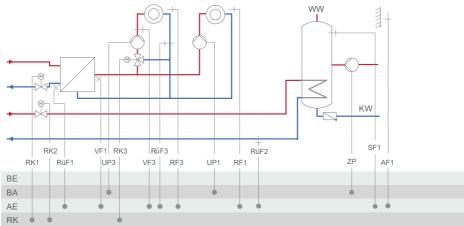

RK • •		
System	13.0	
	Anlage 1500	
	& Q	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated t AF2 = Outdoor-temperature-compensated control with AF2	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RÜF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	

EB 5578 EN 16-105

- ZP speed

Control signal Y2 (RK2)Control signal Y3 (RK3)External demand


- Outdoor temperature

When CO1 -> F18 - 1

When CO4 -> F25 - 1

When CO5 -> F23 - 1 Direction = Output


System Anl 13.1

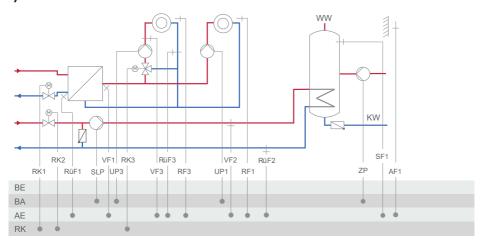

16-106 EB 5578 EN

System	13.1	
	Anlage HKI HKS TW SALO SALO	
control with AF1; CO3 -> F02 - 1, selec	control; CO3 -> F02 - 1, select AF1 = Outdoor-tem t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	– Control signal Y2 (RK2)	
	– Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 13.2-1

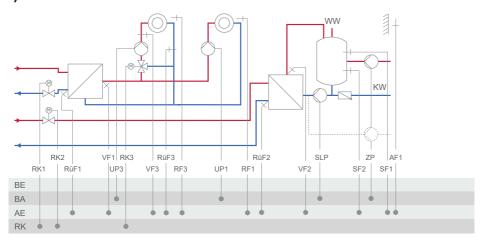

16-108 EB 5578 EN

System	13.2-1	
	Anlaue 19.2 Tw	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-temp ct AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F04	- 0 (without flow rate sensor)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 Control signal Y2 (RK2) 	
	 Control signal Y3 (RK3) 	
	 External demand 	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 13.2-2

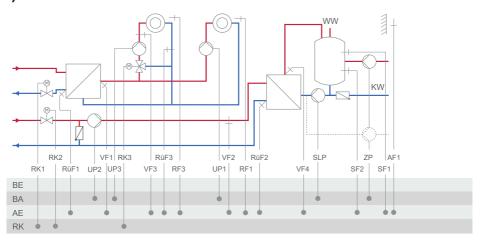

16-110 EB 5578 EN

System	13.2-2		
	Anlage 13:2 - 2:		
	control; CO3 -> F02 - 1, select AF1 = Outdoor-tem ct AF2 = Outdoor-temperature-compensated control		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 1 (with SF2)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F04	- 0 (without flow rate sensor)		
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually installe ment of VF4)	ed at the point of measure-	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	 Control signal Y1 (RK1) 		
	 Control signal Y2 (RK2) 		
	 Control signal Y3 (RK3) 		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	


System Anl 13.6-1

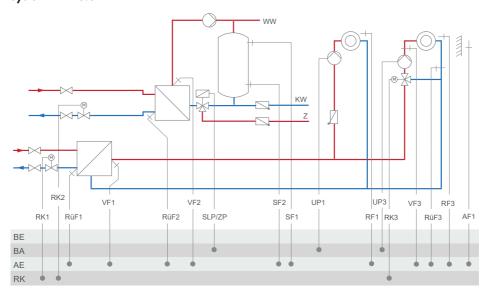

16-112 EB 5578 EN

System	13.6-1	
	Anlage 13.6-1	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-tem tt AF2 = Outdoor-temperature-compensated contro	
Note:	Install a continuously running pump in the DHW rectly to the voltage supply.	circuit and connect it di-
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 13.6-2

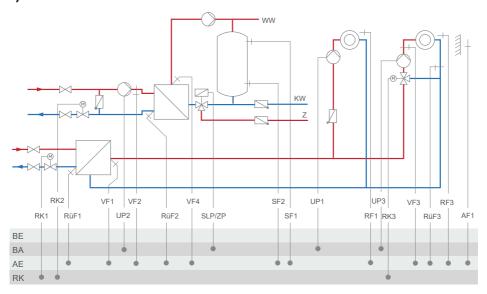

16-114 EB 5578 EN

System	13.6-2	
	Anlaue #13.6 = 2 HK1 HK3 TW \$ 2 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7 7	
	t control; CO3 -> F02 - 1, select AF1 = Outdoor-ter ect AF2 = Outdoor-temperature-compensated contr	
Note:	Install a continuously running pump in the DHW rectly to the voltage supply.	/ circuit and connect it di-
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually instal ment of VF4)	led at the point of measure-
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	 Control signal Y3 (RK3) 	
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 13.9-1

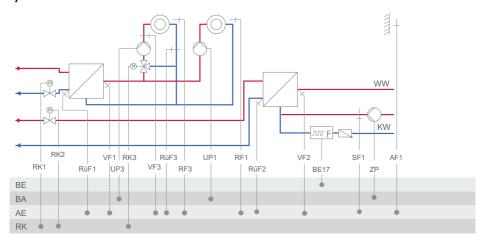

16-116 EB 5578 EN

System	13.9-1			
	Anlage HK1 HK3 TW			
	RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2			
Default setting				
CO1 -> F01	- 0 (without RF1)			
CO1 -> F02	- 1 (with AF1)			
CO1 -> F03	- 1 (with RüF1)			
CO3 -> F01	- 0 (without RF3)			
CO3 -> F02	- 1 (with AF1)			
CO3 -> F03	- 0 (without RüF3)			
CO4 -> F01	- 0 (without SF1)			
CO4 -> F03	- 0 (without RüF2)			
CO4 -> F04	- 0 (without flow rate sensor)			
CO5 -> F07	- 0 (without error message at terminal 37)			
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):			
	 Control signal Y1 (RK1) 			
	 Control signal Y2 (RK2) 			
	 Control signal Y3 (RK3) 			
	- 10 V supply			
	- External demand	When CO1 -> F18 - 1		
	- ZP speed	When CO4 -> F25 - 1		
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output		


System Anl 13.9-2

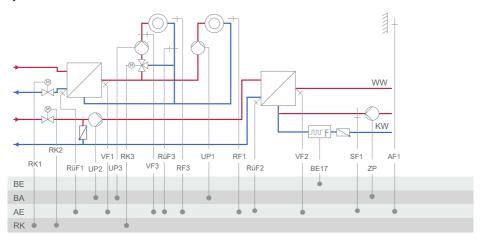

16-118 EB 5578 EN

System	13.9-2	
	Anlage 13.9 - 2 HK1 HK3 TWU O O CT	
	&	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-ten ct AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 0 (without SF1)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F04	- 0 (without flow rate sensor)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- 10 V supply	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 14.1

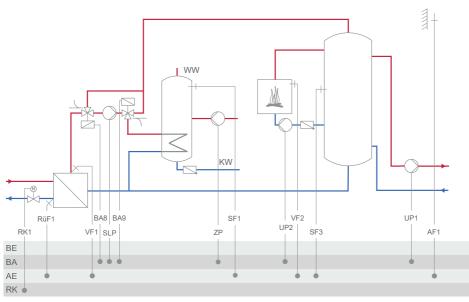

System	14.1	
	Anlage KK	
	\$\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 External demand 	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-120 EB 5578 EN

System Anl 14.2

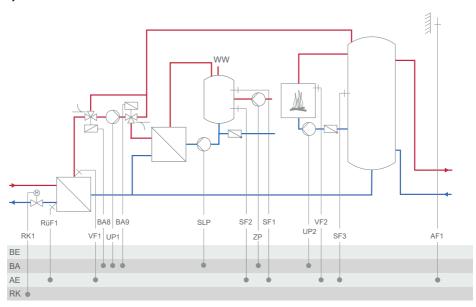

System	14.2	
	Anlaue MC1 TW Z	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO5 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 14.3

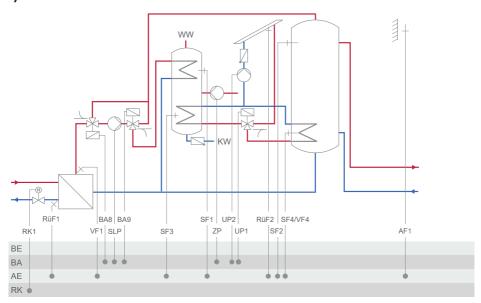

System	14.3
	Anlage HCI TW CI
Default setting	
CO1 -> F02	- 1 (with AF1)
CO1 -> F03	- 1 (with RüF1)
CO4 -> F01	- 0 (without RüF1)
CO5 -> F07	- 0 (without error message at terminal 46)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	- Control signal Y1 (RK1)
	- External demand When CO1 -> F18 - 1
	- ZP speed When CO4 -> F25 - 1
	 Outdoor temperature When CO5 -> F23 - 1 Direction = Output

16-122 EB 5578 EN


System Anl 15.0

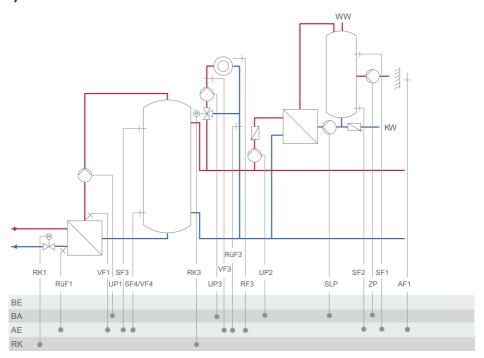

System	15.0	
	Anlaue HK3 TW AND	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-tem t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y3 (RK3) 	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-124 EB 5578 EN


System Anl 15.1

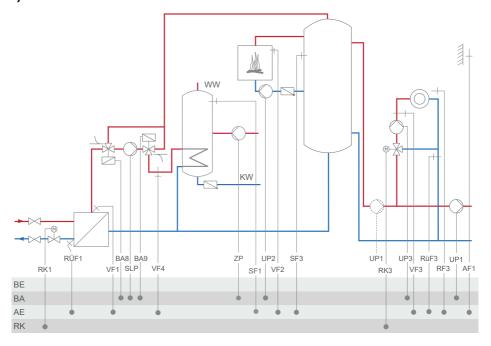

System	15.1		
	Anlage HK1 HK2 TWA AND		
	control; CO3 -> F02 - 1, select AF1 = Outdoor-te ect AF2 = Outdoor-temperature-compensated contr		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 0 (without SF2)		
CO5 -> F14	- 0 (UP1 only active during the processing for an external demand)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	 Control signal Y1 (RK1) 		
	- Control signal Y3 (RK3)		
	- External demand	When CO1 -> F18 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	

16-126 EB 5578 EN


System Anl 15.2

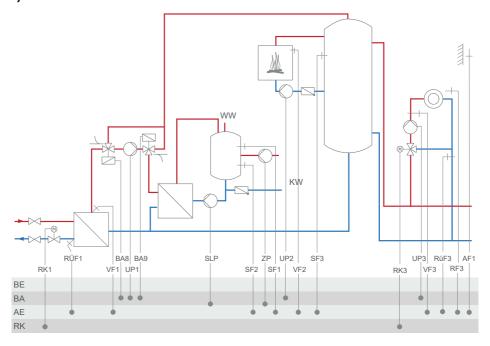

System	15.2
	Anlage HK1 HK2 TW SZ Z S Z
	d set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated 12 - 1, select AF2 = Outdoor-temperature-compensated control with AF2
Default setting	
CO1 -> F01	- 0 (without RF1)
CO1 -> F02	- 1 (with AF1)
CO1 -> F03	- 1 (with RöF1)
CO3 -> F01	- 0 (without RF3)
CO3 -> F02	- 1 (with AF1)
CO3 -> F03	- 0 (without RüF3)
CO4 -> F01	- 1 (with SF1)
CO4 -> F02	- 1 (with SF2)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	Control signal Y1 (RK1)
	Control signal Y3 (RK3)
	- External demand When CO1 -> F18 - 1
	- SLP speed When CO4 -> F21 - 1
	- ZP speed When CO4 -> F25 - 1
	 Outdoor temperature When CO5 -> F23 - 1 Direction = Output

16-128 EB 5578 EN


System Anl 15.3

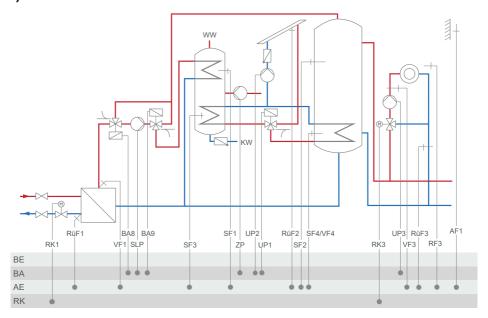

System	15.3			
	Anlaue HK1 HK2 TWA SAZ SAZ SAZ SAZ SAZ SAZ SAZ S			
	RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2			
Default setting				
CO1 -> F02	- 1 (with AF1)			
CO1 -> F03	- 1 (with RüF1)			
CO3 -> F01	- 0 (without RF3)			
CO3 -> F02	- 1 (with AF1)			
CO3 -> F03	- 0 (without RüF3)			
CO4 -> F01	- 1 (with SF1)			
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):			
	– Control signal Y1 (RK1)			
	– Control signal Y3 (RK3)			
	- External demand	When CO1 -> F18 - 1		
	- ZP speed	When CO4 -> F25 - 1		
	– Outdoor temperature	When CO5 -> F23 - 1 Direction = Output		

16-130 EB 5578 EN


System Anl 15.4

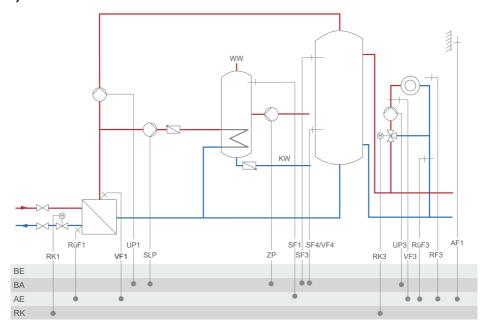

System	15.4	
	Anlage HK1 HK2 TWA SELECTION SELECTI	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-tempt t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	– Control signal Y3 (RK3)	
	 External demand 	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1 Direction = Output

16-132 EB 5578 EN


System Anl 15.5

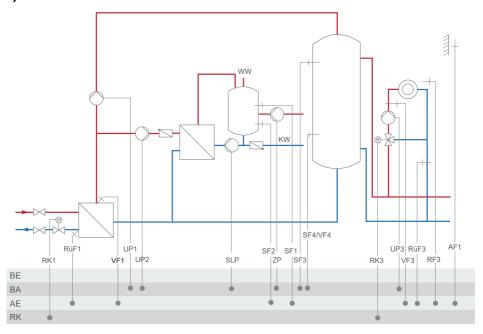

System	15.5	
	Anlaue HKC1 HKC2 TW	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


16-134 EB 5578 EN

System Anl 16.0

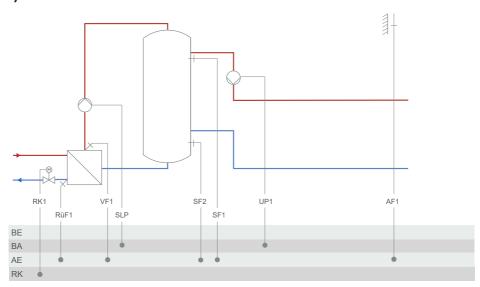

System	16.0	
	Anlage 16.0	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	Control signal Y1 (RK1)	
	- SLP speed	When CO1 -> F21 - 1
	 Differential temperature control 	When CO1 -> F23 - 1
	- External demand	When CO1 -> F18 - 1
	 Outdoor temperature 	When CO5 -> F23 - 1 Direction = Output


System Anl 16.1

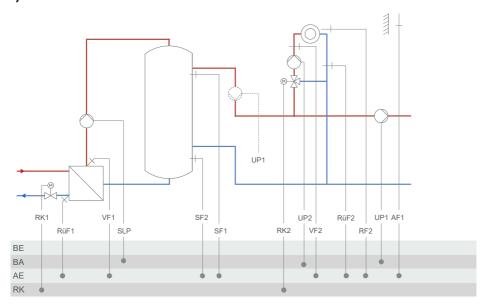

16-136 EB 5578 EN

System	16.1	
	Anlage HK1 HK2 SC-2-0	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-temp et AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 38)	
CO5 -> F14	- 0 (UP1 according to the ZP schedule or only acti for an external demand)	ve during the processing
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- SLP speed	When CO1 -> F21 - 1
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 16.2

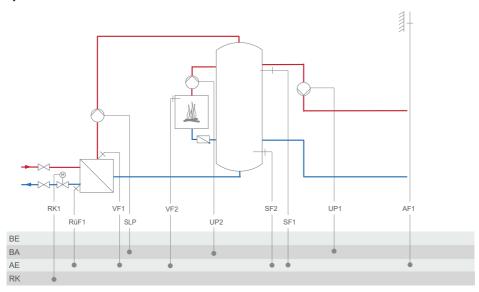

System	16.2
	Anlage 16.2
	₩1 ————————————————————————————————————
Default setting	
CO1 -> F02	- 1 (with AF1)
CO1 -> F03	- 1 (with RüF1)
CO1 -> F06	- 1 (with SF2)
CO5 -> F07	- 0 (without error message at terminal 43)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	- Control signal Y1 (RK1)
	- SLP speed When CO1 -> F21 - 1
	- External demand When CO1 -> F18 - 1
	 Outdoor temperature When CO5 -> F23 - 1 Direction = Output


16-138 EB 5578 EN

System Anl 16.3

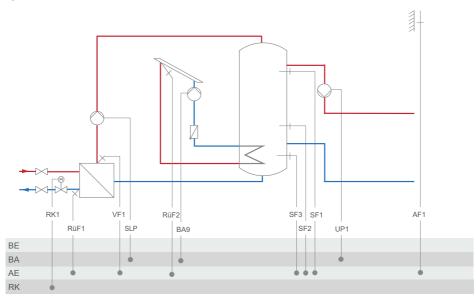

System	16.3	
	Anlage 16.3	
	& Z	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- SLP speed	When CO1 -> F21 - 1
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 16.4

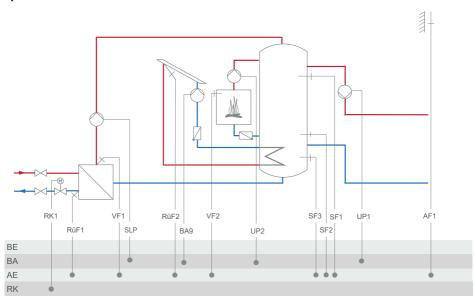

System	16.4	
	Anlage 16.4	
	×:1	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- SLP speed	When CO1 -> F21 - 1
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

16-140 EB 5578 EN


System Anl 16.8

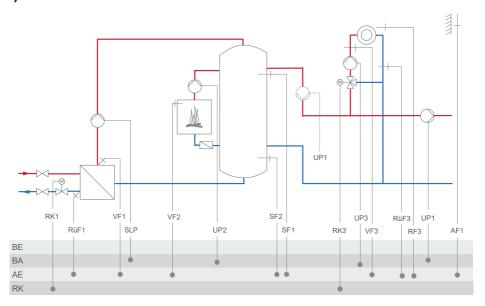

System	16.5	
	Anlage 15.5	
	oint control; CO3 -> F02 - 1, select AF1 = Outdoor- select AF2 = Outdoor-temperature-compensated co	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO5 -> F07	- 0 (without error message at terminal 38)	
CO5 -> F14	- 0 (UP1 according to the ZP schedule or only for an external demand)	active during the processing
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM): - Control signal Y1 (RK1) - Control signal Y3 (RK3) - SLP speed - External demand - Outdoor temperature	When CO1 -> F21 - 1 When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output

16-142 EB 5578 EN

System Anl 16.6

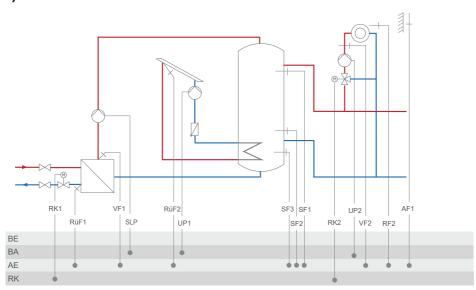


System	16.6
	Anlage 16.6
	MIC 14/2 MIC 14

RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2

Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO5 -> F07	- 0 (without error message at terminal 38)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- SLP speed	When CO1 -> F21 - 1
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 16.7

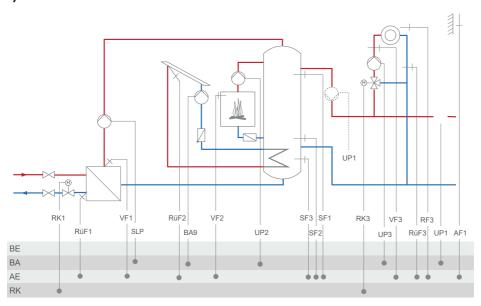

16-144 EB 5578 EN

System	16.7	
	Anlage HK1 HK2 ANLAGE HK2 AN	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-te ct AF2 = Outdoor-temperature-compensated cont	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO5 -> F07	- 0 (without error message at terminal 43)	
CO5 -> F14	- 0 (UP1 according to the ZP schedule or only of for an external demand)	active during the processing
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	- Control signal Y3 (RK3)	
	- SLP speed	When CO1 -> F21 - 1
	- External demand	When CO1 -> F18 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output

System Anl 16.8

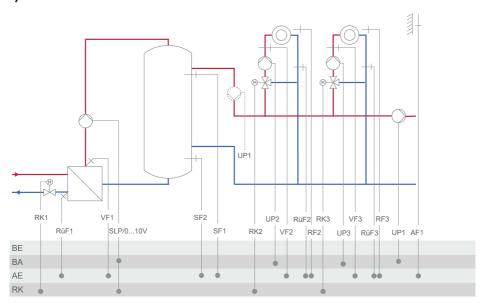


16-146 EB 5578 EN

System	16.8
	Anlage 15.8 HK1 HK2 HK3
RK2: CO2 -> F02 · 0 = Fixed set point control; CO2 -> F02 · 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 · 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 · 0 = Fixed set point control; CO3 -> F02 · 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 · 1, select AF2 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 · 1, select AF2 = Outdoor-temperature-compensated control with AF2	
Default setting	
CO1 -> F02	- 1 (with AF1)
CO1 -> F03	- 1 (with RüF1)

Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO5 -> F07	- 0 (without error message at terminal 38)	
CO5 -> F14	- 0 (UP1 according to the ZP schedule or only active during the processing for an external demand)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- SLP speed When CO1 -> F21 - 1	
	- External demand When CO1 -> F18 - 1	
	- Outdoor temperature When CO5 -> F23 - 1 Direction = Output	


System Anl 17.1

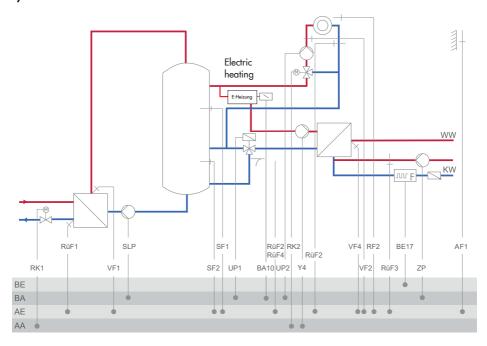

16-148 EB 5578 EN

System	17.1		
	Anlage 17.41		
	WI HE TW		
	RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting			
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO1 -> F06	- 1 (with SF2)		
CO2 -> F01	- 0 (without RF2)		
CO2 -> F02	- 1 (with AF1)		
CO2 -> F03	- 0 (without RüF2 in RK2)		
CO4 -> F03	- 0 (without RüF2/RüF4)		
CO4 -> F04	- 0 (without flow switch)		
CO4 -> F14	- 0 (without RüF3)		
CO4 -> F07	- 0 (without error message at terminal 46)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	 Control signal Y2 (RK2) 		
	- Control signal Y4		
	- SLP speed	When CO1 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- External demand	When CO1 -> F18 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	

System Anl 17.8

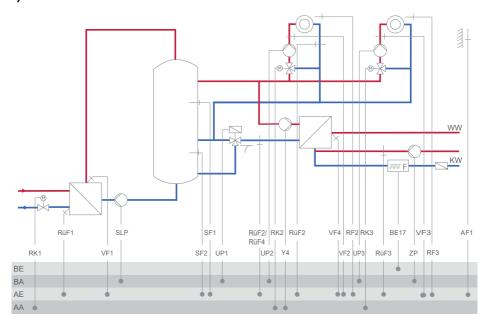

16-150 EB 5578 EN

When CO1 -> F21 - 1

When CO1 -> F18 - 1

When CO4 -> F25 - 1

When CO5 -> F23 - 1 Direction = Output


System	17.8	
	Anlaue HICI HICE TIME AND	
RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 0 (without RüF2 in RK2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO4 -> F03	- 0 (without RüF2/RüF4)	
CO4 -> F04	- 0 (without flow switch)	
CO4 -> F14	- 0 (without RüF3)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	- Control signal Y4	

- SLP speed

External demandZP speed

- Outdoor temperature


System Anl 18.1-1

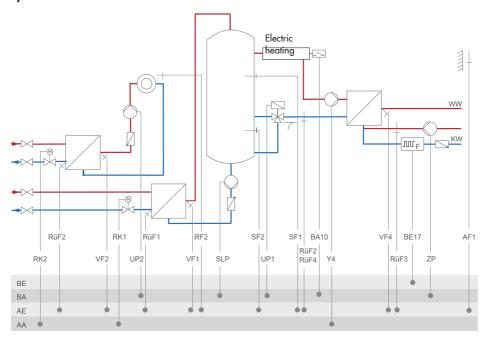

16-152 EB 5578 EN

System	18.1-1	
	Anlage 18.1 - 1	
	SCE-O	
	control; CO2 -> F02 - 1, select AF1 = Outdoor-tempt t AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 1 (with RüF2 in RK2)	
CO4 -> F03	- 0 (without RüF2/RüF4)	
CO4 -> F04	- 0 (without flow switch)	
CO4 -> F14	- 0 (without RüF3)	
CO4 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	– Control signal Y1 (RK1)	
	– Control signal Y2 (RK2)	
	– Control signal Y4	
	- SLP speed	When CO1 -> F21 - 1
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 18.1-2

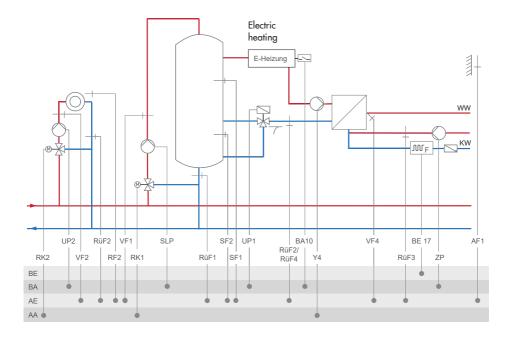

16-154 EB 5578 EN

System	18.1-2	
	Anlaue	
	&z-)	
Default setting		
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO1 -> F06	- 1 (with SF2)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 1 (with RüF2 in RK2)	
CO4 -> F03	- 0 (without RüF2/RüF4)	
CO4 -> F04	- 0 (without flow switch)	
CO4 -> F14	- 0 (without RüF3)	
CO4 -> F07	- 0 (without error message at terminal 46)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y4	
	- SLP speed	When CO1 -> F21 - 1
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 21.0

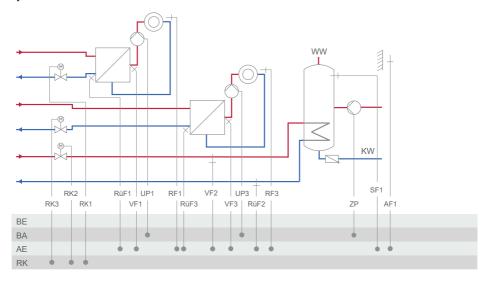

16-156 EB 5578 EN

System	21.0	
	Anlage HICS TWA HICS TWA AND	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-ter tt AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 1 (with RüF3)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	 Control signal Y1 (RK1) 	
	 Control signal Y2 (RK2) 	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 21.1-1

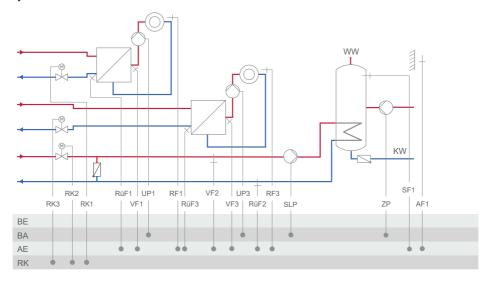

16-158 EB 5578 EN

System	21.1-1	
	Anlaue HK1 HK2 TWM SAZ	
	point control; CO3 -> F02 - 1, select AF1 = Outdoo , select AF2 = Outdoor-temperature-compensated of	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 0 (without RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 0 (without RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 0 (without SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	
	 External demand 	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 21.1-2

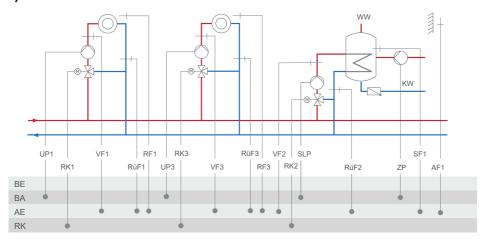

16-160 EB 5578 EN

System	21.1-2		
	Anlage 21.1-2 HK1 HK2 TW CH CH C		
	RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 0 (without RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 0 (without RüF3)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 0 (without SF2)		
CO4 -> F03	- 0 (without RüF2)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	Control signal Y1 (RK1)		
	 Control signal Y2 (RK2) 		
	– Control signal Y3 (RK3)		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	


System Anl 21.2-1

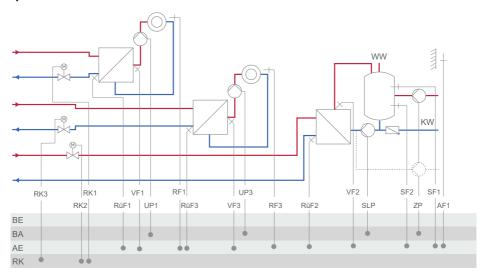

16-162 EB 5578 EN

System	21.2-1
	Anlage 21.2 - 1 HKC TW
	set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated - 1, select AF2 = Outdoor-temperature-compensated control with AF2
Default setting	
CO1 -> F01	- 0 (without RF1)
CO1 -> F02	- 1 (with AF1)
CO1 -> F03	- 1 (with RÜF1)
CO3 -> F01	- 0 (without RF3)
CO3 -> F02	- 1 (with AF1)
CO3 -> F03	- 1 (with RüF3)
CO4 -> F01	- 1 (with SF1)
CO4 -> F02	- 1 (with SF2)
CO4 -> F03	- 0 (without RüF2)
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):
	- Control signal Y1 (RK1)
	- Control signal Y2 (RK2)
	- Control signal Y3 (RK3)
	- External demand When CO1 -> F18 - 1
	- SLP speed When CO4 -> F21 - 1
	- ZP speed When CO4 -> F25 - 1
	- Outdoor temperature When CO5 -> F23 - 1 Direction = Output


System Anl 21.2-2

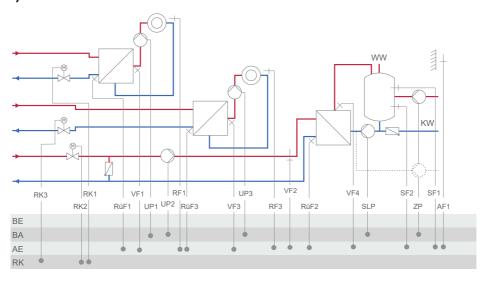

16-164 EB 5578 EN

System	21.2-2	
	Anlage 212-2	
	control; CO3 -> F02 - 1, select AF1 = Outdoor-temper tt AF2 = Outdoor-temperature-compensated control	
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 1 (with RüF3)	
CO4 -> F01	- 1 (with SF1)	
CO4 -> F02	- 1 (with SF2)	
CO4 -> F03	- 0 (without RüF2)	
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4)	
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	 Control signal Y2 (RK3) 	
	- Control signal Y3 (RK3)	
	- External demand	When CO1 -> F18 - 1
	- SLP speed	When CO4 -> F21 - 1
	- ZP speed	When CO4 -> F25 - 1
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output


System Anl 21.2-3

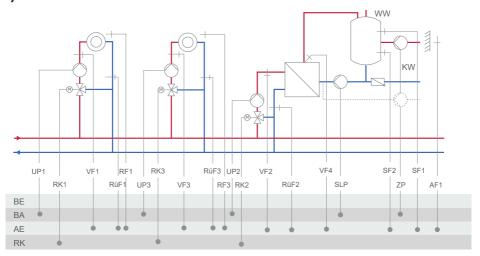

16-166 EB 5578 EN

System	21.2-3		
	Anlage 21.2 - 6 HK1 HK3 TM All PART TM Al		
	control; CO3 -> F02 - 1, select AF1 = Outdoor-tem ct AF2 = Outdoor-temperature-compensated control		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 1 (with RüF3)		
CO4 -> F01	- 1 (with SF1)		
CO4 -> F02	- 1 (with SF2)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F05	- 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4)		
CO4 -> F10	- 0 (DHW circulation return flow in storage tank)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	 Control signal Y1 (RK1) 		
	 Control signal Y2 (RK2) 		
	- Control signal Y3 (RK3)		
	- External demand	When CO1 -> F18 - 1	
	- SLP speed	When CO4 -> F21 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	


System Anl 21.9-1

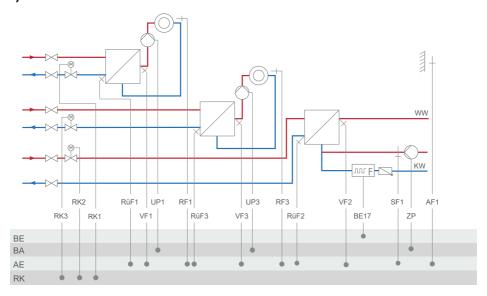

16-168 EB 5578 EN

System	21.9-1		
	Anlage 21.9 - 1		
	KI HG TW AGZ		
	control; CO3 -> F02 - 1, select AF1 = Outdoor-ter ct AF2 = Outdoor-temperature-compensated control		
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 1 (with RüF3)		
CO4 -> F01	- 0 (without SF1)		
CO4 -> F03	- 0 (without RüF2)		
CO4 -> F04	- 0 (without flow rate sensor)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	 Control signal Y1 (RK1) 		
	 Control signal Y2 (RK2) 		
	 Control signal Y3 (RK3) 		
	- 10 V supply		
	- External demand	When CO1 -> F18 - 1	
	- ZP speed	When CO4 -> F25 - 1	
	 Outdoor temperature 	When CO5 -> F23 - 1 Direction = Output	


System Anl 21.9-2

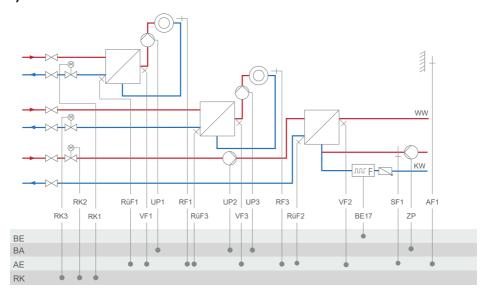

16-170 EB 5578 EN

System	21.9-2	21.9-2		
	Andaue 21,9 - 2 HK1 HK3 TW O Z KN2 J J KN2 KN2			
	set point control; CO3 -> F02 - 1, select AF1 = Outdo - 1, select AF2 = Outdoor-temperature-compensated			
Default setting				
CO1 -> F01	- 0 (without RF1)			
CO1 -> F02	- 1 (with AF1)			
CO1 -> F03	- 1 (with RüF1)			
CO3 -> F01	- 0 (without RF3)			
CO3 -> F02	- 1 (with AF1)	- 1 (with AF1)		
CO3 -> F03	- 1 (with RüF3)	- 1 (with RüF3)		
CO4 -> F01	- 0 (without SF1)	- 0 (without SF1)		
CO4 -> F03	- 0 (without RüF2)	- 0 (without RüF2)		
CO4 -> F04	- 0 (without flow rate sensor)	- 0 (without flow rate sensor)		
CO5 -> F07	- 0 (without error message at terminal 37)	- 0 (without error message at terminal 37)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	- Control signal Y2 (RK2)		
	- Control signal Y3 (RK3)		
	- 10 V supply			
	- External demand	When CO1 -> F18 - 1		
	- ZP speed	When CO4 -> F25 - 1		
	- Outdoor temperature	When CO5 -> F23 - 1 Direction = Output		

System Anl 25.0-1

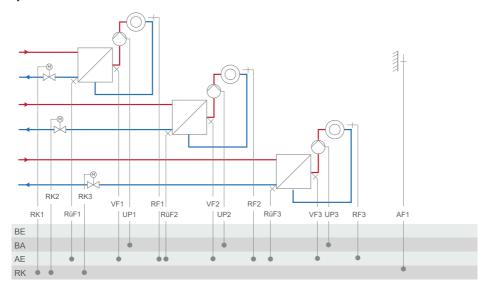

16-172 EB 5578 EN

When CO1 -> F18 - 1


When CO5 -> F23 - 1 Direction = Output

System	25.0-1	
	Anilate PETUTE HICH HICE HICE O O O O SAGE ANILATE ANILATE	
RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2		
Default setting		
CO1 -> F01	- 0 (without RF1)	
CO1 -> F02	- 1 (with AF1)	
CO1 -> F03	- 1 (with RüF1)	
CO2 -> F01	- 0 (without RF2)	
CO2 -> F02	- 1 (with AF1)	
CO2 -> F03	- 1 (with RüF2)	
CO3 -> F01	- 0 (without RF3)	
CO3 -> F02	- 1 (with AF1)	
CO3 -> F03	- 1 (with RüF3)	
CO5 -> F07	- 0 (without error message at terminal 37)	
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):	
	- Control signal Y1 (RK1)	
	- Control signal Y2 (RK2)	
	- Control signal Y3 (RK3)	

- External demand

- Outdoor temperature


System Anl 25.0-2

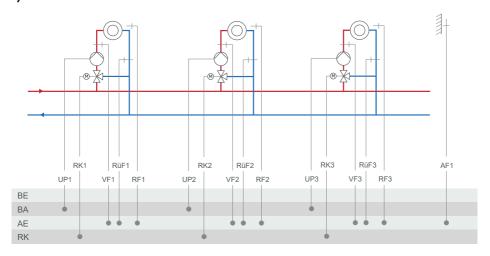

16-174 EB 5578 EN

System	25.0-2		
	Anilage 25.0 = 盃 HKS HKS HKS KS C C C C C C C C C C C C C C C C C		
control with AF1; CO2 -> F02 - 1, select RK3: CO3 -> F02 - 0 = Fixed set point of	control; CO2 -> F02 - 1, select AF1 = Outdoor-tem t AF2 = Outdoor-temperature-compensated control control; CO3 -> F02 - 1, select AF1 = Outdoor-tem t AF2 = Outdoor-temperature-compensated control	i with AF2 perature-compensated	
Default setting			
CO1 -> F01	- 0 (without RF1)		
CO1 -> F02	- 1 (with AF1)		
CO1 -> F03	- 1 (with RÜF1)		
CO2 -> F01	- 0 (without RF2)		
CO2 -> F02	- 1 (with AF1)		
CO2 -> F03	- 1 (with RüF2)		
CO3 -> F01	- 0 (without RF3)		
CO3 -> F02	- 1 (with AF1)		
CO3 -> F03	- 1 (with RüF3)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	- Control signal Y1 (RK1)		
	- Control signal Y2 (RK2)		
	- Control signal Y3 (RK3)		
	- External demand	When CO1 -> F18 - 1	
	– Outdoor temperature	When CO5 -> F23 - 1 Direction = Output	

System Anl 25.5

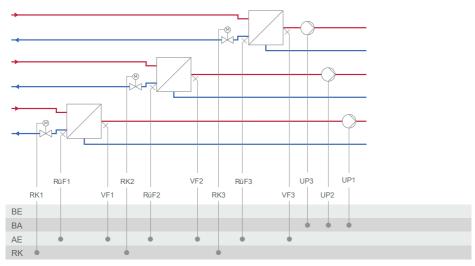

System	25.5		
	Anlage HICL HICE HICE AND HICE HIC		
Default setting			
CO1 -> F02	- 0 (without AF1)		
CO1 -> F03	- 1 (with RüF1)		
CO2 -> F02	- 0 (without AF1)		
CO2 -> F03	- 1 (with RüF2)		
CO3 -> F02	- 0 (without AF1)		
CO3 -> F03	- 1 (with RüF3)		
CO5 -> F07	- 0 (without error message at terminal 37)		
CO5 -> F34, F35	Function AA1 (0 to 10 V), AA2 (PWM):		
	 Control signal Y1 (RK1) 		
	- Control signal Y2 (RK2)		
	- Control signal Y3 (RK3)		
	- External demand	When CO1 -> F18 - 1	


16-176 EB 5578 EN

16.2 Functions of the heating circuit

Which controller functions are available depends on the selected system code number (Anl).

16.2.1 Outdoor-temperature-compensated control

When outdoor-temperature-compensated control is used, the flow temperature is controlled based on the outdoor temperature. The heating characteristic in the controller defines the flow temperature set point as a function of the outdoor temperature (see Fig. 16-2). The outdoor temperature required for outdoor-temperature-compensated control can either be measured at an outdoor sensor, received over the 0 to 10 V input (see section 16.2.1.1) or a connected device bus (see section 16.2.1.2).

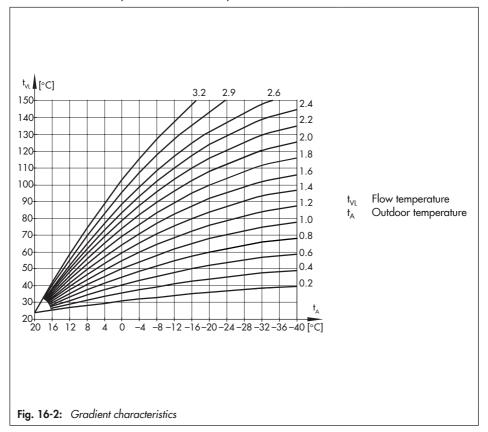

16.2.1.1 Outdoor temperature received or sent as 0 to 10 V signal

The outdoor temperature can be received at terminals 19 and 23 over the 0 to 10 V input. Alternatively, the temperature measured by the outdoor sensor can be issued at AA1 as a 0 to 10 V signal. The zero of the 0 to 10 V input and output signals can be shifted, if required.

Functions	Default	Configuration
Outdoor sensor AF1, 2	1	CO1, 2, 3, 11, 12, 13 -> F02 - 1 CO2, 3: select AF1, AF2
Outdoor temperature received	0	CO5 -> F23 - 1
or sent as 0 to 10 V signal	Input	Direction: input (receive)
	−20 °C	Lower transmission range: -50 to +100 °C
	50 °C	Upper transmission range: -50 to +100 °C
All Zero shift	0 5 %	CO5 -> F31 - 1 Zero: 5 to 20 %
Outdoor temperature received	0	CO5 -> F23 - 1
or sent as 0 to 10 V signal	Input	Direction: output (send)
	−20 °C	Lower transmission range: -50 to +100 °C
	50 °C	Upper transmission range: -50 to +100 °C
AA1 reverse	0 0 %	CO5 -> F25 - 0 Zero: 0 to 50 %
AA1 PWM	0	CO5 -> F34 - 0 Function: outdoor temperature

16-178 EB 5578 EN

16.2.1.2 Outdoor temperature received or sent over the device bus


The measured outdoor temperature can be provided to other controllers over the device bus.

Functions	Default	Configuration	
Outdoor sensor AF1, 2		CO1, 2, 3 -> F02 - 1	
Device bus	0	CO7 -> F01 - 1, device bus address	
Receive value AF1	0	CO7 -> F07 - 1, register number	
Send value AF1 1)	0	CO7 -> F06 - 1, register number	
Receive value AF2	0	CO7 -> F09 - 1, register number	
Send value AF2 1)	0	CO7 -> F08 - 1, register number	
 Send received outdoor temp and AE 	erature as 0	to 10 V signal by device bus with CO5 -> F23 - 1 setting	


EB 5578 EN 16-179

16.2.1.3 Gradient characteristic


Basically, the following rule applies: a decrease in the outdoor temperature causes the flow temperature to increase in order to keep the room temperature constant. By varying the 'Gradient' and 'Level' parameters, you can adapt the characteristic to your individual requirements:




The gradient needs to be increased if the room temperature drops when it is cold outside.



The gradient needs to be decreased if the room temperature drops when it is cold outside.



The level needs to be increased and the gradient decreased if the room temperature drops when it is mild outside.



The level needs to be decreased and the gradient increased if the room temperature rises when it is mild outside.

16-180 EB 5578 EN

Outside the times-of-use, reduced set points are used for control: the reduced flow set point is calculated as the difference between the adjusted values for 'Day set point' (rated room temperature) and 'Night set point' (reduced room temperature). The 'Max. flow temperature' and 'Min. flow temperature' parameters mark the upper and lower limits of the flow temperature. A separate gradient characteristic can be selected for the limitation of the return flow temperature.

Examples for adjusting the characteristic:

-	Old building, radiator design 90/70:	Gradient approx. 1.8
_	New building, radiator design 70/55:	Gradient approx. 1.4
_	New building, radiator design 55/45:	Gradient approx. 1.0
_	Underfloor heating depending on arrangement:	Gradient smaller than 0.5


i Note

Particularly for control operation without room sensor, the room temperatures set for day ('Day set point') and night ('Night set point') only become effective satisfactorily when the heating characteristic has been adapted to the building/heating surface layout.

Functions	Default	Configuration
Four-point characteristic	0	CO1, 2, 3, 11, 12, 13 -> F11 - 1
Parameters	Default	Switch position: value range
Day set point	20.0 °C	å ☆: 0.0 to 40.0 °C
Night set point	15.0 °C	₫ (: 0.0 to 40.0 °C
Parameters	Default	Parameters: value range
Flow gradient	1.21)	PA1, 2, 3, 11, 12, 13 -> P01: 0.2 to 3.2
Level (parallel shift)	0.0 °C	PA1, 2, 3, 11, 12, 13 -> PO2: -30.0 to 30.0 °C
Min. flow temperature	20.0 °C	PA1, 2, 3, 11, 12, 13 -> P06: -5.0 to 150.0 °C
Max. flow temperature	70.0 °C 1)	PA1, 2, 3, 11, 12, 13 -> P07: 5.0 to 150.0 °C
With CO1, 2, 3, 11, 12, 13 -> F05 - 1 the following applies:	Gradient: 0.2 to 1.0 (0.5) Max. flow temperature: 5.0 to 50.0 °C (50.0 °C)	

16.2.1.4 Four-point characteristic

The four-point characteristic allows you to define your own heating characteristic. It is defined by four points for the outdoor temperature, flow temperature, reduced flow temperature and return flow temperature. The 'Max. flow temperature' and 'Min. flow temperature' parameters mark the upper and lower limits of the flow temperature.

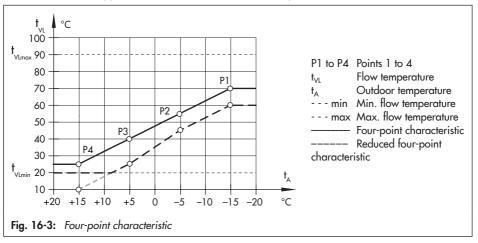

i Note

- The 'Day set point' and 'Night set point' parameters are no longer available when the four-point characteristic has been selected when no additional functions (e.g. optimization, flash adaptation) have been selected.
- The **four-point characteristic** function can only be activated when the **adaptation** function is not active (CO1, 2, 3, 11, 12, 13 -> F08 0).

Functions	Default	Configuration
Adaptation	0	CO1, 2, 3, 11, 12, 13 -> F08 - 0
Four-point characteristic	0	CO1, 2, 3, 11, 12, 13 -> F11 - 1

16-182 EB 5578 EN

Parameters		Default	Parameters: value range
Outdoor temperature	Point 1	−15.0 °C	PA1, 2, 3, 11, 12, 13 -> P05:
	Point 2	−5.0 °C	−50.0 to +50.0 °C
	Point 3	5.0 °C	
	Point 4	15.0 °C	
Flow temperature	Point 1	70.0 °C	PA1, 2, 3, 11, 12, 13 -> P05:
	Point 2	55.0 °C	−5.0 to +150.0 °C
	Point 3	40.0 °C	
	Point 4	25.0 °C	
Reduced flow temperature	Point 1	60.0 °C	PA1, 2, 3, 11, 12, 13 -> P05:
	Point 2	40.0 °C	−5.0 to +150.0 °C
	Point 3	20.0 °C	
	Point 4	20.0 °C	
Return flow temperature	Points 1 to 4	65.0 °C	PA1, 2, 3, 11, 12, 13 -> P05: 5.0 to 90.0 °C
Min. flow temperature		20.0 °C	PA1, 2, 3, 11, 12, 13 -> P06: -5.0 to +150.0 °C
Max. flow temperature		70.0 °C 1)	PA1, 2, 3, 11, 12, 13 -> P07: 5.0 to 150.0 °C
1) A/UL CO1 2 2 11 1/	2		

¹⁾ With CO1, 2, 3, 11, 12,

16.2.2 Fixed set point control

During the times-of-use, the flow temperature can be controlled according to a fixed set point. Outside the times-of-use, the controller regulates to a reduced flow temperature. Set the desired rated flow temperature as 'Day set point' and the reduced flow temperature as 'Night set point'.

Functions	Default	Configuration
Outdoor sensor	1	CO1, 2, 3, 11, 12, 13 -> F02 - 0
Parameters	Default	Switch position: value range
Day set point	50.0 °C	♣☆: Min. to max. flow temperature
Night set point	30.0 °C	₫ (: Min. to max. flow temperature

^{13 -&}gt; F05 - 1 the following applies: Max. flow temperature: 5.0 to 50.0 °C (50.0 °C)

Parameters	Default	Parameters: value range	
Min. flow temperature	20.0 °C	PA1, 2, 3, 11, 12, 13 -> P06: -5.0 to +150.0 °C	
Max. flow temperature	70.0 °C	PA1, 2, 3, 11, 12, 13 -> P07: 5.0 to 150.0 °C	

16.2.3 Underfloor heating/drying of jointless floors

Using function block setting CO1, 2, 3, 11, 12, 13 -> F05 - 1, the respective heating circuit is configured as an underfloor heating circuit. In doing so, the controller at first only limits the value ranges of the heating characteristic gradient and the maximum flow temperature in PA1, 2, 3, 11, 12, 13 parameter levels:

- Value range of the gradient: 0.2 to 1.0
- Value range of the maximum flow temperature: 5 to 50 °C

Furthermore, it is possible to set a **Boost** between 0.0 to 50.0 °C, which is additionally taken into account when there is a heat demand for the underfloor heating circuit of an upstream control circuit.

The **Drying of jointless floors** function can be activated afterwards. The function block parameters (starting with the 'Start temperature') determine the drying process: the first heating up phase starts at the entered 'Start temperature', which has a flow temperature of 25 °C in its default setting. The start temperature is constantly regulated for the days entered in 'Hold (days)'. Afterwards, this temperature is raised by the value entered in 'Temp. rise/day' within 24 hours, i.e. the default setting causes the flow temperature set point to rise to 30 °C 24 hours after the holding phase. If the maximum temperature is reached, it is kept constant for the number of days entered in 'Hold (days)'. The 'Temp. reduction/day' parameter determines the temperature reduction downwards. If the 'Temp. reduction/day' is set to 0, the temperature maintaining phase moves directly to automatic mode. If the function block parameter 'Start temperature' is set to 25 °C and 'Temp. rise/day' to 0.0 °C, the drying functions runs as specified in Part 4 of DIN EN 1264: the drying of jointless floors function starts with a flow temperature of 25 °C, which is kept constant for three days. Afterwards, the controller switches to the maximum adjusted temperature. The further process remains unchanged. The drying of jointless floors function is activated using the adjusted 'Start temperature' by changing the setting 'Stop' to 'Start'. 'Start' is displayed when the drying function starts. The restarting stages 'Build-up', 'Hold' (holding the maximum temperature) and 'Reduction' can be be selected to continue an interrupted drying process. The course of the drying process can be monitored in the operating level by reading the measured data of the associated heating circuit.

16-184 EB 5578 EN

'Done' is displayed after the last phase is completed. This disappears from the display after resetting the display to Stop in CO1, 2, 3 -> F05 or after interrupting the power supply. If a power failure occurs while the drying process is in progress, the drying process continues afterwards exactly at the point at which it was interrupted. In systems in which the drying function is interrupted due to DHW heating (e.g. system Anl 2.1), storage tank charging does not occur while the drying function is active, provided it is not used for frost protection of the storage tank.

CO1		
Hold (c	lays)	4
Temp. red./day		0.0°C
Start condition		Stop
F07 Optimization		0
Start c	ondition	

HC2 Values	p.1/1
Floor drying	Start
Outdoor temp	9.9°C
Flow temp.	24.7℃
Flow SP	25.0℃

i Note

The function block parameter can only be accessed after starting the function by resetting to 'Stop' in CO1, 2, 3, 11, 12, 13 -> F05.

Functions	Default	Configuration
Underfloor heating/drying of jointless	0	CO1, 2, 3, 11, 12, 13 -> F05 - 1
floors	0.0 °C	Boost: 0.0 to 50.0 °C
	25.0 °C	Start temperature: 20.0 to 60.0 °C
	0	Hold (days): 0 to 10 days
	5.0 °C	Temp. rise/day: 0.0 to 20.0 °C
	45.0 °C	Maximum temperature: 25.0 to 60.0 °C
	4	Hold (days): 0 to 30 days
	0.0 °C	Temp. reduction/day: 0.0 to 20.0 °C
	Stop	Start condition: Stop, Start, Raise, Hold, Reduction

16.2.4 Night set-back

The night set-back (= difference of the flow target temperature in day and night mode) is calculated in all heating circuits with a gradient characteristic as follows:

2x Heating characteristic gradient x (day room temperature – night room temperature)

16.2.4.1 Outdoor temperature for continuous day mode

If a heating circuit is in night mode (automatic mode, ©), this circuit is switched to day mode whenever the outdoor temperature falls below 'Outdoor temperature for continuous day mode'. The night mode restarts after the outdoor temperature rises above the limit (plus 0.5 °C hysteresis).

This function prevents the building from cooling down excessively outside the times-of-use when low outdoor temperatures occur. The transition towards day mode can be configured to be variable depending on the outdoor temperature.

Parameters	Default	Parameters: value range
Outdoor temperature for continuous day mode	−15.0 °C	PA1, 2, 3, 11, 12, 13 -> P09: -50.0 to 5.0 °C (only when CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 0)

16.2.4.2 Variable night set-back

With the setting CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 1, the night set-back is variable based on the outdoor temperature. The night set-back is fully effective at outdoor temperatures above the outdoor temperature limit value 'OTL night 100 %'.

The absolute value of the night set-back is linearly reduced to zero in the range between this value and the outdoor temperature limit value 'OTL night 0 %' for continuous day mode.

The absolute value of the night set-back is indicated in the 'Night set points' menu as 'HKx night set-back'. It is also indicated during day mode, but has no effect. With the setting CO1, CO2,CO3, CO11, CO12, CO13 -> F28 - 1, the 'Outdoor temperature for continuous day mode' (PO9) parameter is not used in the corresponding PA level.

Functions	Default	Configuration
Variable night set-back	0	CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 1 (only when CO1, CO2, CO3, CO11, CO12, CO13 -> F11 - 0)
	5.0 °C	OTL night 100 %: -50 °C to 20.0 °C
	−15 °C	OTL day 0 %: -50 °C to 5.0 °C

16-186 EB 5578 EN

16.2.5 Buffer tank systems

A heating characteristic based on a gradient or four entered points can be set in PA1 for the buffer tanks in systems Anl 3.9, 5.9, 14.1 to 14.3, 15.1 to 15.5, 16.x, 17.x and 18.x. A buffer tank set point for day operation and a buffer tank set point for night operation can be set without outdoor sensors in the customer level. An external demand transmitted from secondary controlled heating circuits, DHW circuit or an external request (by device bus, 0 to 10 V or binary signal) can override the current buffer tank set point. The maximum demand is indicated as the buffer tank set point for SF1. If the temperature falls below the buffer tank set point at SF1, charging of the buffer tank is started. This does not apply to systems Anl 3.9, 5.9 and 18.x. In these systems, the buffer tank set point is only determined by the DHW circuit

In systems And 14.1 to 14.3 and 15.1 to 15.5, the set point of the charging temperature is always 6 °C higher than the buffer tank set point. Each charging of the buffer tank finishes as soon as the temperature at the top buffer tank sensor is +3 °C higher than the buffer tank set point (bottom buffer tank sensor in systems Anl 15.4 and 15.5). If charging of the DHW storage tank is demanded in systems Anl 14.1 to 14.3 and 15.1 to 15.3, it is first checked whether there is enough heat in the buffer tank to charge the DHW storage tank. The DHW storage tank is charged by the district heating system if the temperature in the buffer tank is insufficient for charging. The charging of the DHW storage tank has priority over a charging demand of the buffer tank. The buffer tank is charged once the DHW storage tank charging has been completed. In systems Anl 14.3 and 15.3, a solar circuit with reroutable heat exchanger flow is integrated. If the temperature difference between the collector circuit sensor RüF2 and one of the storage tank sensors SF3 or SF4 is greater than the value of 'Solar circuit pump ON', the solar circuit pump UP2 is activated and the corresponding storage tank is charged. If both storage tanks can be charged, the DHW storage tank charging has priority. If the temperature difference falls below the value of 'Solar circuit pump OFF' in both storage tank circuits, the solar circuit pump UP2 is deactivated again. Basically, the solar circuit pump is deactivated when the measured temperatures of both storage tank sensors SF3 and SF4 have reached the 'Max. storage tank temperature' or 'Maximum buffer tank temperature' or when the solar collector temperature rises above 120 °C.

In systems Anl 3.9, 5.9, 16.x, 17.x and 18.x, the set point of the charging temperature is determined by the 'Minimum set point to charge buffer tank' parameter setting in the PA1 level. The automatic adaptation ('AUTO' setting) causes the set point of the charging temperature to always be above the current buffer tank set point by the value entered in 'Charging temperature boost'. Every other value entered in 'Minimum set point to charge buffer tank' is used as the minimum set point for the charging temperature which first starts to be variable

at higher buffer tank set points. When a return flow temperature sensor RüF1 is used, the charging pump SLP (CO1 -> F22 - 1) is first released to avoid cold charging when the temperature measured at RüF1 has reached the same temperature measured at SF1.

In systems Anl 3.9 and 5.9 this function only applies when the heating circuits RK2 and RK3 are not running. The 'Stop charging of the buffer tank' parameter (PA1 -> P17, default = AU-TO) determines under which conditions the charaina of the buffer tank is stopped. The automatic adaptation ('AUTO' setting) causes the buffer tank charging to be stopped when the temperature in the buffer tank reaches the value ('Buffer tank set point' + 'Hysteresis of buffer tank'. Every other value entered for 'Stop charging of the buffer tank' is rated as a fixed switch-off temperature for the buffer tank charging. When SF2 (CO1 -> F06 - 1) is configured, SF2 is always used to stop the charging of the buffer tank. The CO1 -> F25 - 1 setting causes the buffer tank bottom sensor SF3 to be activated, which can be used to stop buffer tank charging at low outdoor temperatures. In this way, the buffer tank is not completely charged in summer mode with SF2 as a switch-off sensor to keep the return flow temperature low at the end of the buffer tank charging. The storage tank charging pump is not switched off until the lag time (entered 'Valve transit time Ty' for RK1 multiplied by 'Lag time of charging pump') has elapsed. An activated setting CO1 -> F27 - 1 (discharging protection) causes the charging to be stopped when the charging temperature does not reach its set point even though the valve is fully open or it falls below the temperature measured at SF1 and does not rise again. Charging with the valve fully open is stopped after one hour at the latest. In such cases, 'Operation: discharging protection' is displayed with the measured values in HC1 for the next 30 minutes.

The CO1 -> F27 - 1 setting causes a 2 °C higher charging set point to be calculated. The following then applies:

Charging set point = Set point at SF1 + 'Charging temperature boost' + 2 °C

The operation of the feeder pump UP1 in systems Anl 16.0 to 16.5, 16.7 and 16.8 is either determined by the ZP time schedule or prompted by an external demand. For systems with downstream control circuits, either only this external demand or the demand of the downstream control circuits causes the feeder pump UP1 to be activated, depending on the CO5 -> F14 setting.

The pump UP2 of the solid fuel boiler circuit in systems Anl 14.1, 14.2, 15.1, 15.2, 16.2, 16.4, 16.5 and 16.7 starts to run when the temperature reaches 'Start temperature for boiler pump' at VF2. The boiler pump is switched off again when the temperature at VF2 falls below the temperature T = 'Start temperature for boiler pump' – 'Boiler pump hysteresis'. In systems Anl 14.3, 15.3, 16.3, 16.4, 16.6 and 16.7, a solar circuit is integrated, which uses storage tank sensor SF3 for control. The collector circuit pump CP is activated when the temperature at the collector sensor RüF2 is higher than that at storage tank sensor SF3 by the

16-188 EB 5578 EN

value entered in 'Solar circuit pump ON'. It is deactivated when the temperature difference falls below the valve entered in 'Solar circuit pump OFF', when the temperature at the storage tank sensor SF3 reaches 'Max. storage tank temperature' or when the collector temperature rises above 120 °C.

The outputs AA1 (0 to 10 V) and AA2 (PWM) for the control signal Y4 to control the heat exchanger charging pump are available to control the DHW temperature in systems Anl 3.9, 5.9, 17.x and 18.x. The control signal can also be reversed, if required. For operation of the heat exchanger charging pump, the minimum delivery rate and the control parameters to control the DHW temperature can adjusted with CO4 -> F12 - 1. The outputs AA1 (0 to 10 V) and AA2 (PWM) are available for adapting the delivery rate of the charging pump SLP based on the temperature. The output signal can also be reversed, if required. A flow switch can be activated with the CO4 -> F04 - 1 setting. The output UP1 for the changeover valve is activated by configuring the return flow temperature sensor RüF2. The changeover valve is controlled based on the 'Return flow temperature limit, layering at top' parameter: If the temperature measured at RüF2/RüF4 exceeds the adjusted switching point, the output UP1 remains deactivated and the return flow water is layered at the top. After the temperature measured at RüF2 has fallen below the switching point, the output UP1 is activated and the return flow water is layered at the bottom.

The CO4 -> F14 - 1 setting activates the **Thermal disinfection** function and the input RüF3 required for this function. It may be necessary for the controller to initially ensure at the start of every thermal disinfection that a sufficiently high temperature exists in the buffer tank. Therefore, enough time for the thermal disinfection process must be available.

Alternatively, in systems Anl 3.9, 17.x and 18.x, an electric heating cartridge can be used for the thermal disinfection process. With the CO4 -> F23 - 1 setting the increased heat demand by the DHW circuit during an active thermal disinfection is not passed on to the buffer tank circuit RK1. The measured temperature at SF1 is decisive for the demand for electric heating at the start of a thermal disinfection process and during the entire process: when the temperature at SF1 is the same or greater than 'Disinfection temperature' (function block parameter in CO4 -> F14) + 'Set point boost' (function block parameter in CO4 -> F14), there is no demand for electric heating. When the temperature at SF1 is below this limit, the binary output BA10 is activated to demand electric heating.

i Note

The buffer tank control circuit is deactivated as described in section 16.2.4.1. When predefined gradients of heating characteristic (CO1 -> F11 - 0) are used, night mode is not possible in the buffer tank control circuit. In contrast to an active four-point characteristic (CO1 -> F11 - 1): in this case, a four-point characteristic exists for day and night modes.

Functions	Default	Configuration
Storage tank sensor SF2	1	CO1 -> F06 - 1
Speed control of the charging pump	0	CO1 -> F21 - 1
	40.0 °C	Start speed reduction, limit: 5.0 to 90.0 °C
	50.0 °C	Stop speed reduction, limit: 5.0 to 90.0 $^{\circ}\text{C}$
	20.0 °C	Minimum speed: 0 to 50 %
SLP depending on return flow temperature	0	CO1 -> F22 - 1
Buffer tank bottom sensor	0	CO1 -> F25 - 1 Buffer tank bottom sensor SF3 active
	10.0 °C	Limit temperature: 0.0 to 50.0 °C
Discharging protection	0	CO1 -> F27 - 1
Return flow sensor RüF2	0	CO4 -> F03 - 1
Three-step control mode	1	CO4 -> F12 - 1
	20 %	Minimum speed: 5 to 50 %
	2.0	KP: 0.1 to 50.0
	120 s/30 s	TN: 1 to 999 s
	0 s	TV: 0 to 999 s
Electric heating cartridge	0	CO4 -> F23 - 1
AA1, AA2 reverse	0	CO5 -> F25, F26 - 1
	0 %	Zero: 0 to 50 %
AA1, AA2 PWM	0	CO5 -> F34, F35 - 1 Function: SLP speed, 'Y4'

16-190 EB 5578 EN

Parameters	Default	Parameters: value range
Minimum set point to charge buffer tank	AUTO	PA1 -> P16: AUTO to 90.0 °C
Stop charging of the buffer tank	AUTO	PA1 -> P17: AUTO to 90.0 °C
Charging temperature boost	6.0 °C	PA1 -> P18: 0.0 to 50.0 °C
Lag time of charging pump	1.0	PA1 -> P19: 0.0 to 10.0
Solar circuit pump ON	10.0 °C	PA4 -> P10: 1.0 to 30.0 °C
Solar circuit pump OFF	3.0 °C	PA4 -> P11: 0.0 to 30.0 °C
Max. storage tank temperature	80.0 °C	PA4 -> P12: 20.0 to 90.0 °C
Maximum buffer tank temperature	80.0 °C	PA4 -> P13: 20.0 to 90.0 °C
Return flow temperature limit, layering at top	25.0 °C	PA4 -> P21: 5.0 to 90.0 °C
Start temperature for boiler pump	60.0 °C	PA5 -> P01: 20.0 to 90.0 °C
Boiler pump hysteresis	5.0 °C	PA5 -> P02: 0.0 to 30.0 °C

16.2.6 Summer mode

Summer mode is activated depending on the mean daytime temperature (measured between 7.00 h and 22.00 h) during the adjusted summer time period. If the mean daytime temperature exceeds the 'Boost' on the number of successive days set in 'No. days until activation', summer mode is activated on the following day. This means that the valves in all heating circuits are closed and the circulation pumps are switched off after $t=2 \times v$ valve transit time. If the mean daytime temperature falls below the 'Limit' on the number of successive days set in 'No. days until deactivation', summer mode is deactivated on the following day.

Functions	Default	Configuration
Summer mode	0	CO5 -> F04 - 1
	01.06 - 30.09	Time: Adjustable as required
	2	No. days until activation: 1 to 3
	1	No. days until deactivation: 1 to
	18.0 °C	3
		Limit: 0.0 to 30.0 °C

i Note

Summer mode only becomes effective when the controller is in automatic mode (\bigcirc) .

16.2.7 Delayed outdoor temperature adaptation

The calculated outdoor temperature is used to determine the flow temperature set point. The heat response is delayed when the outdoor temperature either increases or decreases or both. If the outdoor temperature varies by, for example 12 °C within a very short period of time, the calculated outdoor temperature is adapted to the actual outdoor temperature in small steps using a delay of 3 °C/h over a time period of $t = \frac{12 \text{ °C}}{3 \text{ °C/h}} = 4 \text{ h}$.

i Note

The delayed outdoor temperature adaptation helps avoid unnecessary overloads of central heating stations in combination with either overheated buildings occurring, for example due to warm winds or temporarily insufficient heating due to the outdoor sensor being exposed to direct sunshine. In the operating level, the outdoor temperature blinks on the display while delayed outdoor temperature adaptation is active. A small hour glass appears next to the thermometer on the display when this function is active. The calculated outdoor temperature is displayed.

Functions	Default	Configuration
Delayed outdoor temperature adaptation (decreasing)	0	CO5 -> F05 - 1 Delay/h: 0.2 to 6.0 °C
Delayed outdoor temperature adaptation (increasing)	0 3.0 °C	CO5 -> F06 - 1 Delay/h: 0.2 to 6.0 °C

16.2.8 Remote operation

Apart from measuring the room temperature, the Types 5257-5¹⁾ and Type 5257-51 Room Panels (Pt1000 sensor) as well as Type 5244¹⁾ Room Panel (PTC sensor) provide the following opportunities of influencing the control process:

Selecting the operating mode:	② Automatic mode☆ Day mode✔ Night mode
Set point correction:	During rated operation, the room temperature set point can be increased or reduced by up to 5 $^{\circ}$ C using a continuously adjustable rotary knob.

With an activated room sensor, the measured room temperature is displayed when the remote operation is connected and activated. Nevertheless, it is not used for control when either the **optimization**, **adaptation** or **flash adaptation** function is activated.

16-192 EB 5578 EN

Alternatively, the TROVIS 5570 ¹⁾ Room Panel can be connected over meter bus (see section 16.4.15).

1) No longer available

Default	Configuration
0	CO1, 2, 3 -> F01 - 1
OVIS 5570	Room Panel is used:
0	CO7 -> F01 - 1, device bus address
0	CO7 -> F03 - 1, device bus address
0	CO7 -> F04 - 1, device bus address
0	CO7 -> F05 - 1, device bus address
	0 ROVIS 5570 0 0



Room panels cannot be used for the heating circuits RK11, RK12 and RK13.

16.2.9 Optimization

This function requires the use of a room sensor. Depending on the building characteristics, the controller determines and adapts the required advance heating time (maximum 8 hours) to ensure that the desired 'Day set point' (rated room temperature) has been reached in the reference room when the time-of-use starts. During the advance heating period, the controller heats with the max. flow temperature. This temperature is built up in steps of 10 °C. As soon as the 'Day set point' has been reached, outdoor-temperature-compensated control is activated.

Depending on the room sensor, the controller switches off the heating system up to one hour before the time-of-use ends. The controller chooses the deactivation time such that the room temperature does not drop significantly below the desired value until the time-of-use ends.

During the advance heating period and the premature deactivation of the heating system, the * or (icon blinks on the display.

Outside the times-of-use, the controller monitors the 'Night set point' (reduced room temperature). When the temperature falls below the night set point, the controller heats with the max. flow temperature until the measured room temperature exceeds the adjusted value by 1 °C.

i Note

- Direct sunshine can cause the room temperature to increase and thus result in the premature deactivation of the heating system.
- When the room temperature decreases while the heating system is shortly outside its timesof-use, this can prematurely cause the controller to heat up to the 'Day set point'.

Functions	Default	Configuration
Room sensor	0	CO1, 2, 3, 11, 12, 13 -> F01 - 1
Outdoor sensor	1	CO1, 2, 3, 11, 12, 13 -> F02 - 1
Optimization	0	CO1, 2, 3, 11, 12, 13 -> F07 - 1
Parameters	Default	Switch position: value range
Day set point	20.0 °C	♣茶: 0.0 to 40.0 °C
Night set point	15.0 °C	♣ (: 0.0 to 40.0 °C

16.2.10 Flash adaptation

To ensure that the controller reacts immediately to room temperature deviations during rated and reduced operation, the function block setting CO1, 2, 3, 11, 12, 13 -> F09 - 1 needs to be made. The heating is then always switched off as soon as the room temperature exceeds the 'Day set point' or 'Night set point' by 2 °C.

Heating first starts again when the room has cooled off and the room temperature is 1 °C above the set point. The flow temperature set point is corrected if the 'Cycle time' or 'KP (gain)' are set to a value other than 0. The 'Cycle time' determines the intervals at which the flow temperature set point is corrected by 1 °C. A 'KP (gain)' set to a value other than 0 causes a direct increase/decrease in flow temperature set point when a sudden deviation in room temperature arises. A 'KP (gain)' setting of 10.0 is recommended.

i Note

- Cooling loads, such as drafts or open windows, affect the control process.
- Rooms may be temporarily overheated after the cooling load has been eliminated.

16-194 EB 5578 EN

Functions	Default	Configuration
Room sensor	0	CO1, 2, 3, 11, 12, 13 -> F01 - 1
Outdoor sensor	1	CO1, 2, 3, 11, 12, 13 -> F02 - 1
Flash adaptation	0 20 min 0.0	CO1, 2, 3, 11, 12, 13 -> F09 - 1 Cycle time: 0 to 100 min KP (gain): 0.0 to 25.0
Parameters	Default	Switch position: value range
Day set point	20.0 °C	↓ 淬: 0.0 to 40.0 °C
Night set point	15.0 °C	å €: 0.0 to 40.0 °C

16.2.10.1 Flash adaptation without outdoor sensor (based on room temperature)

The flow temperature control starts with 'Day set point' for flow in rated operation or with 'Night set point' for flow in reduced operation as no set points calculated using characteristics exist without an outdoor sensor. The 'Cycle time' determines the intervals at which the flow temperature set point is corrected by 1 °C. The heating is then always switched off as soon as the room temperature exceeds the 'Day set point' or 'Night set point' by 2 °C. Heating first starts again when the room has cooled off and the room temperature is 1 °C above the set point. A 'KP (gain)' set to a value other than 0 causes a direct increase/decrease in flow temperature set point when a sudden deviation in room temperature arises. A 'KP (gain)' setting of 10.0 is recommended.

Functions	Default	Configuration
Room sensor	0	CO1, 2, 3, 11, 12, 13 -> F01 - 1
Outdoor sensor	1	CO1, 2, 3, 11, 12, 13 -> F02 - 0
Flash adaptation	0 20 min 0.0	CO1, 2, 3, 11, 12, 13 -> F09 - 1 Cycle time: 1 to 100 min KP (gain): 0.0 to 25.0
D	D ()	6 5 1 50 1
Parameters	Default	Switch position: value range
Day set point		\$\div \text{: 0.0 to 40.0 °C} \$\div \text{: 0.0 to 40.0 °C}\$
		•
Day set point	20.0 °C	♣☆: 0.0 to 40.0 °C
Day set point Night set point	20.0 °C 15.0 °C	♣☆: 0.0 to 40.0 °C ♣ €: 0.0 to 40.0 °C

16.2.11 Adaptation

The controller is capable of automatically adapting the heating characteristic to the building characteristics. A gradient characteristic must be set in this case (CO1, 2, 3, 11, 12, 13 -> F11 - 0). The reference room, where the room sensor is located, represents the entire building and is monitored to ensure that the room set point ('Day set point') is maintained. When the mean measured room temperature in rated operation deviates from the adjusted set point, the heating characteristic is modified accordingly for the following time-of-use. The corrected value is displayed in PA1, 2, 3, 11, 12, 13 -> P01 (Gradient, flow).

Functions	Default	Configuration
Room sensor	0	CO1, 2, 3, 11, 12, 13 -> F01 - 1
Outdoor sensor		CO1, 2, 3, 11, 12, 13 -> F02 - 1
Adaptation	0	CO1, 2, 3, 11, 12, 13 -> F08 - 1
Four-point characteristic	0	CO1, 2, 3, 11, 12, 13 -> F11 - 0
Parameters	Default	Switch position: value range
Day set point	20.0 °C	♣桊: 0.0 to 40.0 °C
Night set point	15.0 °C	♣ ((: 0.0 to 40.0 °C

i Note

If the **Flash adaptation** function is already configured with a small cycle time, the **Adaptation** function should not be configured as well.

16.2.12 Cooling control

Cooling control with outdoor sensor

When the cooling control function is activated in a control circuit with outdoor sensor, the four-point characteristic of the corresponding control circuit is automatically activated and the operating direction of the control output is reversed. In PA1, PA2 and/or PA3 the four points for the course of the set point based on the outdoor temperatures can be adjusted separately for day and night mode. The 'Base point for return flow temperature' that can be adjusted with an active return flow sensor determines the point at which a minimum limitation of the return flow temperature starts: if the measured return flow temperature falls below this value, the flow temperature set point is raised. The four return flow temperature values in the four-point characteristic function have no effect.

16-196 EB 5578 EN

Functions		Default	Configuration
Outdoor sensor			CO1, 2, 3 -> F02 - 1
Cooling control		0	CO1, 2, 3 -> F04 - 1
Four-point characteristic		0	CO1, 2, 3 -> F11 - 1
Parameters		Default	Parameters: value range
Outdoor temperature	Point 1 Point 2 Point 3 Point 4	5.0 °C 15.0 °C 25.0 °C 35.0 °C	PA1, 2, 3 -> P05: -50.0 to +50.0 °C
Flow temperature	Point 1 Point 2 Point 3 Point 4	20.0 °C 15.0 °C 10.0 °C 5.0 °C	PA1, 2, 3 -> P05: -5.0 to +150.0 °C
Reduced flow temperature	Point 1 Point 2 Point 3 Point 4	30.0 °C 25.0 °C 20.0 °C 15.0 °C	PA1, 2, 3 -> P05: -5.0 to +150.0 °C
Base point for return flow temperature:		65.0 °C	PA1, 2, 3 -> P13: 5.0 to 90.0 °C

i Note

The limiting factors KP of the **Return flow sensor** (CO1, 2, 3 -> F03) functions apply during cooling control as well.

Cooling control without outdoor sensor

When the cooling control function is activated in a control circuit without outdoor sensor, only the adjustment limits for the day and night set points at the rotary switch as well as the 'Base point for return flow temperature' can be adjusted in PA1 and/or PA2.

Functions	Default	Configuration
Outdoor sensor		CO1, 2, 3 -> F02 - 0
Cooling control	0	CO1, 2, 3 -> F04 - 1
Parameters	Default	Switch position: value range
Parameters Flow set point (day)	Default 20.0 °C	Switch position: value range

Parameters	Default	Parameters: value range
Min. flow temperature	20.0 °C	PA1, 2, 3 -> P06: -5.0 to +150.0 °C
Max. flow temperature	90.0 °C	PA1, 2, 3 -> P07: 5.0 to 150.0 °C
Base point for return flow temperature:	65.0 °C	PA1, 2, 3 -> P13: 5.0 to 90.0 °C

i Note

- The limiting factors KP of the **Return flow sensor** (CO1, 2, 3 -> F03) functions apply during cooling control as well.
- The request for a signal by downstream control circuits or externally (when a pre-control circuit is used) is based on the maximum selection. Therefore, systems (e.g. system Anl 5.0) or controllers connected over a device bus are not suitable for transmitting the signal for required cooling. The 'Set point boost (pre-control circuit)' parameter can only generate higher and not lower set points in the pre-control circuit.

16.2.13 Differential temperature control

In systems Anl 1.0 and 16.0, the differential temperature control causes the delivery rate of pump UP1 to be adapted through the 0 to 10 V or PWM output depending on the difference between the secondary flow temperature and the secondary return flow temperature. In system Anl 1.0 the sensor input RüF2 is automatically activated for this purpose with the setting CO1 -> F23 - 1. In system Anl 16.0, the sensor inputs VF2 and RüF2 are automatically activated. The KP (influence factor) determines how strongly the controller responds when the temperature deviates from the set point of the differential temperature control. The outputs AA1 (0 to 10 V) and AA2 (PWM) are available for the differential temperature control. The output signal can also be reversed, if required.


Functions	Default	Configuration
Differential temperature control	0	CO1 -> F23 - 1
	20.0 °C	Set point of differential temperature control: 0.0
	1.0	to 50.0 °C
	20 %	KP (influence factor): 0.1 to 10.0
		Minimum speed: 0 to 100 %
AA1, AA2 reverse	0	CO5 -> F25, F26 - 1
	0 %	Zero: 0 to 50 %
AA1, AA2 PWM	0	CO1 -> F34, F35 - 0
		Function: differential temperature control

16-198 EB 5578 EN

16.3 Functions of the DHW circuit

16.3.1 DHW heating in the storage tank system

Start storage tank charging

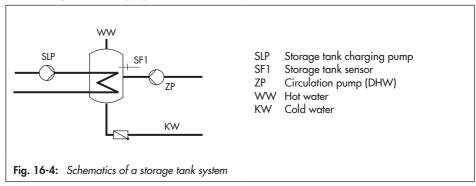

The controller begins charging the storage tank when the water temperature measured at storage tank sensor SF1 falls below the 'DHW temperature set point' by 0.1 °C. If the flow temperature in the system exceeds the desired charging temperature, the controller tries to reduce the flow temperature in the heating circuit for up to three minutes before the storage tank charging pump is activated. When there is no heating operation or when the flow temperature in the system is lower, the storage tank charging pump is switched on immediately. If the function CO4 -> F15 - 1 (SLP ON depending on return flow temperature) is activated, the primary valve is opened without simultaneously operating the storage tank charging pump. The storage tank charging pump is first switched on when the primary return flow temperature has reached the temperature currently measured at storage tank sensor SF1. This function enables storage tank charging when the heating system is switched off, e.g. in summer mode, without cooling down the storage tank first by filling it with cold flow water. The storage tank charging pump does not start operation before a sufficiently high temperature has been reached at the heat exchanger. An activated setting CO1 -> F27 - 1 (discharging protection) causes the charging to be stopped when the charging temperature does not reach its set point even though the valve is fully open or it falls below the temperature measured at SF1 and does not rise again. Charging with the valve fully open is stopped after one hour at the latest. In such cases, 'Operation: discharging protection' is displayed with the measured values in HC1 for the next 30 minutes.

i Note

The 'DHW temperature set point' is to be regarded in relation to the charging temperature if a storage tank thermostat is used.

Time-controlled switchover of storage tank sensors

By configuring a second storage tank sensor SF2, it is possible to determine by setting the function block CO4 -> F19 - 1 that the storage tank sensor SF1 is used for day mode in the DHW circuit and storage tank sensor SF2 for night mode. As a result, different storage tank volumes can be kept at a constant temperature according to a time schedule and also at different temperatures if the 'DHW temperature set points' for day and night differ from one another.

Stop storage tank charging

The controller stops charging the storage tank when the water temperature measured at storage tank sensor SF1 has reached the temperature T = 'DHW temperature' + 'Hysteresis'. When there is no heating operation or when the flow temperature demand in the system is lower, the corresponding valve is closed. The storage tank charging pump is switched off after t = 'Lag time of storage tank charging pump' x 'Valve transit time'.

With the default settings, the temperature in the storage tank is increased by 5 °C to reach 65 °C when the storage tank temperature falls below 60 °C. The charging temperature is calculated from the DHW temperature (60 °C) plus the 'Charging temperature boost' (10 °C), which equals 70 °C. When the storage tank has been charged, the heating valve is closed and the charging pump continues to run for the time $t = P06 \times V$ alve transit time. Outside the times-of-use, the storage tank is only charged when the temperature falls below 40 °C ('Night set point for DHW temperature'). In this case, the tank is charged with a charging temperature of 50 °C until 45 °C is reached in the tank.

Functions	Default	Configuration
Storage tank sensor SF1		CO4 -> F01 - 1
Storage tank sensor SF2		CO4 -> F02 (-1 when CO4 -> F19 - 1)
SLP depending on return flow temperature	0	CO4 -> F15
Switchover	0	CO4 -> F19 (-1 only when CO4 -> F02 - 1)
Discharging protection	0	CO4 -> F27 - 1

16-200 EB 5578 EN

Switch position: value range

Day set point for DHW temperature or charging temperature when CO4 -> F01 - 0	60.0 °C	♣☆: Min. to max. adjustable DHW set point
Night set point for DHW temperature	40.0 °C	₹ (: Min. to max. adjustable DHW set point
Parameters	Default	Parameters: value range
Min. adjustable DHW set point 1)	40.0 °C	PA4 -> P01: 5.0 to 90.0 °C
Max. adjustable DHW set point 1)	60.0 °C	PA4 -> P02: 5.0 to 90.0 °C
Hysteresis ²⁾	5.0 °C	PA4 -> P03: 0.0 to 30.0 °C
Charging temperature boost 3)	10.0 °C	PA4 -> P04: 1.0 to 50.0 °C
Lag time for storage tank charging pum		PA4 -> P19 x Valve transit time: 0.0 to 10.0

Default

Parameters

16.3.1.1 DHW circuit additionally controlled by a globe valve

In systems Anl 7.1, 8.1, 9.1, 9.5, 11.1, 12.1, 13.1 and 21.1, the following versions with globe valve can be configured instead of the three-way valve control in the DHW circuit:

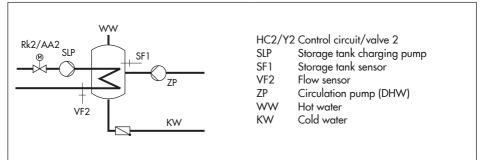


Fig. 16-5: Schematics of a storage tank system with a globe valve for return flow temperature limitation

Globe valve and flow sensor VF2 are used exclusively for return flow temperature limitation in the schematics shown above. The pre-control circuit provides at least the same flow temperature as in the standard schematic version which is calculated from DHW temperature set point + Charging temperature boost + Boost set point of pre-control circuit.

Parameters serve as limitation of the adjustment range for the DHW temperature to be set at the rotary switch

²⁾ Deactivation value T = DHW temperature + 'Hysteresis'


Charging temperature T = DHW temperature + 'Charging temperature boost'

The functions and parameters of the DHW heating in the storage tank system are upgraded by the following settings:

Functions	Default	Configuration
Return flow control	0	CO4 -> F20 - 1
Parameters	Default	Parameters: value range

16.3.2 DHW heating in the storage tank charging system

Start storage tank charging

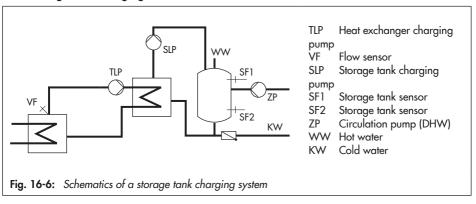

The controller begins charging the storage tank when the water temperature measured at storage tank sensor SF1 falls below the 'DHW temperature set point' by 0.1 °C. If the flow temperature in the system exceeds the desired charging temperature, the controller tries to reduce the flow temperature in the heating circuit for up to three minutes before the exchanger charging pump is activated together with the storage tank charging pump. When there is no heating operation or when the flow temperature in the system is lower, the exchanger charging pump is switched on. If the temperature currently measured at storage tank sensor SF1 is reached at the flow sensor VF, the storage tank charging pump is switched on.

An activated setting CO1 -> F27 - 1 (discharging protection) causes the charging to be stopped when the charging temperature does not reach its set point even though the valve is fully open or it falls below the temperature measured at SF1 and does not rise again. Charging with the valve fully open is stopped after one hour at the latest. In such cases, 'Op-

16-202 EB 5578 EN

eration: discharging protection' is displayed with the measured values in HC1 for the next 30 minutes.

If a storage tank thermostat is used, the storage tank charging pump is switched on as soon as the temperature T = Charging temperature -5 °C is reached at the flow sensor VF. If a storage tank thermostat is used, the storage tank charging pump is switched on when the temperature T = Charging temperature -5 °C is reached at the flow sensor VF.

i Note

The 'DHW temperature set point' is to be regarded in relation to the charging temperature if a storage tank thermostat is used.

When the flow sensor VF4 is activated, the set point in the heat exchanger circuit is influenced by the system deviation in the storage tank charging circuit upon activation of the storage tank charging pump: if the temperature measured at flow sensor VF4 is lower than the desired 'Charging temperature', the set point in the heat exchanger circuit is increased in steps of 1 °C. When the set point in the heat exchanger charging circuit reaches the 'Max. charging temperature', the set point is no longer increased. An error message (Max. charging temp.) is generated.

i Note

The set point in the heat exchanger circuit which is valid at the end of the charging cycle will be used again at the beginning of the next cycle.

If times-of-use have been programmed for DHW heating, the 'DHW temperature set point' adjusted at the rotary switch is applied during these times-of-use. Outside the times-of-use, the night set point for DHW temperature is used. This does not apply when a storage tank thermostat is used.

Time-controlled switchover of storage tank sensors

By configuring a second storage tank sensor SF2, it is possible to determine by setting the function block CO4 -> F19 - 1 that the storage tank sensor SF1 is used for day mode in the DHW circuit and storage tank sensor SF2 for night mode. As a result, different storage tank volumes can be kept at a constant temperature according to a time schedule and also at different temperatures if the 'DHW temperature set points' for day and night differ from one another.

Stop storage tank charging

The controller stops charging the storage tank when the water temperature measured at storage tank sensor SF2 has reached the temperature T = 'DHW temperature' + 'Hysteresis'. To do so, the heat exchanger charging pump is immediately switched off. When there is no heating operation or when the flow temperature demand in the system is lower, the corresponding valve is closed. The storage tank charging pump is switched off after the time has elapsed $t = P06 \times v$ valve transit time.

Functions	Default	Configuration
Storage tank sensor SF1		CO4 -> F01 - 1
Storage tank sensor SF2		CO4 -> F02 - 1
Flow sensor	0	CO4 -> F05
Switchover	0	CO4 -> F19
Discharging protection	0	CO4 -> F27 - 1
Parameters	Default	Switch position: value range
Day set point for DHW temperature or charging temperature when CO4 -> F01 - 0	60.0 °C	♣茶: Min. to max. adjustable DHW set point
Night set point for DHW temperature	40.0 °C	$ label{eq:def:Continuous}$ Min. to max. adjustable DHW set point
Min. adjustable DHW set point 1)	40.0 °C	PA4 -> P01: 5.0 to 90.0 °C
Max. adjustable DHW set point 1)	60.0 °C	PA4 -> P02: 5.0 to 90.0 °C
Hysteresis ²⁾	5.0 °C	PA4 -> P03: 1.0 to 30.0 °C
Charging temperature boost 3)	10.0 °C	PA4 -> P04: 0.0 to 50.0 °C
Max. charging temperature	80.0 °C	PA4 -> P05: 20.0 to 150.0 °C (only with VF4)
Lag time for storage tank charging pump	p 1.0	PA4 -> P06: 0.0 to 10.0

Parameters serve as limitation of the adjustment range for the DHW temperature to be set at the rotary switch

16-204 EB 5578 EN

²⁾ Deactivation value T = DHW temperature + 'Hysteresis'


³⁾ Charging temperature T = DHW temperature + 'Charging temperature boost'

16.3.2.1 Cold charging protection

In system Anl 1.1(-1), the **cold charging protection** function causes a storage tank charging to be started first when the primary flow temperature is sufficiently high enough. The CO4 -> F22 - 1 setting automatically activates the FG2 input to measure the primary flow temperature. If the measured primary flow temperature is lower than the measured storage tank temperature (e.g. due too a supply line that has cooled down at the start of a storage tank charging), the heating circuit valve is only opened 10 % at first. The storage tank charging is not released in absolute priority operation until the primary flow temperature has risen enough as a result. Parallel operation must be additionally configured if it is required.

Functions	Default	Configuration
Cold charging protection	0 10 %	CO4 -> F22 - 1 Valve position: 1 to 100 %
Parallel pump operation	0 10 min 40.0 °C	CO4 -> F06 - 1 Stop: 0 to 10 min Temperature limit: 20.0 to 90.0 °C

16.3.3 DHW heating in instantaneous heating system

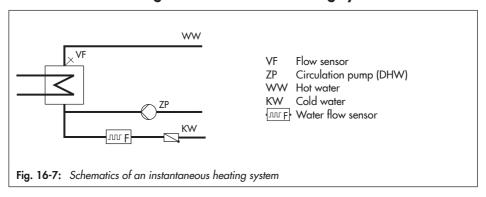

Without a water rate sensor or flow switch, the control of the required DHW temperature at the flow sensor VF is only active during times-of-use of the circulation pump ZP. The water flow sensor or flow switch allows the controller to recognize when DHW tapping starts and stops. Control of the required DHW temperature can made to be active only during DHW tapping by deleting all times-of-use of the circulation pump. If the control with flow rate sensor is configured, the attenuation in the DHW circuit (CO4 -> F13 - 1) is automatically activated and the temperature set to 8 $^{\circ}$ C.

The control of the required DHW temperature at the flow sensor VF is only active during times-of-use of the circulation pump ZP.

If a water flow sensor is connected (see Fig. 16-7), make sure that the function '10 V supply' is configured with the CO5 -> F34 setting.

i Note

After entering the key number 1999, the status information, e.g. operating point, valve controller (influence of the PI component on the valve position) and valve sensor (influence of the manipulated variable on the valve position), is displayed in the extended operating level as a percent after the sectional display of the DHW circuit.

Functions	Default	Configuration
Flow rate sensor	0 Analog	CO4 -> F04 - 1 Select: Analog (flow rate sensor), Binary (flow switch)
AA1 PWM	0	CO4 -> F34 - 0 Function: 10 V supply
Parameters	Default	Switch position: value range
		g-
Day set point for DHW temperature	60.0 °C	₹: Min. to max. adjustable DHW set point
Day set point for DHW temperature Night set point for DHW temperature	60.0 °C 40.0 °C	
, ,		於: Min. to max. adjustable DHW set point
Night set point for DHW temperature	40.0 °C	♣☆: Min. to max. adjustable DHW set point ♣ ℂ: Min. to max. adjustable DHW set point

16.3.4 Domestic hot water heating with solar system

The systems Anl 1.3, 1.4, 1.7, 1.8, 2.3, 2.4, 3.3, 3.4, 4.3, 10.3, 11.3 and 11.4 are fitted with a solar system for DHW heating. In these systems, the difference between the temperatures measured at the storage tank sensor SF3 and the sensor VF3 at the solar collector is determined. The 'Solar circuit pump ON' parameter determines the minimum temperature difference between sensors VF3 and SF3 required to activate the solar circuit pump. If the temperature difference falls below the value of 'Solar circuit pump OFF', the solar circuit pump is switched off. Basically, the solar circuit pump is also switched off when either the water temperature measured at sensor SF3 has reached the 'Max. storage tank temperature' or when the solar collector temperature rises above 120 °C.

16-206 EB 5578 EN

i Note

The times-of-use of the DHW circuit do not affect the operation of the solar system.

After the key number 1999 has been entered, the operating hours of the solar pump are displayed in extended operating level (see the 'Setup' section).

Parameters	Default	Parameters: value range
Solar circuit pump ON	10.0 °C	PA4 -> P10: 1.0 to 30.0 °C
Solar circuit pump OFF	3.0 °C	PA4 -> P11: 0.0 to 30.0 °C
Max. storage tank temperature	80.0 °C	PA4 -> P12: 20.0 to 90.0 °C

16.3.5 Intermediate heating

This function can only be activated in systems Anl 2.x, 4.1 to 4.5, 8.x, 9.5 and 9.6.

With the setting CO4 -> F07 - 1, heating operation of the UP1 heating circuit is reactivated for a period of ten minutes after 20 minutes of priority operation (heating deactivated during DHW heating). By setting CO4 -> F07 - 0, storage tank charging is given unlimited priority over the heating operation in the UP1 heating circuit.

Functions	Default	Configuration
Intermediate heating	1	CO4 -> F07 - 1

16.3.6 Parallel pump operation

This function can only be activated in systems Anl 1.1-1, 2.x, 4.1 to 4.5, 6.1, 8.x, 9.5 and 9.6.

When CO4 -> F06 - 1, the circulation pump UP1 remains activated during DHW heating.

This does not include operating situations during which the current flow temperature demand of the pump circuit is lower than the adjusted 'Temperature limit'. In this case, the controller applies priority operation, if necessary with intermediate heating. Once a parallel pump operation cycle has been activated and the time period set in 'Stop' has elapsed, system deviations greater than 5 °C cause the controller to suspend parallel operation for 10 minutes and to apply priority operation.

Setting 'Stop' to 0 min leads to a parallel operation once initiated remaining regardless of a deviation.

Functions	Default	Configuration
Parallel pump operation	0 10 min 40.0 °C	CO4 -> F06 - 1 Stop: 0 to 10 min Temperature limit: 20.0 to 90.0 °C

16.3.7 Circulation pump during storage tank charging

With the setting CO4 -> F11 - 1, the circulation pump (DHW) continues operation according to the programmed time schedule even during storage tank charging. With the setting CO4 -> F11 - 0, the circulation pump is switched off as soon as the storage tank charging pump is activated. The circulation pump starts to operate again according to the time schedule when the storage tank charging pump has been switched off again.

Functions	Default	Configuration
Operation of circulation pump (DHW)		
during storage tank charging	0	CO4 -> F11

16.3.8 Priority circuit

In many district heating systems with primary DHW heating, the allotted amount of water cannot meet DHW heating and heating operation demands when they are required at the same time. As a result, the capacity required for DHW heating needs to be taken from the heating system when great heating loads occur; and this, until DHW demand has been concluded. Nevertheless, heating operation is not to be interrupted simply. Only the amount of energy required for DHW heating is to be deducted. This can be achieved by using the priority functions: reverse control and set-back operation.

16.3.8.1 Reverse control

In all systems with DHW heating and at least one heating circuit with a control valve, DHW heating can be given priority by applying reverse control. With the setting $CO4 \rightarrow F08 - 1$, the temperature is monitored at sensor VFx.

In systems without sensor VFx in the DHW circuit (e.g. systems Anl 4.5, 11.0, 12.0, 13.0 and 21.0), the temperature is monitored directly at storage tank sensor SF1. If system deviations still occur after the time set in 'Start' has elapsed, the set point of the heating circuit with the control valve is gradually reduced each minute until the flow temperature set point has

16-208 EB 5578 EN

reached 5 °C at the minimum. How strongly the controller responds is determined by the 'KP' (influence factor).

When 'Start' is set to 0, the priority operation is started regardless of the time and temperature in the system. The control valves of the corresponding heating circuits are closed.

Functions	Default	Configuration
Priority (reverse)	0 2 min 1.0	CO4 -> F08 - 1 Start: 0 to 10 min KP (influence factor): 0.1 to 10.0 Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3
Priority (set-back)	0	CO4 -> F09 - 0

16.3.8.2 Set-back operation

In all systems with DHW heating and at least one heating circuit with a control valve, DHW heating can be given priority by applying set-back operation. With the setting CO4 -> F09 - 1, the temperature is monitored at sensor VFx in the DHW circuit.

In systems without sensor VFx in the DHW circuit (e.g. systems AnI 4.5, 11.0, 12.0, 13.0 and 21.0), the temperature is monitored directly at storage tank sensor SF1. If system deviations still occur after the time set in Start has elapsed, the selected heating circuits with the control valve are set to reduced operation.

When 'Start' is set to 0, the priority operation is started in all heating circuits regardless of the time and temperature in the system.

Functions	Default	Configuration
Priority (reverse)	0	CO4 -> F08 - 0
Priority (set-back)	0 2 min	CO4 -> F09 - 1 Start: 0 to 10 min Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3

16.3.9 Forced charging of DHW storage tank

To provide the full network performance for room heating when the time-of-use of the heating circuits begins, any storage tanks are charged one hour before the time-of-use of the heating circuits starts. For the individual controller, this means that storage tank charging is activated when the water temperature in the storage tank falls below the adjusted deactivation value of T = 'DHW temperature' + 'Hysteresis'.

The forced charging of the storage tank does not take place when the DHW circuit is not used at the beginning of the time-of-use set for the heating circuit(s).

i Note

This function is not available when a storage tank thermostat is used.

16.3.10 Thermal disinfection of DHW storage tank

In all systems with DHW heating, a thermal disinfection is performed on a selected day of the week or daily.

- In systems with DHW storage tank, it is heated up, taking into account the Charging temperature boost parameter (or Set point boost, depending on the system) to the adjusted Disinfection temperature. Disinfection takes place within the adjusted time period ('Time').
- In systems with DHW heating in instantaneous heating system, the function remains active taking into account the Boost parameter until the circulation pipe, measured at storage tank sensor SF1, has reached the adjusted Disinfection temperature, provided disinfection has not been terminated prematurely at the end of the adjusted time period (Time).
- In systems with storage tank charging system, the CO4 -> F24 -1 setting can be used to activate the sensor RüF2 instead of SF1 or SF2 to switch off the thermal disinfection.

The 'Duration' determines how long the disinfection temperature must be maintained within the adjusted time period to rate the process successful. If the Duration is set to a value other than 0, no intermediate heating operation takes place during thermal disinfection.

When the 'Disinfection temperature' has not been reached before the end of the thermal disinfection cycle, it is indicated correspondingly on the display. This error message can also be generated prematurely if the remaining time until the disinfection temperature is reached is shorter than the adjusted 'Duration'. The indication is automatically reset when the disinfection temperature is properly reached during the following thermal disinfection cycle.

Thermal disinfection for preventing legionella infection causes:

- Excessively high return flow temperatures during the disinfection cycle (return flow temperature limitation suspended)
- Excessively high DHW temperatures after thermal disinfection has been concluded
- Possibly lime scale, which can have a negative effect on heat exchanger performance.

16-210 EB 5578 EN

i Note

This function is not available when a storage tank thermostat is used.

The return flow temperature limitation in the primary control circuit is deactivated also while thermal disinfection is active in a secondary controller in controllers linked with each other over a device bus.

i Note

The forced operation of the circulation pump (DHW) starts while thermal disinfection is active.

Functions	Default	Configuration
Storage tank sensor SF1	1	CO4 -> F01 - 1
Thermal disinfection	0 Wednesday 00:00 04:00 70.0 °C 10.0 °C 0 min ON	CO4 -> F14 - 1 Monday, Tuesday,, daily Start: adjustable as required in steps of 15 minutes End: adjustable as required in steps of 15 minutes Disinfection temperature: 60.0 to 90.0 °C Set point boost: 0.0 to 50.0 °C ¹⁾ Duration: 0 to 255 min Active when BI = ON, OFF (start of disinfection with terminal BI17) ²⁾
Bottom sensor for thermal disinfection	0	CO4 -> F24 - 1: only when CO4 -> F14 - 1 Sensor RüF2 as switch-off sensor active

Systems Anl 1.9, 3.9, 5.9, 11.0, 11.3, 11.5, 11.9, 12.0, 12.9, 13.0, 13.9, 17.x, 18.x, 21.0 and 21.9 only

²⁾ B117 only functions when the time is set to 00:00 - 00:00 h

16.4 System-wide functions

16.4.1 Automatic summer/standard time switchover

The time is automatically changed on the last Sunday in March at 2.00 h and on the last Sunday in October at 3.00 h.

Functions	Default	Configuration
Summer time	1	CO5 -> F08 - 1

i Note

The automatic summer/standard time switchover can also be programmed in the Time/date menu (see the 'Setup' section).

16.4.2 Frost protection

Frost protection measures are taken when the outdoor temperature falls below 'Limit'. The switching differential to cancel the frost protection measures is always 1 °C.

Restricted frost protection: frost protection measures are taken only when all heating circuits in the system are in stand-by mode. The circulation pumps are automatically switched on and their flow temperature set points are adjusted to 10 °C. The circulation pump in the DHW circuit is automatically switched on only when the stand-by mode has been adjusted at the rotary switch in all heating circuits. Nevertheless, the storage tank is always recharged to 10 °C if the storage tank temperature falls below 5 °C.

Frost protection with highest priority: the heating circuit circulation pumps are always switched on automatically. The flow temperature set points of all heating circuits currently in stand-by mode are set to +10 °C. In the DHW circuit, the circulation pump is always activated. If the storage tank temperature falls below +5 °C, the storage tank is recharged to +10 °C.

Functions	Default	Configuration
Frost protection		CO5 -> F09 - 0: Restricted frost protection
		CO5 -> F09 - 1: Highest priority for frost protection
	3.0 °C	Limit: -15.0 to +3.0 °C

16-212 EB 5578 EN

i Note

Frost protection operation of a pump, a heating circuit or the DHW circuit is only active when the \Re frost protection icon is displayed.

NOTICE

System damage caused by frost.

In the stand-by mode (\circ) fixed set point control without outdoor temperature sensor does not include frost protection.

→ Do not switch off closed-loop operation for a long time during cold weather.

16.4.3 Forced pump operation

When the heating circuit pumps have not been activated for 24 hours, forced operation of the pumps is started between 12.02 h and 12.03 h. This is done to avoid that the pumps get stuck when they are not operated for long periods of time. In the DHW circuit, the circulation pump is operated between 12.04 h and 12.05 h, the other pumps between 12.05 h and 12.06 h.

16.4.4 Return flow temperature limitation

The temperature difference between the flow and return flow in a network indicates how well the energy is used: the greater the difference, the higher the efficiency. A return flow sensor RÜF is sufficient to evaluate the temperature difference when the flow temperatures are predefined. The return flow temperature can be limited either to a value depending on the outdoor temperature (variable) or to a fixed set point. When the temperature measured at return flow sensor RÜF exceeds the current return flow temperature limit, the set point of the flow temperature (flow temperature of the heating system, charging temperature) is reduced. This causes the primary flow rate to be reduced and the return flow temperature to drop. In systems Anl 2.x, 3.1 to 3.4, 4.1 to 4.4, 5.1, 5.2, 7.x, 8.x and 9.x, the 'Max. return flow temperature' parameter (PA4 level) is used for limitation in the primary circuit during DHW heating if it is greater than the parameter valid for the primary circuit. The KP (limiting factor) determines how strongly the controller responds when the limits are exceeded in either direction (PI algorithm).

If just the proportional component is to be implemented, set CO5 -> F16 - 1. This allows the integral-action component in the return flow temperature limitation algorithm of all control circuits of the controller to be deactivated. The set point reading (flow temperature of the heating, charging temperature) blinks to indicate that a return flow limitation is active in the control circuit concerned.

i Note

When outdoor-temperature-compensated control with gradient characteristic is used, the return flow temperature is limited to a fixed value by equating the 'Base point for return flow temperature' and 'Max. return flow temperature' (PA1, 2, 3, 11, 12, 13 -> P13 and P14) parameters.

Functions	Default	Configuration
Return flow sensor RüF1/2/3		CO1, 2, 3, 4, 11, 12, 13 -> F03 - 1
	1.0	KP (limiting factor): 0.1 to 10.0
Return flow temperature limitation with P algorithm 1)	0	CO5 -> F16

If the controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

Parameters	Default	Parameters: value range
Return flow gradient	1.2	PA1, 2, 3, 11, 12, 13 -> P11: 0.2 to 3.2
Return flow level	0.0 °C	PA1, 2, 3, 11, 12, 13 -> P12: –30.0 to +30.0 $^{\circ}\text{C}$
Base point for return flow temperature:	65.0 °C	PA1, 2, 3, 11, 12, 13 -> P13: 5.0 to 90.0 °C
Max. return flow temperature Max. return flow temperature		PA1, 2, 3, 11, 12, 13 -> P14: 5.0 to 90.0 °C PA4 -> P07: 5.0 to 90.0 °C

or:

Parameters	Default	Parameters: value range
Return flow temperature, points 1 to 4	65.0 °C	PA1, 2, 3, 11, 12, 13 -> P05: 5.0 to 90.0 °C

i Note

To ensure that the preset return flow temperature limit can be met, make sure that the heating characteristic is not adjusted to ascend too steeply, the speed of the circulation pumps is not set too high and the heating systems have been balanced.

16-214 EB 5578 EN

16.4.5 Condensate accumulation control

Activate the **damping** function to start up condensate accumulation plants, in particular to avoid problematic excess temperatures. The controller response to set point deviations which cause the primary valve to open is attenuated. The controller response to set point deviations which cause the control valve to close remains unaffected.

i Note

The condensate accumulation control function can only be activated when the control circuit concerned is controlled using a PI algorithm (three-step control).

Functions	Default	Configuration
Control mode	1	CO1, 2, 3, 4, 11, 12, 13 -> F12 - 1
Damping	0 3.0 °C	CO1, 2, 3, 4, 11, 12, 13 -> F13 - 1 Max. system deviation: 3.0 to 10.0 °C

16.4.6 Three-step control

The flow temperature can be controlled using a PI algorithm. The valve reacts to pulses that the controller sends when a system deviation occurs. The length of the first pulse, in particular, depends on the extent of the system deviation and the selected 'KP (gain)' (the pulse length increases as KP increases). The pulse and pause lengths change continuously until the system deviation has been eliminated. The pause length between the single pulses is greatly influenced by the 'Tn (reset time)' (the pause length increases as TN increases). The 'TY (valve transit time)' specifies the time required by the valve to travel through the range of 0 to 100 %.

Functions	Default	Configuration
Control mode	1	CO1, 2, 3, 4, 11, 12, 13 -> F12 - 1
	2.0 120 s	KP (gain): 0.1 to 50.0 Tn (reset time): 1 to 999 s
	0 s	TV (derivative-action time): do not change the
	35 s	value. TY (valve transit time): 15, 20, 25, , 240 s

16.4.7 On/off control

The flow temperature can be controlled, for example by activating and deactivating a boiler. The controller switches on the boiler when the flow temperature falls below the set point by T = $0.5 \times 10.5 \times$

Functions	Default	Configuration
Control mode	1	CO1, 2, 3, 4, 11, 12, 13 -> F12 - 0
	5.0 °C	Hysteresis: 1.0 to 30.0 °C
	2 min	Min. ON time: 0 to 10 min
	2 min	Min. OFF time: 0 to 10 min

16.4.8 Continuous control in control circuit HC1

The flow temperature in the control circuit HC1 can be controlled using a PID algorithm. The valve in RK1 control circuit receives an analog 0 to 10 V signal from the controller. When a system deviation occurs, 'KP (gain)' immediately causes the 0 to 10 V signal to change (the greater the KP, the greater the change). The integral component becomes effective with time: 'Tn (reset time)' represents the time which elapses until the integral component has changed the output signal to the same extent as the immediate change performed by the proportional component (the greater Tn is, the slower the rate of change will be). Due to the derivative component, any change of the system deviation is incorporated into the output signal with a certain gain (the greater TV is, the stronger the change will be).

Functions	Default	Configuration
Control mode	1	CO1, 2, 3, 11, 12, 13 -> F12 - 1
	2.0	KP (gain): 0.1 to 50.0
	120 s	Tn (reset time): 1 to 999 s
	0 s	TV (derivative-action time): 0 to 999 s
	35 s	TY (valve transit time): 15, 20, 25,, 240 s

16-216 EB 5578 EN

16.4.9 Releasing a control circuit/controller with binary input

The release of an individual control circuit or the controller with the binary input only becomes effective when the respective control circuit is in automatic mode ($^{\odot}$ icon). The released control circuit always works in automatic mode; the deactivated control circuit behaves as if it were transferred to stand-by mode. It remains active, however, in any case for processing an external demand. The control circuit can be released by the binary input when the binary input is either a make contact ('Active when BI' = OFF) or a break contact ('Active when BI' = ON).

i Note

- In systems with downstream heating circuit without a valve (system Anl 2.x, 4.x), B11 only influences the operation of this heating circuit when Release control circuit is configured, while the operation of the entire controller (including the control circuits of the connected TROVIS I/O expansion modules; excluding the processing of external demand) is influenced when Release controller is configured.
- In system Anl 3.0, BI15 influences the operation of the entire controller (except for processing an external demand) when Release control circuit is configured.
- In buffer tank systems Anl 15.x and 16.x, BI15 influences only the operation of the buffer tank charging circuit when Release control circuit is configured.

Functions	Default	Configuration
Enable	0	CO1, 2, 3 -> F14 - 1 1)
Release controller	0	CO5 -> F15 - 1 1)
	ON	1) Active when BI = ON, OFF

16.4.10 Speed control of the charging pump

This function allows the delivery rate of the charging pump in systems with buffer tank (CO1 -> F21 - 1) and in systems with DHW storage tank (CO4 -> F21 - 1) to be varied based on the temperature. When this function is activated, the input SF2 is automatically activated. In combination with CO1 -> F06 - 0 or CO4 -> F02 - 0, this input is only used for speed control and not to stop the storage tank charging. If CO1 -> F26 - 1 or CO4 -> F26 - 1 is also configured, another sensor can be determined for speed control in these function blocks. 'RüF2' is set by default as the function block parameter. Sensors in the selection list that are already assigned to a function and would consequently be used twice as a result are marked by an exclamation mark in front of the sensor designation. The sensor assigned in

F26 - 1 is designated as 'SLP sensor' in the operating level. The outputs AA1 (0 to 10 V) and AA2 (PWM) are available for adapting the delivery rate of the charging pump SLP based on the temperature. The output signal can also be reversed, if required.

All storage tank charging actions start with the minimum delivery rate of the charging pumps. As soon as the charging temperature is nearly reached, the delivery rate of the charging pump is increased and the valve controls the flow rate. If the charging temperature drops 5 °C below its associated set point, the delivery rate is reduced again. At the latest when the temperature at SF2 has reached the 'Start' value to reduce the delivery rate, the linear reduction of the delivery rate based on the temperature at SF2 starts. If the temperature at SF2 reaches the 'Stop' value to reduce the delivery rate, the charging pump runs again at the minimum delivery rate. Following the lag time, the charging pump is finally deactivated when the storage is fully charged.

Functions	Default	Configuration
Speed control of the charging pump	0 40.0 °C 50.0 °C 20 %	CO1 -> F21 - 1 or CO4 -> F21 - 1 Start speed reduction - SF2 limit: 5.0 to 90.0 °C Stop speed reduction - SF2 limit: 5.0 to 90.0 °C Minimum speed: 0 to 50 %
SLP temperature sensor	0 RüF2	CO1 -> F26 - 1 or CO4 -> F26 - 1 Sensor: AF1 to SF3
AA1, AA2 reverse	0 0 %	CO5 -> F25 , F26- 1 Zero: 0 to 50 %
AA1, AA2 PWM	0	CO5 -> F34, F35 - 1 Function: SLP speed

16.4.11 Processing an external demand

The controller can process binary or analog requests for an externally required signal by a more complex secondary system. A binary request can only be processed when the input SF3 or FG3 is not assigned. Processing of external demand by device bus can also be configured.

i Note

Overheating may occur in the heating circuits of the primary controller without control valve.

16-218 EB 5578 EN

Excessive charging temperatures in DHW circuits without control valve controlled by the primary controller are excluded when the default settings of the controller are used: while storage tank charging is active, no flow temperature higher than the charging temperature is used by the primary controller. If the **Priority for external demand** function is activated, the external demand is also processed during storage tank charging. The heating circuits can be configured in such a way that they only process external demand. The possible settings for each heating circuit do not apply with this configuration as only the external demand is processed with associated UP as feeder pump.

Functions	Default	Configuration
Priority for external demand	0	CO4 -> F16 - 1
Demand only	0 0 0	CO1 -> F24 - 1 CO2 -> F24 - 1 CO3 -> F24 - 1

Binary demand processing

Regardless of the operating mode set for control circuit, except for manual mode, the controller regulates the flow temperature in the heating circuit concerned when either the binary input (terminals 17/18) is a make contact ('Active when BI' = OFF) or a break contact ('Active when BI' = ON) in control circuit HC1 to at least the adjusted flow temperature adjusted in PA1 -> P10 ('Minimum flow temperature set point HC for binary demand processing').

Functions	Default	Configuration
Demand processing, 0 to 10 V	0	CO1, 2, 3 -> F16 - 0
Binary demand processing	0 ON	CO1 -> F17 - 1 Active when BI = ON, OFF
Parameters	Default	Parameters: value range
Minimum flow temperature set point HC for binary demand processing	40.0 °C	PA1 -> P10: 5.0 to 150.0 °C

Demand processing, 0 to 10 V

Regardless of the operating mode set for the control circuit affected (except for manual mode), the controller regulates the flow temperature at least to the temperature corresponding with the 0 to 10 V signal at the 0 to 10 V input.

Functions	Default	Configuration
Demand processing, 0 to 10 V	0	CO1, 2, 3 -> F16 - 1
AE Zero shift	0	CO5 -> F31 - 0
	0 °C	Lower transmission range: 0 to 150 $^{\circ}\text{C}$
	120 °C	Upper transmission range: 0 to 150 °C
	0	CO5 -> F31 - 1
	5 %	Zero: 5 to 20 %
	0 °C	Lower transmission range: 0 to 150 $^{\circ}\text{C}$
	120 °C	Upper transmission range: 0 to 150 °C
Binary demand processing	0	CO1 -> F17 - 0
Parameters	Default	Parameter level: value range
Set point boost (primary exchanger control)	5 °C	PA1, 2, 3: 0 to 50 °C

16.4.12 External demand using a 0 to 10 V signal

The controller can request a demand for the maximum flow set point (with boost, if need be) by issuing an analog signal for external demand. For this purpose, the 0 to 10 V output is used.

Analog, binary signals or requests processed over the device bus are integrated into the analog request for an external demand.

Functions	Default	Configuration
External demand	0 0.0 °C 120.0 °C 0.0 °C	CO1 -> F18 - 1 Lower transmission range: 0.0 to 150.0 °C Upper transmission range: 0.0 to 150.0 °C Boost: 0.0 to 30.0 °C
AA1 PWM	0	CO5 -> F34 - 0 Function: external demand

16-220 EB 5578 EN

16.4.13 Capacity limitation in RK1

The capacity can be limited based on a pulse signal to 800 pulse/h at terminals 17/18. This only applies to systems which do not use input SF3/FG3. Three different operating situations exist:

- A system with simultaneous room and DHW heating requires maximum energy.
- A system with a fully charged storage tank that is only used for room heating requires less energy.
- A system that suspends room heating during DHW heating requires less energy.

As a result, three different maximum limit values can be adjusted:

- Max. limit value to determine the absolute upper limit
- 'Max. limit (heating)' to operate room heating only
- Max. limit (DHW) to operate DHW heating only

In all systems without DHW heating or without heating circuit, only the Max. limit value for the capacity can be specified. If the 'Max. limit' or 'Max. limit (heating)' parameter is set to 'OT', a four-point characteristic configured in CO1 -> F11 - 1 allows the input of four capacity limits for outdoor-temperature-compensated capacity limitation in addition to the outdoor, flow and return flow temperature values.

All limits are adjusted as pulses per hour (pulses/h). As the reading for the current pulse rate P in pulse/h (-> extended operating level, key number 1999) is calculated based on the time interval between incoming pulses, the controller naturally cannot react immediately to every sudden capacity change in the system.

The flow set point of the control circuit RK1 is reduced when the pulse rate reaches the currently valid maximum limit. The Limiting factor determines how strongly the controller responds.

Example to determine the limit:

If a capacity of 30 kW is to be limited, the following limit must be set in a heat meter, which issues one pulse per kilowatt hour:

$$P = \frac{30 \text{ kW}}{1 \text{ kWh/}} = 30 \text{ pulses/h}$$
pulse

i Note

If the controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

Functions	Default	Configuration
Capacity limitation in RK1 1)	0 15 puls- es/h 15 puls- es/h 15 puls- es/h 1.0	CO5 -> F10 - 1 Maximum limit: OT to 800 m³/h Max. limit (heating) ²⁾ : OT to 800 pulses/h Max. limit (DHW) ²⁾ : 1 to 800 pulses/h Limiting factor: 0.1 to 10.0
Capacity limitation in RK1 by meter bus	0	CO6 -> F12 - 0

¹⁾ Not in system Anl 1.9

16.4.14 Creep feed rate limitation with a binary input

It is possible to report to the controller when the creep feed rate has fallen below a certain level by using a limit switch of the primary valve connected at the input BI13 or to RüF1. Either the open ('Active when BI =' Off) or closed binary input BI13 ('Active when BI =' ON) can be configured to indicate that the creep feed rate has fallen below a certain level. Only the closed binary input at RüF1 can be processed. Shortly after the alert, the controller closes the valve RK1. As soon as the flow temperature falls below the set point by more than 5 °C after the valve has been closed, control operation is started again.

Functions	Default	Configuration
Creep feed rate limitation 1)	0 Binary ON	CO5 -> F12 - 1 Switching mode: Binary (terminals 13/19), analog (RüF1) Active when BI = ON, OFF
1) Not in system Anl 1.9		

16.4.15 Device bus

The device bus allows the connection of up to 32 participants (Series 55xx Controllers). Terminals 29/30 is used in the TROVIS 5578 Controller for this purpose. No attention must be paid to the polarity of the device bus wiring.

Activate the device bus and specify a valid device bus address between 1 and 32 for each device. Note that the device bus address 1 is to be set for just one controller in the system and that all device bus addresses must be unique. The controller with device bus address 1 implements the required bus bias voltage for the system. Once the controllers have been con-

16-222 EB 5578 EN

²⁾ Not in systems Anl 1.0, 1.5-1.8, 3.0, 3.5, 3.9, 4.0, 5.9, 7.x, 10.x, 11.x, 12.x, 13.x, 14.x, 15.x, 16.x, 17.x, 18.x, 21.x and 25.x

nected and set accordingly, additional functions can be configured. These partly application-specific functions include:

- Requesting and processing an external demand (see section 16.4.15.1)
- Sending and receiving outdoor temperatures (see section 16.4.15.2)
- Synchronizing the clock (see section 16.4.15.3)
- Priority over all controllers (see section 16.4.15.4)
- Display error messages issued by the device bus (see section 16.4.15.5)

16.4.15.1 Requesting and processing an external demand

In general, the controller which controls the primary valve or boiler (= primary controller) in a system of linked controllers will process the demand of all subsequent controllers (= secondary controllers). As a result, the primary controller must be configured to receive this demand. Usually, the secondary controllers are configured such that they send their maximum flow set point to the primary controller.

In special cases, however, it might happen that only the set point of one control circuit is to be sent. The appropriate function blocks to do so are also available for selection. After the selected function blocks have been activated, you must specify a register number. The following applies: in a system of linked controllers which are hydraulically supplied by a primary controller, all controllers (primary and secondary controllers) must have the same register number setting for the 'Demand register'.

A controller which is configured to receive a demand in register no. 5 will not process a demand sent to register no. 6. The primary controller compares the received requested demands and its own requested demand and supplies the system with the required flow temperature (if necessary, increased by the 'Set point boost (pre-control circuit)'.



Overheating may occur in the heating circuits of the primary controller without control valve.

Primary controller:

Functions	Default	Configuration
Device bus	0	CO7 -> F01 - 1, device bus address
Receive external demand in RK1	0	CO7 -> F15 - 1 1)
Receive external demand in RK2	0	CO7 -> F17 - 1 1)
Receive external demand in RK3	0	CO7 -> F18 - 1 1)

Functions	Default	Configuration
Demand only	0	CO1 -> F24 - 1
•	0	CO2 -> F24 - 1
	0	CO3 -> F24 - 1
	5	1) Register number/5 to 64
Parameters	Default	Parameters: value range
Set point boost (pre-control circuit)	5.0 °C	PA1, 2, 3 -> P15: 0.0 to 50.0 °C

Secondary controller:

Functions	Default	Configuration
Device bus	0	CO7 -> F01 - 1, device bus address
Send demand RK1	0	CO7 -> F10 - 1 1)
Send demand RK2	0	CO7 -> F11 - 1 1)
Send demand RK3	0	CO7 -> F12 - 1 1)
Send demand DHW	0	CO7 -> F13 - 1 1)
Send max. demand	0	CO7 -> F14 - 1 1)
	5	1) Register number/5 to 64

i Note

The register number specifies the location where the flow set points are saved in the primary controller. As a result, the register number set in the secondary controller in CO7 -> F10 to F14 must be the same as the register number set in CO7 -> F15 in the primary controller.

Excessive charging temperatures in DHW circuits without control valve controlled by the primary controller are excluded when the default settings of the controller are used: while storage tank charging is active, no flow temperature higher than the charging temperature is used by the primary controller. Nevertheless, if the **Priority for external demand** function is activated, the external demand is also processed during storage tank charging.

Functions	Default	Configuration
Priority for external demand	0	CO4 -> F16 - 1

16-224 EB 5578 EN

16.4.15.2 Sending and receiving outdoor temperatures

Controllers equipped with one (two) outdoor sensor(s) can be configured to supply other controllers with the measured outdoor temperature(s) over the device bus. This enables outdoor-temperature-compensated control even in systems which do not have their own outdoor sensor.

Functions	Default	Configuration
Device bus	0	CO7 -> F01 - 1, device bus address
Send AF1	0	CO7 -> F06 - 1 1)
Receive AF1	0	CO7 -> F07 - 1 1)
Send AF2	0	CO7 -> F08 - 1 ²⁾
Receive AF2	0	CO7 -> F09 - 1 ²⁾
	1	1) Register number/1 to 4
	2	2) Register number/1 to 4

i Note

The register number for the outdoor temperature AF1 or AF2 must be the same for the sending and the receiving controller.

16.4.15.3 Synchronizing the clock

One controller in a system of linked controllers should perform the 'Clock synchronization' function. This controller sends its system time once every 24 hours to all other controllers over the device bus.

Regardless of this function, the system time of all controllers is adapted immediately when the time setting of one controller is changed.

Functions	Default	Configuration
Device bus	0	CO7 -> F01 - 1, device bus address
Clock synchronization	0	CO7 -> F02 - 1

16.4.15.4 Priority over all controllers

When controllers are linked with each other over a device bus, the heating circuits of other controllers can be shut down while DHW heating is active. It is also possible to configure the return flow temperature limitation in the primary circuit so that it is raised to the value adjusted for the maximum return flow temperature (or for point 1 of the return flow temperature in a four-point characteristic). Controllers configured to trigger this function must generate the 'DHW heating active' message. 'Receive release RK_' must be configured for the heating circuits concerned in the controllers whose heating circuit(s) are to be shut down when this DHW heating is active. The same register number must be specified if only one DHW circuit is to affect one or more heating circuits. If several DHW circuits exist in the system, it is possible to select the heating circuits that are only to react to one or other active DHW heating by assigning different register numbers. If a secondary heating circuit with valve is to be shut down, the valve of this circuit is closed while its circulation pump remains activated. If a secondary heating circuit without valve is to shut down, just its circulation pump and not the primary circuit (RK1) is shut down, for example in systems Anl 2.x by configuring 'Receive release RK1'

Functions	Default	Configuration
Device bus	0	CO7 -> F01 - 1, device bus address
Send 'DHW heating active'	0	CO7 -> F20 - 1 1)
Receive release RK1	0	CO7 -> F21 - 1 1)
Receive release RK2	0	CO7 -> F22 - 1 1)
Receive release RK3	0	CO7 -> F23 - 1 1)
	32	1) Register number/5 to 64

16.4.15.5 Display error messages issued by the device bus

The setting CO7 -> F16 - 1 causes the controller to react to the error messages from the device bus by generating the 'External err' error message as long as the faults of the other device bus participants exist.

Functions	Default	Configuration
Receive errors	0	CO7 -> F16 - 1

16-226 EB 5578 EN

16.4.16 Activating TROVIS I/O expansion modules

The function blocks F31 to F33 allows one additional heating circuit to be added to a system. One TROVIS I/O expansion module is required per heating circuit. The CO7 -> F31 - 1 setting activates the expansion module for heating circuit 11, CO7 -> F32 - 1 activates the expansion module for heating circuit 12 and CO7 -> F33 activates the expansion module for heating circuit 13 as well as all the associated levels and settings in the controller. Depending on which kind of communication is used, the additionally configured heating circuit works either in the primary circuit, i.e. parallel to the control circuit 1 of the configured main system, or linked to the control circuit 1 (HC1) of the configured main system. As a result, two new plant schemes can be configured per TROVIS I/O module for each main system. Heating circuits connected to HC1 automatically send their flow temperature demand to HC1.

Functions	Default	Configuration
Ext-HC11	0 11 To HC1	CO7 -> F31 - 1: TROVIS I/O for heating circuit 11 active Device bus address: 11 to 19 Connected/primary circuit, to HC1
Ext-HC12	0 12 To HC1	CO7 -> F32 - 1: TROVIS I/O for heating circuit 12 active Device bus address: 11 to 19 Connected/primary circuit, to HC1
Ext-HC13	0 13 To HC1	CO7 -> F33 - 1: TROVIS I/O for heating circuit 13 active Device bus address: 11 to 19 Connected/primary circuit, to HC1

i Note

The default setting for the device bus address (33) must be changed in CO7 -> F01 - 1 when an extension module is used (see section 16.4.15).

16.4.17 Connecting potentiometers for valve position input

The FG1 to FG3 inputs can be used to connect potentiometers, for example to input valve positions when a resistance room sensor is not configured in the control circuit concerned. The use of TROVIS 5570 Room Panel is possible. The measured values (in the measuring ranges from 0 to 2000 Ω) are displayed as measured value 13 (FG1), 14 (FG2) and 15 (FG3). They are also available as Modbus data points.

Functions	Default	Configuration
Room sensor RF1, 2, 3		CO1, 2, 3 -> F01 - 0
		Exceptions:
		CO1 ->F01 - 1 and CO7 ->F03 - 1
		CO2 ->F01 - 1 and CO7 ->F04 - 1
	0	CO3 ->F01 - 1 and CO7 ->F05 - 1

16.4.18 Locking manual level

To protect the heating system, this function can be used to lock the manual level. When this function has been activated, automatic mode is started when the rotary switch is set to in automatic mode.

Functions	Default	Configuration
Lock manual level	0	CO5 -> F21 - 1

16.4.19 Locking the rotary switch

When this function has been activated, the controller remains in automatic mode regardless of the rotary switch position. The rotary switch can no longer be used to adjust the controller settings. It is still possible to enter the key number.

Functions	Default	Configuration
Lock rotary switch	0	CO5 -> F22 - 1

16.4.20 Feeder pump operation

In system Anl 3.0, 5.0, 7.x, 9.1, 9.2, 12.x, 15.1, 16.1, 16.5, 16.7 and 16.8, the feeder pump UP1 only starts to operate in the default setting when a flow temperature demand of a secondary controller exists. If CO5 -> F14 - 1 is configured, this is also the case when the controller's own secondary circuit requires heat.

16-228 EB 5578 EN

Functions	Default	Configuration
Operation UP1	0	CO5 -> F14 - 1

16.4.21 Speed control of the circulation pump (DHW)

The delivery rate of the circulation pump (DHW) can be controlled based on the circulation return flow temperature. The CO4 -> F25 - 1 setting makes the outputs AA1 (0 to 10 V) and AA2 (PWM) available to issue the speed signal. The output signal can also be reversed, if required. The input $R\ddot{\nu}F4/AF2$ is used to measure the circulation return flow temperature.

Functions	Default	Configuration
Speed control of circulation pump (DHV	V) 0	CO4 -> F25 - 1
Return flow temperature of circulation pump (DHW) Target	55 °C	5 to 90 °C
KP (gain)	1.0	0.1 to 50
Tn (reset time)	300 s	30 to 2000 s
Minimum speed	10 %	5 to 50 %
AA1, AA2 reverse	0	CO5 -> F25, F26 - 1 Zero: 0 to 50 %
AA1, AA2 PWM	0	CO5 -> F34, F35 - 1 Function: ZP speed

16.4.22 External demand for heat due to insufficient heat supply

An external heat source can be demanded using the 0 to 10 V output. The function block for a request for external demand CO1 -> F18 - 1 is automatically set. The function block parameters allow the transmission range to be determined. When a system deviation in RK1 greater than 10 °C lasts longer than 30 minutes, a voltage signal corresponding to the actual demand is issued. At the same time, the RK1 valve is forced to close. After 30 minutes, the external demand for heat is canceled and the control signal output in RK1 is enabled again.

Functions	Default	Configuration
Demand for external heat	0	CO1 -> F20 - 1
External demand	0 0.0 °C 120.0 °C 0.0 °C	CO1 -> F18 - 1 Lower transmission range: 0.0 to 150.0 °C Upper transmission range: 0.0 to 150.0 °C Boost: 0.0 to 30.0 °C
AA1 PWM	0	CO5 -> F34 - 0 Function: external demand

16.5 Communication

16.5.1 RS-485 communication module

When looking onto the controller front, the connection for the optional communication module RS-485 (order no. 8812-2002) is located on the left side of the controller housing (RJ-45 port). The bus line links the control units/devices in an open ring. At the end of the bus line, the data cable is connected to the control station using an RS-485/RS-232 converter (e.g. CoRe02, see Data Sheet \blacktriangleright T 5409).

The maximum range of the bus connection (cable length) is 1200 meters. For greater distances, repeaters (e.g. CoRe02) must be used to regenerate the signal level. A maximum of 246 devices with 8-bit addressing can be connected to a bus. If no communication is established between the control system and controller, the time of access by the control system can be restricted to dynamic process by the **monitoring** function. The controller resets the monitoring function, provided the valid Modbus requests are registered. However, in case of an error, all level bits are initialized back to "autonomous" after 30 minutes have elapsed.

NOTICE

Risk of fatal injury due to electric shock.

→ Upon installation, observe the relevant standards and regulations governing lightning and overvoltage protection.

Functions	Default	Configuration
Modbus	1	CO6 -> F01 - 1
16-bit address	0	CO6 -> F02
Monitoring	0	CO6 -> F07
Parameters	Default	Parameters: value range
Modbus station address (8 bit)	255	PA6 -> P01: 1 to 246 with CO6 -> F02 - 1: 1 to 32000

Communication parameter settings

Modbus station address (8 bit)
 This address is used to identify the controller in bus or modem mode. In a system, each controller needs to be assigned a unique address.

16-230 EB 5578 EN

16.5.2 Meter bus

The TROVIS 5578 Controller is fitted with an M-Bus interface for max. three M-Bus units. For systems with three control circuits, a flow rate and/or capacity limitation can be be configured in every control circuit based on the measured data of the heat meters HM 1 to HM 3.

i Note

Details on the use of the different heat or water meters can be found in the technical documentation TV-SK 4000179038.

16.5.2.1 Activating the meter bus

To successfully transfer data from the heat meter, the heat meter must use a standardized protocol in accordance with EN 1434-3. It is not possible to make a general statement about which specific data can be accessed in each meter. For details on the different meter makes refer to the technical documentation TV-SK 6311. All necessary function block parameters to set up the communication with heat meters are available in CO6 -> F10. The meter bus address, model code and reading mode must be specified for the heat meters HM 1 to HM 3. A meter bus address must be unique and correspond with the address set in the heat meter. If the preset meter bus address is unknown, a single heat meter connected to the controller can be assigned the meter bus address 254. The address 255 deactivates the communication with the respective heat meter. The model code to be set for the heat meter can be found in TV-SK 4000179038. In general, the default setting of 1434 can be used for most devices. The meters can be read either automatically every 24 hours (approx.), continuously or when the coils (= Modbus data points) assigned to the heat meters 1 to 3 are overwritten with the value 1 over the system bus interface.

Meter

Z1 (Adr. 154) Connected Z2 (Adr. 255) Deactivated Z3 (Adr. 255) Deactivated The additional "meter" page is displayed with connection status for meters 1 to 3 in the "extended operating level" mode when the meter bus is activated. When 'Connected' status is displayed, the following data for each meter can be read by pressing the rotary pushbutton:

Meter 1	p.1/2
Flow rate	0.00 l/h
Volume	2213.0 m³
Capacity	0.00 kW
Energy	0.90 MWh
Flow	76.39 ℃

Flow rate

Volume

CapacityEnergy

– Linergy – Flow temperature (Flow)

 Meter 1
 p.2/2

 Return flow
 37.48 °C

 ID no.
 1154

 Address
 154

Return flow temperature (Return flow)

Meter ID (ID no.)

- Meter bus address (Address, sent by meter)

Functions	Default	Configuration
Meter bus	0	CO6 -> F10 - 1
	255	HM 13 address: 0 to 255
	1434	HM13 model: 1434, Multical3, Apator, SLS/WSF
	Continuou	s HM13 mode: 24 h, Continuous, Coil
	Tar-A	Tariff: Tar-A, Tar-E (tariff schedule ON, OFF; only for HM1 with '1434' and 'Continuous' settings) Tar-E: the consumption data are assigned to a high tariff or a low tariff depending on the time schedule programmed in the customer level. Three time periods can be entered per day of the week (not vacations or public holidays): 1–7 daily, 1 = Monday, 2 = Tuesday,, 7 = Sunday

16.5.2.2 Flow rate and/or capacity limitation with meter bus

The refreshing rate of the measured variable (flow rate and/or capacity) must be less than fives seconds to ensure that the limitation can be performed properly. The technical documentation TV-SK 6311 lists the heat meters which comply with this criterion and, therefore can be used for limitation. Note that some makes, particularly battery-operated heat meters, respond with communication pauses when they are read too frequently. Others might run out of energy early. For details refer to the above mentioned TV-SK document.

- A system with simultaneous room and DHW heating requires maximum energy.

16-232 EB 5578 EN

- A system with a fully charged storage tank that is only used for room heating requires less energy.
- A system that suspends room heating during DHW heating requires less energy.

As a result, three different maximum limit values for RK1 can be adjusted in all systems with only one control valve and DHW heating on the secondary side:

- Max. limit value to determine the absolute upper limit
- Max. limit value for heating to operate room heating only
- Max. limit value for DHW to operate DHW heating only

If the 'Max. limit' or 'Max. limit (heating)' parameter for HC1 is set to 'OT', a four-point characteristic configured in CO1 -> F11 - 1 allows the input of four flow rate or capacity limits for outdoor-temperature-compensated flow rate or capacity limitation in addition to the outdoor, flow and return flow temperature values.

In all systems with two or three control valves, separate maximum limits can be adjusted for the flow rate and capacity.

Flow limitation

All necessary function block parameters to set up the flow rate limitation are available in CO6 -> F11 or CO6 -> F13 and CO6 -> F15 for the second and third control circuit. One after the other, the system's max. limit or max. limit for heating and the max. limit for DHW for systems with only one primary control valve and secondary DHW heating have to be set. The 'Limiting factor' determines how strongly the controller responds when the limit values are exceeded in either direction.

When the flow rate limitation is activated, the respective measuring and limit values are displayed in the extended operating level after confirming the plant scheme.

i Note

If the controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

Functions	Default	Configuration	
Meter bus	0	CO6 -> F10 - 1	
	255	HM 13 address: 0 to 255	
	1434	1434 HM 13 model: 1434, CAL3, APA+O, SLS	
	Continuou	Continuous HM13 mode: 24 h, Continuous, CoiL	

Functions	Default	Configuration
Flow rate limitation in RK1	0	CO6 -> F11 - 1
	1.5 m³/h	Max. limit: OT to 650 m³/h
	1.5 m³/h	Max. limit (heating): OT to 650 m³/h
	1.5 m³/h	Max. limit (DHW): 0.01 to 650 m ³ /h
	1.0	Limiting factor: 0.1 to 10.0
Flow rate limitation in RK2	0	CO6 -> F13 - 1
	1.5	Max. limit: 0.01 to 650 m ³ /h
	1.0	Limiting factor: 0.1 to 10.0
Flow rate limitation in RK3	0	CO6 -> F15- 1
	1.5	Max. limit: 0.01 to 650 m ³ /h
	1.0	Limiting factor: 0.1 to 10.0

Capacity limitation

All necessary function block parameters to set up the capacity limitation are available in CO6 -> F12, CO6 -> F14 and CO6 -> F16 for the second and third control circuit. One after the other, the system's max. limit or max. limit for heating and the max. limit for DHW for systems with only one primary control valve and secondary DHW heating have to be set. The 'Limiting factor' determines how strongly the controller responds when the limit values are exceeded in either direction.

When the capacity limitation is activated, the respective measuring and limit values are displayed in the extended operating level after confirming the plant scheme.

i Note

If the controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

Functions	Default	Configuration
Meter bus	0	
	255	CO6 -> F10 - 1 HM 13 address: 0 to 255
	1434	HM 13 model: 1434, CAL3, APAtO, SLS
	24h	HM13 mode: 24 h, Continuous, CoiL

16-234 EB 5578 EN

Functions	Default	Configuration
Capacity limitation in RK1	0 1.5 kW 1.5 kW 1.5 kW	CO6 -> F12 - 1 Max. limit: OT to 6500 kW Max. limit (heating): OT to 6500 kW Max. limit (DHW): 0.1 to 6500 kW Limiting factor: 0.1 to 10.0
Capacity limitation in RK2	0 1.5 kW 1.0	CO6 -> F14 - 1 Max. limit: 0.1 to 6500 kW Limiting factor: 0.1 to 10.0
Capacity limitation in RK3	0 1.5 kW 1.0	CO6 -> F16 - 1 Max. limit: 0.1 to 6500 kW Limiting factor: 0.1 to 10.0

16.5.3 Return flow temperature limitation based on capacity

A capacity limit can be determined for control circuit based on the measured capacity value of the heat meter 1 (HM1). The return flow temperature in control circuit 1 is limited according the settings entered in PA1 as long as the measured capacity value is below the determined capacity limit. When the measured capacity value exceeds the capacity limit, a return flow temperature limit adjustable separately for control circuit 1 takes effect.

Functions	Default	Configuration
RK1	0	CO6 -> F17 - 1: new maximum return flow limit at a ca-
Return flow temperature limita-		pacity higher than the max. limit
tion based on capacity		(only when CO6 -> F10 - 1 and activated HM1)
	1.5 kW	Max. limit: 0.1 to 6500 kW
	55 °C	Max. return flow temperature: 5.0 to 90.0 °C

16.5.4 Memory module/mini module

The use of a memory module (order no. 1400-9379) or mini module (order no. 1400-7436) is particularly useful to transfer all data from one TROVIS 5578 Controller to several other TROVIS 5578 Controllers.


i Note

In contrast to the memory module, the mini module is not suitable for transferring the programmed vacations to the individual control circuits or a data logging configuration programmed in TROVIS-VIEW.

Memory module Save settings Load settings

The memory module/mini module is plugged into the RJ-45 connector socket located at the side of the controller. Once the module has been connected, 'Save settings' appears on the controller display. If the memory module already contains data from a different TROVIS 5578 Controller, turn the rotary pushbutton until 'Load settings' is displayed.

- Pressing the rotary pushbutton to confirm 'Save settings' causes the controller settings to be transferred to the memory module/mini module.
- Pressing the rotary pushbutton to confirm 'Load settings' causes the controller settings to be transferred from the memory module/mini module.



During data transfer, the zeros and ones run across the display. When the transfer was successful, 'OK' is displayed. After that, the connection between controller and memory module can be terminated.

Memory	module
OK	•


16-236 EB 5578 EN

Using TROVIS-VIEW (order no. 6661-1014), it is possible to configure all controller settings on a convenient user interface at the computer and to document these settings.

16.5.5 Data logging


A data logging module (order no. 1400-9378) saves the following controller data every two minutes:


- Temperatures measured by the sensors
- Control signals in %
- Switching states of the pump outputs



The data logging module is plugged into the RJ-45 connector socket located at the side of the controller. Once the module has been connected, 'Start data logging' and 'Copy logging data' appear on the controller display.

- Pressing the rotary pushbutton to confirm 'Start data logging' causes the above listed operating values to be saved cyclically to the inserted data logging module.
 The controller display returns to the reading indicated when the data logging module was connected.
- Pressing the rotary pushbutton to confirm 'Copy logging data' causes already logged data to be transferred from the memory controller to the data logging module. During data transfer, the zeros and ones run across the display. When the transfer was successful, 'OK' is displayed. After that, the connection between controller and data logging module can be terminated.





i Note

- The controller starts to write over the oldest data as soon the memory of the data logging module is full after approximately eight days. The current memory capacity of the data logging module can be read in the extended operating level under 'Logging memory' as the second value in the sequence (range of values: 0 to 6035). Directly after inserting the data logging module, data can be first read after the first scanning cycle has been performed.
- The oldest data in the internal memory of the controller are overwritten after approx. 14 days. The cycle time is one minute.

The data log viewer software allows the data to be viewed in graph format. The USB converter 3 (order no. 1400-9377) is required to connect the data logging module to a computer. The data log viewer software is supplied together with the USB converter 3.

16-238 EB 5578 EN

16.6 Function block lists

CO1: RK1 · Heating circuit 1 (not system Anl 1.9) 1)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Room sensor	0	Not systems Anl 1.5– 1.8, 3.x, 5.x, 7.x, 9.x, 12.x, 14.x, 15.x, 16.x, 17.x, 18.x	CO1 -> F01 - 1: Room sensor RF1, temperature reading and FG1 input for Types 5244, 5257-5 and 5257-51 Room Panels active
02	Outdoor sensor	0	1.5–1.8, 3.5, 7.x, 10.5, 25.5	CO1 -> F02 - 1: Outdoor sensor AF1, outdoor-temperature-compensated control active
		1	1.0–1.3, 2.x, 3.0–3.4, 3.9, 4.x–9.x, 10.0–10.3, 11.x–16.x, 17.x, 18.x, 21.x, 25.0	
03	Return flow sensor	0	1.1–1.4, 10.1–10.3, 21.1	CO1 -> F03 - 1: Return flow sensor RüF1; limitation function active Function block parameters:
		1	1.0, 1.5, 1.6– 1.8, 2.x–9.x, 10.0, 10.5, 11.x– 16.x, 17.x, 18.x, 21.0, 21.2, 21.9, 25.x	
04	Cooling control	0	Not systems Anl 1.9, 3.9, 5.9, 16.x, 17.x, 18.x	CO1 -> F04 - 1: Cooling control, only with CO1 -> F11 - 1 The cooling control function causes a reversal of the operating direction and a minimum limitation of the return flow temperature in RK1.

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
05	Underfloor heating	0	Not systems Anl 1.5–1.8, 3.x, 5.0–5.2, 7.x, 9.x, 12.x, 14.x, 15.x, 16.x, 17.x, 18.x	CO1 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters:
06	Storage tank sensor SF2	1	Systems Anl 3.9, 5.9, 16.x, 17.x, 18.x only	CO1 -> F06 - 1: Activate SF2 to switch off charging of the buffer tank
07	Optimization	0	Not systems Anl 1.5–1.8,	CO1 -> F07 - 1: Optimization of heating times (only when CO1 > F01 - 1 and CO1 -> F02 - 1)
08	Adaptation	0	3.x, 5.x, 7.x, 9.x, 12.x, 14.x, 15.x, 16.x, 17.x, 18.x	CO1 -> F08 - 1: Heating characteristic adaptation (only when CO1 -> F01 - 1, CO1 -> F02 - 1 and CO1 -> F11 - 0)
09	Flash adaptation	0		CO1 -> F09 - 1: Flash adaptation of flow temperature (only when CO1 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0)
11	Four-point characteristic	0	Not Anl 1.5–1.8, 7.x	CO1 -> F11 - 1: Four-point characteristic (only when CO1 -> F08 - 0) CO1 -> F11 - 0: Gradient characteristic
12	Three-step control mode	1	All 1)	CO1 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25,, 240 s (35 s) CO1 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min)

16-240 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
13	Damping	0	All 1)	CO1 -> F13 - 1: OPEN signal damping (only when CO1 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C)
14	Release	0	All 1)	CO1 -> F14 - 1: Release RK1 at BI15; FG1 has no function Function block parameters: Active when BI = ON, OFF (ON)
16	Demand processing, 0 to 10 V Input Terminals 19/23	0	All 1)	CO1 -> F16 - 1: Demand processing, 0 to 10 V
17	Binary demand processing	0	Not for sys- tems with SF3	CO1 -> F17 - 1: Binary demand processing at input terminals 17/18 Function block parameters: Active when BI = OFF, ON (ON)
18	External demand	0	All 1)	CO1 -> F18 - 1: External demand 0 to 10 V The standardized signal output (terminals 20/21) is not available anymore as a control output. The maximum flow set point (with boost, if applicable) is demanded as a 0 to 10 V signal at the standardized signal output. Function block parameters: Lower transmission range: 0.0 to 150.0 °C (0.0 °C) Upper transmission range: 0.0 to 150.0 °C (120.0 °C) Boost: 0.0 to 30.0 °C (0.0 °C)
20	Demand for external heat	0	All 1)	CO1 -> F20 - 1: External demand for heat due to insufficient heat supply
21	Speed control of the charging pump	0	Systems Anl 3.9, 5.9, 16.x, 17.x, 18.x only	CO1 -> F21 - 1: Temperature-based adaptation of the delivery rate of the charging pump The output is determined in the CO5 -> F34 or F35 setting with the 'SLP speed' function. Function block parameters: Start speed reduction, limit: 5.0 to 90.0 °C (40.0 °C) Stop speed reduction, limit: 5.0 to 90.0 °C (50.0 °C) Minimum speed: 0 to 50 % (20 %)
22	SLP depending on return flow temperature	0	Systems Anl 3.9, 5.9, 16.x, 17.x, 18.x only	CO1 -> F22 - 1: Storage tank charging pump not ON unless return flow hot

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
23	Differential temperature control	0	System Anl 1.0, 16.0 only	CO1 -> F23 - 1: Activation of differential temperature control The output is determined in the CO5 -> F34 or F35 setting with the 'Differential temperature control' function. Function block parameters: Set point of differential temperature control: 0.0 to 50.0 °C (20.0 °C) KP (influence factor): 0.1 to 10.0 (1.0) Minimum speed: 0 to 100 % (20 %)
24	Demand only	0	All 1)	CO1 -> F24 - 1: RK1 works as a feeder circuit. RK1 only processes external demand for heating; UP1 runs depending on demand.
25	Buffer tank bottom sensor	0	3.9,5.9, 16.x, 17.x, 18.x	CO1 -> F25 - 1: Buffer tank bottom sensor SF3 active Function block parameters: Temperature limit: 0.0 to 50.0 °C (10 °C)
26	SLP temperature sensor	0	3.9, 5.9, 16.x, 17.x, 18.x	CO1 -> F26 - 1: Different sensor for the speed control of the charging pump Function block parameters: Sensor: AF1 to SF3 (RüF2)
27	Discharging protection	0	3.9, 5.9, 15.4, 15.5, 16.x, 17.x, 18.x	CO1 -> F27 - 1: discharging protection active
28	Variable night set-back	0	Not systems Anl 1.5, 1.6, 1.7, 1.8, 3.x, 5.x, 7.x, 9.1, 9.2, 10.5, 12.x, 14.x, 15.x, 16.x, 17.x, 18.x, 25.5	CO1 -> F28 - 1: variable night set-back (only when CO1 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to 20.0 °C (5.0 °C) OTL day 0 %: -50.0 to 5.0 °C (-15.0 °C)

F Function block number, WE Default setting, Anl System code number

16-242 EB 5578 EN

CO2: RK2 · Heating circuit 2 (systems Anl 3.1–3.4, 3.9, 4.x, 5.x, 6.0, 10.x, 16.1, 16.6, 16.8, 17.x, 18.x, 25.0, 25.5)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Room sensor	0	All 1)	CO2 -> F01 - 1: Room sensor RF2, temperature reading and FG2 input for Types 5244, 5257-5 and 5257-51 Room Panels active
02	Outdoor sensor	0	All 1)	CO2 -> F02 - 1: with outdoor sensor, outdoor-tempera- ture-compensated control active Function block parameters: Select AF1, AF2
03 Return flow sensor 0 4.x-5.2, 6.x, CO2 -> F03 - 1: R	CO2 -> F03 - 1: Return flow sensor RüF2; limitation function active Function block parameters:			
		1	3.0–3.5, 10.0, 10.5, 25.x	KP (limiting factor): 0.1 to 10.0 (1.0)
04	Cooling control	0	Not systems Anl 3.9, 5.9, 16.x, 17.x, 18.x	CO2 -> F04 - 1: Cooling control The cooling control function causes a reversal of the operating direction and a minimum limitation of the return flow temperature in RK2.
05	Underfloor heating	0	All 1)	CO2 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction
07	Optimization	0	All 1)	CO2 -> F07 - 1: Optimization of heating times (only when CO2 > F01 - 1 and CO1(2) -> F02 - 1)
08	Adaptation	0	All 1)	CO2 -> F08 - 1: Heating characteristic adaptation (only when CO2 -> F01 - 1, CO1(2) -> F02 - 1 and CO2 -> F11 - 0)
09	Flash adaptation	0	All 1)	CO2 -> F09 - 1: Flash adaptation of flow temperature (only when CO2 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
11	Four-point characteristic	0	All 1)	CO2 -> F11 - 1: Four-point characteristic (only when CO2 -> F08 - 0) CO2 -> F11 - 0: Gradient characteristic
12	Three-step control mode	1	All 1)	CO2 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25,, 240 s (35 s) CO2 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min)
13	Damping	0	All 1)	CO2 -> F13 - 1: OPEN signal damping (only when CO2 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C)
14	Release	0	All 1)	CO2 -> F14 - 1: Release RK2 at BI16; FG2 has no function Function block parameters: Active when BI = ON, OFF (ON)
16	Demand processing, 0 to 10 V Input Terminals 19/23	0	All 1)	CO2 -> F16 - 1: Demand processing in RK2
24	Demand only	0	All 1)	CO2 -> F24 - 1: RK2 works as a feeder circuit. RK2 only processes external demand for heating; UP2 runs depending on demand.
28	Variable night set-back	0	Not Anl 3.5, 10.5, 25.5	CO2 -> F28 - 1: variable night set-back (only when CO2 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to +20.0 °C (5.0 °C) OTL day 0 %: -50.0 to +5.0 °C (-15.0 °C)

F Function block number, WE Default setting, Anl System code number

16-244 EB 5578 EN

CO3: RK3 · Heating circuit 3 (systems Anl 3.9, 5.x, 6.x, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 17.x, 21.x, 25.x) 11

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Room sensor	0	All 1)	CO3 -> F01 - 1: Room sensor RF3, temperature reading and FG3 input for Types 5244, 5257-5 and 5257-51 Room Panels active
02	Outdoor sensor	1	All 1)	CO3 -> F02 - 1: with outdoor sensor, outdoor-temperature-compensated control active Function block parameters: Select AF1, AF2
03	Return flow sensor	0	5.0–5.2, 6.x, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 21.1, 21.9	CO3 -> F03 - 1: Return flow sensor RüF2; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0)
-		1	21.2, 25.x	
04	Cooling control	0	Not systems Anl 5.9, 15.x, 16.x, 17.x	CO3 -> F04 - 1: Cooling control The cooling control function causes a reversal of the operating direction and a minimum limitation of the return flow temperature in RK3.
05	Underfloor heating	0	All 1)	CO3 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction
07	Optimization	0	All 1)	CO3 -> F07 - 1: Optimization of heating times (only when CO3 > F01 - 1 and CO1(3) -> F02 - 1)
08	Adaptation	0	All 1)	CO3 -> F08 - 1: Heating characteristic adaptation (only when CO3 -> F01 - 1, CO1(3) -> F02 - 1 and CO3 -> F11 - 0)
09	Flash adaptation	0	All 1)	CO3 -> F09 - 1: Flash adaptation of flow temperature (only when CO3 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
11	Four-point characteristic	0	All 1)	CO3 -> F11 - 1: Four-point characteristic (only when CO3 -> F08 - 0) CO3 -> F11 - 0: Gradient characteristic
12	Three-step control mode	1	All 1)	CO3 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25,, 240 s (35 s) CO3 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min)
13	Damping	0	All 1)	CO3 -> F13 - 1: OPEN signal damping (only when CO3 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C)
14	Release	0	Not for sys- tems with SF3	CO3 -> F14 - 1: Release RK3 at B117; FG3 has no function Function block parameters: Active when BI = ON, OFF (ON)
16	Demand processing, 0 to 10 V Input Terminals 19/23	0	All 1)	CO3 -> F16 - 1: Demand processing in RK3
24	Demand only	0	All 1)	CO3 -> F24 - 1: RK3 works as a feeder circuit. RK3 only processes external demand for heating; UP3 runs depending on demand.
28	Variable night set-back	0	Not Anl 25.5	CO3 -> F28 - 1: variable night set-back (only when CO3 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to +20.0 °C (5.0 °C) OTL day 0 %: -50.0 to +5.0 °C (-15.0 °C)

F Function block number, WE Default setting, Anl System code number

16-246 EB 5578 EN

CO4: DHW circuit (systems Anl 1.1–1.9, 2.x, 3.1–3.4, 3.9, 4.1–4.5, 5.1, 5.2, 7.x, 8.x, 9.x, 10.1–10.3, 11.x, 12.x, 13.x, 14.x, 15.x, 17.x, 18.x, 21.x) $^{1)}$

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Storage tank sensor SF1 Not systems Anl 3.9, 5.9, 11.0, 11.3, 11.5, 12.0, 13.0, 17.x, 18.x, 21.0	0	1)	CO4 -> F01 - 1: Storage tank sensor SF1 CO4 -> F01 - 0: Storage tank thermostat (only when CO4 -> F02 - 0) 1) Default = 1: Systems Anl 1.1-1.8, 2.x, 3.1-3.4, 4.1-4.5, 5.1, 5.2, 7.x-9.x, 10.1-10.3, 11.1, 11.2, 11.4, 11.6, 12.1, 13.1, 13.2, 14.x, 15.x, 21.1, 21.2 2) Default = 0: Systems Anl 1.9, 11.9, 12.9, 13.9, 21.9
02	Storage tank sensor SF2 Not Anl 1.9, 11.0, 11.3, 11.9, 12.0, 12.9, 13.0, 13.9, 14.3, 15.3, 21.0, 21.9	0	1) 2)	CO4 -> F02 - 1: Storage tank sensor SF2 (only when CO4 -> F01 - 1) 1) Default = 1: 1.1, 1.3, 1.4, 1.5, 1.7, 1.8-2, 2.0, 2.1, 3.1, 3.3, 3.4, 4.1, 4.3, 4.5, 5.1, 7.1, 8.1, 9.1, 9.5, 10.1, 10.3, 11.1, 11.4, 11.5, 11.9, 12.1, 13.1, 14.1, 15.0, 15.1, 21.1 2) Default = 0: 1.2, 1.6, 1.8-1, 1.8-3, 1.9, 2.2, 2.3, 2.4, 3.2, 4.2, 5.2, 7.2, 8.2, 9.2, 9.6, 10.2, 11.0, 11.2, 11.3, 11.6, 12.0, 12.2, 12.9, 13.0, 13.2, 13.9, 14.2, 14.3, 15.2, 15.3, 21.0, 21.2, 21.9
03	Return flow sensor RüF2	0	1.9, 7.x, 8.x, 11.x, 12.x, 13.x, 21.x 3.9, 5.9, 17.x, 18.x	CO4 -> F03 - 1: Return flow sensor RüF2; limitation function active Function block parameter: KP (limiting factor): 0.1 to 10.0 (1.0) CO4 -> F03 - 1: return flow sensor RüF2 or RüF4 when RüF2 is activated for HK2; output UP1 to layer the return flow depending on the temperature active
04	Flow rate sensor	0	1.9, 11.9, 12.9, 13.9, 21.9	CO4 -> F04 - 1: Flow rate sensor at B17 Function block parameter: Select: Analog/Binary (Analog) 11 11 Analog = flow rate sensor (1400-9246) Binary = flow switch at terminals 17/18 In systems Anl 3.9, 5.9, 17.x and 18.x, only a flow switch can be configured.

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
05	Flow sensor	0	1.1–1.4, 1.6, 1.8, 1.9, 2.2, 2.4, 3.2, 3.4, 4.2, 5.2, 7.2, 8.2, 9.2, 9.6, 10.1– 10.3, 11.2, 11.9, 12.2, 12.9, 13.2, 13.9, 21.2, 21.9	CO4 -> F05 - 1: Flow sensor VF4 (to measure storage tank charging temperature)
06	Parallel pump operation	1	8.x, 9.5, 9.6	CO4 -> F06 - 1: Parallel pump operation Function block parameters: Stop: 0 to 10 min (10 min)
		0	2.1–2.4, 4.1–4.5	Temperature limit: 20.0 to 90.0 °C (40.0 °C) CO4 -> F06 - 0: UP1 switched off during DHW heating
07	Intermediate heating	1	2.x, 4.1-4.5	CO4 -> F07 - 1: after 20 minutes of DHW heating, heating operation in UP1 circuit reactivated for 10 minutes
		0	8.x, 9.5, 9.6	CO4 -> F07 - 0: storage tank charging is given unlimited pri- ority concerning UP1 circuit
08	Priority (reverse)	0	1.1–1.4, 3.1–3.4, 4.1–4.5, 5.1, 5.2, 9.x, 10.1–	CO4 -> F08 - 1: Priority by reverse control (only when CO4 -> F09 - 0) Function block parameters: Start: 0 to 10 min (2 min) KP (influence factor): 0.1 to 10.0 (1.0) Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3
09	Priority (set-back)	0	10.3, 11.x, 12.x, 13.x, 15.0, 15.4, 15.5, 21.x	CO4 -> F09 - 1: Priority through set-back operation (only when CO4 -> F08 - 0) Function block parameters: Start: 0 to 10 min (2 min) Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3
10	Circulation pump (DHW) integrated into heat exchanger	0	1.6, 1.8, 3.2, 3.4, 5.2, 7.2, 9.2, 11.2, 11.4, 12.2, 13.2, 21.2	CO4 -> F10 - 1: Control of DHW circuit active while circulation pump (ZP) is running
		1	11.6, 13.6	

16-248 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
11	Operation of circulation pump (DHW) during storage tank charging	0	Not Anl 1.9, 11.0, 11.3, 11.9, 12.0, 12.9, 13.0, 13.9, 21.0, 21.9	CO4 -> F11 - 1: Circulation pump (ZP) runs according to time schedule during storage tank charging CO4 -> F11 - 0: Circulation pump (ZP) switched off during storage tank charging
12	Control mode	1	1.9, 3.9, 5.9, 7.x, 8.x, 9.x, 11.x, 12.x, 13.x, 17.x, 18.x, 21.	CO4 -> F12 - 1: Three-step control Function block parameters: Minimum speed: 5 to 50 % (20 %) (systems Anl 3.9, 5.9, 17.x, 18.x only) KP (gain): 0.1 to 50.0 (2.0; systems Anl 1.9, 11.9, 12.9, 13.9, 21.9: 0.6) Tn (reset time): 1 to 999 s (120 s, systems Anl 3.9, 5.9, 17.x 18.x: 30 s; systems Anl 1.9, 11.9, 12.9, 13.9, 21.9: 12 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15 to 240 s (35 s; systems Anl 1.9, 11.9, 12.9, 13.9, 21.9: 20 s, not systems Anl 3.9, 5.9, 17.x, 18.x) CO4 -> F12 - 0: On/off control (not systems Anl 3.9, 5.9, 17.x, 18.x); in this case, F12 -0 = F12 - 1 applies Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min)
13	Damping	1	All 1)	CO4 -> F13 - 1: OPEN signal damping (only when CO4 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) CO4 -> F13 - 1: OPEN signal damping (only when CO4 -> F04 - 1, analog setting)
				Function block parameters: Max. system deviation: 3.0 to 10.0 °C (8.0 °C)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
14	Thermal disinfection	0	Not systems Anl 3.9, 5.9, 17.x, 18.x	CO4 -> F14 - 1: Thermal disinfection (only when CO4 -> F01 - 1) Function block parameters: Day of week: Monday, Tuesday,, daily (Wednesday) Time: Adjustable as required in steps of 15 minutes (00:00 - 04:00) Disinfection temperature: 60.0 to 90.0 °C (70.0 °C) Set point boost: 0.0 to 50.0 °C (10.0 °C) (systems Anl 1.9, 3.9, 5.9, 11.0, 11.3, 11.5, 11.9, 12.0, 12.9, 13.0, 13.9, 17.x, 18.x, 21.0, 21.9 only) Duration: 0 to 255 min (0 min) When Start time = Stop time Select: Active when BI = OFF, ON (ON)
			3.9, 5.9, 17.x, 18.x	CO4 -> F13 - 1: OPEN signal damping (only when CO4 -> F04 - 1, analog setting) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (8.0 °C)
15	SLP depending on return flow temperature	0	1.5, 1.7, 2.0, 2.1, 2.3, 3.1, 3.3, 4.1, 4.3, 5.1, 11.1	CO4 -> F15 - 1: storage tank charging pump not ON unless return flow hot (for systems Anl 1.5, 1.7, 2.0, 2.1, 2.3, 4.1, 4.3, 5.1 only when CO1 -> F03 - 1; for system Anl 11.1 only when CO4 -> F03 - 1)
16	Priority for external demand	0	1.5–1.8, 2.x, 3.1–3.4, 4.1–4.3, 5.x, 15.0, 15.4, 15.5 7.x–9.x	CO4 -> F16 - 1: Priority for external demand Note: a high external demand causes excessive charging temperatures in DHW circuits without control valve. The default setting cannot be changed in systems Anl 7.x to
19	Switchover	0	Not systems Anl 1.9, 3.9, 5.9, 11.0, 11.3, 11.5, 11.9, 12.0, 12.9, 13.0, 13.9, 17.x, 18.x, 21.0, 21.9	9.x. CO4 -> F19 - 1: Switchover SF1, SF2 according to a time schedule. SF1 applies for day mode and SF2 for night mode (only when CO4 -> F02 - 1)
20	Return flow control	0	7.1, 8.1, 9.1, 9.5, 11.1, 12.1, 13.1, 21.1	CO4 -> F20 - 1: DHW circuit additionally controlled by a globe valve

16-250 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
21	Speed control of the charging pump	0	1.5–1.8, 2.x, 3.1–3.4, 4.1–4.3, 5.1, 5.2, 7.x, 8.x, 9.x, 10.1–10.3, 11.1–11.4, 12.1, 12.2, 13.1, 13,2, 21.1, 21.2	CO4 -> F21 - 1: Temperature-based adaptation of the delivery rate of the charging pump Function block parameters: Start speed reduction, limit: 5.0 to 90.0 °C (40.0 °C) Stop speed reduction, limit: 5.0 to 90.0 °C (50.0 °C) Min. speed signal: 0 to 50 % (20 %)
22	Cold charging protection	0	1.1	CO4 -> F22 - 1: Storage tank charging started when the primary flow temperature is high enough Function block parameters: Valve position: 1 to 100 %
23	Electric heating cartridge	0	Systems Anl 3.9, 17.1, 18.1	CO4 -> F23 - 1: The output BO10 to release the electric heating is activated based on the temperature at SF1 for thermal disinfection (only when CO4 -> F14 - 1)
24	Bottom sensor for thermal disinfection	0	1.2, 1.4, 1.6, 1.8, 2.2, 2.4, 3.2, 3.4, 4.2, 5.2, 7.2, 8.2, 9.2, 9.6, 10.2, 11.2, 11.4, 11.6, 12.2, 13.2, 13.6, 14.2, 15.2, 21.2	CO4 -> F24 - 1: only when CO4 -> F14 - 1 Sensor RüF2 as switch-off sensor active
25	ZP speed	0	All	CO4 -> F25 - 1: speed control Temperature sensor RüF4/AF2 active The output is determined in the CO5 -> F34 or F35 setting with the 'ZP speed' function. Function block parameters: Return flow set point: 5.0 to 90.0 °C (55 °C) KP (gain): 0.1 to 50.0 (1.0) Tn (reset time): 30 to 2000 s (300 s) Minimum speed: 5 to 50 % (10 %)
26	SLP temperature sensor	0	All	CO4 -> F26 - 1: Different sensor for the speed control of the charging pump Function block parameters: Sensor: AF1 to SF3 (RüF2)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
27	Discharging protection		Not Anl 1.1- 1.4, 1.9, 3.9, 5.9, 10.1-10.3, 11.0,11.3, 11.9, 12.0, 12.9, 13.0, 13.9, 14.x, 15.x, 17.x, 18.x, 21.0, 21.9	CO4 -> F27 - 1: discharging protection active

F Function block number, WE Default setting, Anl System code number

CO5: System-wide functions (all systems)

If the controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Sensor type	1	All	CO5 -> F01 - 1, F02 - 0: Pt 1000
02				CO5 -> F01 - 0, F02 - 0: PTC
03				CO5 -> F01 - 1, F02 - 1: Ni 1000
04	Summer mode	0	Not systems Anl 1.5, 1.6, 1.9, 3.5, 10.5, 25.5	CO5 -> F04 - 1: Summer mode Function block parameters: Date: adjustable as required (01.06 30.09.) No. days until activation: 1 to 3 (2) No. days until deactivation: 1 to 3 (1) Limit: 0.0 to 30.0 °C (18.0 °C)
05	Delayed outdoor temperature adaptation (decreasing)	0	Not Anl 1.9	CO5 -> F05 - 1: Delayed outdoor temperature adaptation as the temperature falls Function block parameters: Delay/h: 0.2 to 6.0 °C (3.0 °C)
06	Delayed outdoor temperature adaptation (increasing)	0	Not Anl 1.9	CO5 -> F06 - 1: Delayed outdoor temperature adaptation as the temperature rises Function block parameters: Delay/h: 0.2 to 6.0 °C (3.0 °C)

16-252 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
07	Error message	0	Not systems Anl 5.1, 5.2, 5.9, 6.1, 9.x, 12.1, 12.2-x, 13.1, 13.2, 13.6, 15.1, 15.2, 15.3, 17.8, 21.1, 21.2	CO5 -> F07 - 1: Terminal for error message: see plant scheme table Function block parameters: Relay contact = NO contact, NC contact (NO contact)
08	Summer time	0	All	CO5 -> F08 - 1: Summer/standard time switchover
09	Frost protection	1	Not systems Anl 1.5, 1.6, 1.9, 3.5, 10.5, 25.5	CO5 -> F09 - 1: Highest priority for frost protection Function block parameters: Limit: -15.0 to +3.0 °C (+3.0 °C) CO5 -> F09 - 0: Restricted frost protection Function block parameters: Limit: -15.0 to +3.0 °C (+3.0 °C)
		0	1.5, 1.6, 1.9, 3.5, 10.5, 25.5	
10	Capacity limitation at terminals 17/18	0	Not for systems with SF3, not system Anl 1.9	CO5 -> F10 - 1: Capacity limitation in RK1 with pulses (only when CO6 -> F12 - 0) Function block parameters: Max. limit: OT to 800 pulses/h (15 pulses/h) Max. limit (heating) ¹⁾ : OT to 800 pulses/h (15 pulses/h) Max. limit (DHW) ¹⁾ : 1 to 800 pulses/h (15 pulses/h) Limiting factor: 0.1 to 10.0 (1.0) Not systems Anl 1.0, 1.5-1.8, 3.0, 3.5, 3.9, 4.0, 5.9, 7.x, 10.x, 11.x, 12.x, 13.x, 14.x, 15.x, 16.x, 17.x, 18.x, 21.x, 25.x
12	Creep feed rate limitation	0	Not Anl 1.9	CO5 -> F12 - 1: Creep feed rate limitation Function block parameters: Switching mode: Binary at terminals 13/19, analog at input RüF1 (binary) Active when BI = ON, OFF (ON)
14	Operation UP1	0	3.0, 5.0, 7.x, 9.1, 9.2, 12.x, 15.1, 16.1, 16.5, 16.7, 16.8	CO5 -> F14 - 1: Feeder pump UP1 operation to cover own demand Note: the feeder pump UP1 also starts to operate to cover the demand of RK2/RK3

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
15	Release	0	All	CO5 -> F15 - 1: Release controller at BI15, FG1 has no function Function block parameters: Active when BI = ON, OFF (ON)
16	Return flow temperature limitation (proportional controller)	0	All	CO5 -> F16 - 1: Return flow temperature limitation with P algorithm
19	Monitoring	0	All	CO5 -> F19 - 1: Temperature monitoring
20	Sensor calibration	1	All	CO5 -> F20 - 1: Set all sensor calibration values CO5 -> F20 - 0: Delete all sensor calibration values
21	Lock manual level	0	All	CO5 -> F21 - 1: Lock rotary switch In switch position, the controller runs in automatic mode
22	Lock rotary switch	0	All	CO5 -> F22 - 1: Lock rotary switch Key number input is still possible.
23	OT with 0-10 V	0	All	CO5 -> F23 - 1: Outdoor temperature received or sent as 0 to 10 V signal (terminals 19/23) The output is determined in the CO5 -> F34 setting with the 'Outdoor temperature' function. Function block parameters: Direction: Input, Output (Input) Lower transmission range: -50.0 to +100.0 °C (-20.0 °C) Upper transmission range: -50.0 to +100.0 °C (+50.0 °C)
24	0-10 V input	0	All	CO5 -> F24 - 1: The measured value at 0 to 10 V input is displayed as a special value.
25	AA1 reverse (0 to 10 V)	0	All	CO5 -> F25 - 0: 0 V/0 % = Valve CLOSED/pump OFF CO5 -> F25 - 1: 0 V/0 % = Valve OPEN/pump with max. de- livery rate Function block parameters: Zero: 0 to 50 % (0 %)
26	AA2 reverse (PWM)	0	All	CO5 -> F26 - 0: 0 V/0 % = Valve CLOSED/pump OFF CO5 -> F26 - 1: 0 V/0 % = Valve OPEN/pump with max. delivery rate Function block parameters: Zero: 0 to 50 % (0 %)

16-254 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
31	AE1 zero	0	All	CO5 -> F31 - 0 Function block parameters: Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C) CO5 -> F31 - 1 Function block parameters: Zero: 5 to 20 % (5 %) Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C)
34	AA1 PWM (0 to 10 V)	0	All	CO5 -> F34 - 0/- 1: output terminals 21/20 always 0 to 10 V signal Function: Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (Y1)
35	AA2 PWM (PWM)	0	All	CO5 -> F35 - 0/- 1: output terminals 22/20 always PMW signal Function: Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (Y2)

F Function block number, WE Default setting, Anl System code number

CO6: Modbus (all systems)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Modbus	1	All	CO6 -> F01 - 1: Modbus active
02	16-bit address	0	All	CO6 -> F02 - 1: Modbus 16-bit addressing (only with CO6 -> F01 - 1) CO6 -> F02 - 0: Modbus 8-bit addressing
03	Modem	0	All	CO6 -> F03 to F06 is required to configure the error message
04	Automatic configuration	0	All	transfer to a connected Modbus/GPRS gateway (1402-0701).
05	Lock dial-up to building automation system	0	All	
06	Dial-up also upon corrected error	0	All	

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
07	Monitoring	0	All	CO6 -> F07 - 1: Control system monitoring > Resets all level bits to "autonomous" when there is no communication (only when CO6 -> F01 - 1)
08	Text message	0	All	CO6 -> F08 is required to configure the error message transfer to a connected Modbus/GPRS gateway (1402-0701).
10	Meter bus	0	All	CO6 -> F10 - 1: Meter bus active Function block parameters: HM 13 address: 0 to 255 (255) HM13 model: 1434, Multical3, Apator, SLS/WSF (1434) HM13 mode: 24 h, Continuous, CoiL For HM1 with '1434' and 'Continuous' settings, additionally: Additionally: Select: Tariff: Tar-A, Tar-E (Tar-A, tariff schedule OFF)
11	Flow rate limitation in RK1	0	Not Anl 1.9	CO6 -> F11 - 1: Flow rate limitation (only when CO6 -> F10 - 1 and HM1 is activated) Function block parameters: Max. limit: OT to 650 m³/h (1.5 m³/h) Max. limit (heating) ¹⁾ : OT to 650 m³/h (1.5 m³/h) Max. limit (DHW) ¹⁾ : 0.01 to 650 m³/h (1.5 m³/h) Limiting factor: 0.1 to 10 (1)
12	Capacity limitation in RK1	0	Not Anl 1.9	CO6 -> F12 - 1: Capacity limitation (only when CO6 -> F10 - 1 and HM1 is activated) Function block parameters: Max. limit: OT to 6500 kW (1.5 kW) Max. limit (heating) ¹⁾ : OT to 6500 kW (1.5 kW) Max. limit (DHW) ¹⁾ : 0.1 to 6500 kW (1.5 kW) Limiting factor: 0.1 to 10 (1)
13	Flow rate limitation in RK2	0	3.0–3.4, 3.9, 4.x, 5.9, 7.x, 8.x, 10.x, 11.x, 12.x, 13.x, 15.x, 16.1, 16.6,	CO6 -> F13 - 1: Flow rate limitation (only when CO6 -> F10 - 1 and HM2 is activated) Function block parameters: Max. limit: 0.01 to 650 m³/h (1.5 m³/h) Limiting factor: 0.1 to 10 (1)
14	Capacity limitation in RK2	0	16.8, 17.x, 18.x, 21.x, 25.x	CO6 -> F14 - 1: Capacity limitation (only when CO6 -> F10 - 1 and HM2 is activated) Function block parameters: Max. limit: 0.1 to 6500 kW (1.5 kW) Limiting factor: 0.1 to 10 (1)

16-256 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
15	Flow rate limitation in RK3	0	5.9, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 17.8, 21.x, 25.x	
16	Capacity limitation in RK3	0		CO6 -> F16 - 1: Capacity limitation (only when CO6 -> F10 - 1 and HM3 is activated) Function block parameters: Max. limit: 0.1 to 6500 kW (1.5 kW) Limiting factor: 0.1 to 10 (1)
17	Return flow temperature limitation based on capacity	0	All	CO6 -> F17 - 1: new maximum return flow limit at a capacity higher than the max. limit (only when CO6 -> F10 - 1 and activated HM1) Function block parameters: Max. limit: 0.1 to 6500 kW (1.5 kW) Max. return flow temperature: 5.0 to 90 °C (55 °C)
20	Modbus without building automation system	0	All	CO6 -> F20 - 1: Various Modbus specifications do not have any effect on the collective level/building automation system reading
	1) Not systems A	Anl 1.0	, 1.5-1.8, 3.0,	3.5, 4.0, 7.x, 10.x, 11.x, 12.x, 13.x, 14.x, 15.x, 16.x, 17.x, 21.x, 25.x

F Function block number, WE Default setting, Anl System code number

CO7: Device bus (all systems)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Device bus	0	All	CO7 -> F01 - 1: Device bus active Function block parameters:
				Device bus address/Auto 1), 1 to 32 (32) 1) Auto = Automatic search for a free device bus address in the system
02	Clock syn- chronization	0	All	CO7 -> F02 - 1: controller sends its system time to all device bus participants once every 24 hours

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
03	Room panel RK1	0	1.0–1.4, 2.x, 4.x, 6.0, 9.5, 9.6, 10.x, 11.x, 13.x, 21.x, 25.x	CO7 -> F03 - 1: communication with TROVIS 5570 for RK1 active, CO1 -> F01 - 1 automatically set Function block parameters: Device bus address/Auto 11, 1 to 32 (32) 1) Auto = Automatic search for a room panel set to detection mode
04	Room panel RK2	0	3.0–3.4, 4.x, 5.x, 6.0, 10.x, 16.1, 16.6, 16.8, 25.x	CO7 -> F04 - 1: communication with TROVIS 5570 for RK2 active, CO2 -> F01 - 1 automatically set Function block parameters: Device bus address/Auto ¹⁾ , 1 to 32 (32) 1) Auto = Automatic search for a room panel set to detection mode
05	Room panel RK3	0	5.x, 6.0, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 21.x, 25.x	CO7 -> F05 - 1: communication with TROVIS 5570 for RK3 active, CO3 -> F01 - 1 automatically set Function block parameters: Device bus address/Auto 11, 1 to 32 (32) 11 Auto = Automatic search for a room panel set to detection mode
06	Send AF1	0	All	CO7 -> F06 - 1: Function block parameters: Register number/1 to 4 (1)
07	Receive AF1	0	All	CO7 -> F07 - 1: Function block parameters: Register number/1 to 4 (1)
08	Send AF2	0	All	CO7 -> F08 - 1: Analysis active Function block parameters: Register number/1 to 4 (2)
09	Receive AF2	0	Not Anl 1.9	CO7 -> F09 - 1: Function block parameters: Register number/1 to 4 (2)
10	Send demand RK1	0	All	CO7 -> F10 - 1: Send demand Function block parameters: Register number/5 to 64 (5)
11	Send demand RK2	0	All	CO7 -> F11 - 1: Function block parameters: Register number/5 to 64 (5)
12	Send demand RK3	0	All	CO7 -> F12 - 1: Function block parameters: Register number/5 to 64 (5)

16-258 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
13	Send demand DHW	0	All	CO7 -> F13 - 1: 'Charging temperature boost' (P04) is generated in the PA4 level Function block parameters: Register number/5 to 64 (5)
14	Send max. demand	0	All	CO7 -> F14 - 1: the controller already determines internally the maximum flow set point of its circuit and sends it this value to the primary controllers
15	Receive external demand in RK1	0	All	CO7 -> F15 - 1: External demand processing in RK1 Function block parameters: Register number/5 to 64 (5)
16	Receive errors	0	All	CO7 -> F16 - 1: the controller generates the 'External' message as long as the faults of the other device bus participants exist.
17	Receive external demand in RK2	0	All	CO7 -> F17 - 1: External demand processing in RK2 Function block parameters: Register number/5 to 64 (5)
18	Receive external demand in RK3	0	All	CO7 -> F18 - 1: External demand processing in RK3 Function block parameters: Register number/5 to 64 (5)
19	Raise return flow temperature	0	All	CO7 -> F19 - 1: Return flow temperature limit in RK1 raised when 'DHW heating active' message is received over the device bus Function block parameters: Register number/5 to 64 (32)
20	Send 'DHW heating active'	0	All	CO7 -> F20 - 1: Function block parameters: Register number/5 to 64 (32)
21	Receive release RK1	0	All	CO7 -> F21 - 1: Function block parameters: Register number/5 to 64 (32)
22	Receive release RK2	0	3.1–3.4, 4.x, 5.x, 6.x, 10.x, 16.1, 16.6, 16.8, 25.x	CO7 -> F22 - 1: Function block parameters: Register number/5 to 64 (32)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
23	Receive release RK3	0	5.x, 6.x, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 21.x, 25.x	
31	Ext-HC11	0	All	CO7 -> F31 - 1: TROVIS I/O for heating circuit 11 active Function block parameters: Device bus address: 11 to 19 (11) Connected/primary circuit, to HC1 (to HC1)
32	Ext-HK12	0	All	CO7 -> F32 - 1: TROVIS I/O for heating circuit 12 active Function block parameters: Device bus address: 11 to 19 (12) Connected/primary circuit, to HC1 (to HC1)
33	Ext-HK13	0	All	CO7 -> F33 - 1: TROVIS I/O for heating circuit 13 active Function block parameters: Device bus address: 11 to 19 (13) Connected/primary circuit, to HC1 (to HC1)

F Function block number, WE Default setting, Anl System code number

CO8: Initialization of BI1 and BI2 (all systems)

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Analysis of BI1	0	All	CO8 -> F01 - 1: Analysis active Function block parameter: 1)
02	Analysis of BI2	0	All	CO8 -> F02 - 1: Analysis active Function block parameter: 1)
03	Analysis of BI3	0	All	CO8 -> F03 - 1: Analysis active Function block parameter: 1)
04	Analysis of BI4	0	All	CO8 -> F04 - 1: Analysis active Function block parameter: 1)
05	Analysis of BI5	0	All	CO8 -> F05 - 1: Analysis active Function block parameter: 1)
06	Analysis of BI6	0	All	CO8 -> F06 - 1: Analysis active Function block parameter: 1)
09	Analysis of BI9	0	All	CO8 -> F09 - 1: Analysis active Function block parameter: 1)
10	Analysis of BI10	0	All	CO8 -> F10 - 1: Analysis active Function block parameter: 1)

16-260 EB 5578 EN

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
11	Analysis of BI11	0	All	CO8 -> F11 - 1: Analysis active Function block parameter: 1)
12	Analysis of BI12	0	All	CO8 -> F12 - 1: Analysis active Function block parameter: 1)
13	Analysis of BI13	0	All	CO8 -> F13 - 1: Analysis active Function block parameter: 1)
15	Analysis of BI15	0	All	CO8 -> F15 - 1: Analysis active Function block parameter: 1)
16	Analysis of BI16	0	All	CO8 -> F16 - 1: Analysis active Function block parameter: 1)
17	Analysis of BI17	0	All	CO8 -> F17 - 1: Analysis active Function block parameter: 1)
	1) Error message when BI = 0, BI = 1, none (1)			

F Function block number, WE Default setting, Anl System code number

CO11: RK11 · Heating circuit 11

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Room sensor	0	All	CO11 -> F01 - 1: Room sensor RF11; temperature reading active
02	Outdoor sensor	0	All	CO11 -> F02 - 1: Use of measured value AF1; outdoor-temperature-compensated control active
03	Return flow sensor	1	All	CO11 -> F03 - 1: Rücklaufsensor RüF11; Begrenzungsfunktion aktiv Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0)
05	Underfloor heating	0	All	CO11 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
07	Optimization	0	All	CO11 -> F07 - 1: Optimization of heating times (only when CO11 > F01 - 1 and CO11 -> F02 - 1)
08	Adaptation	0	All	CO11 -> F08 - 1: Heating characteristic adaptation (only when CO11 -> F01 - 1, CO11 -> F02 - 1 and CO11 -> F11 - 0)
09	Flash adaptation	0	All	CO11 -> F09 - 1: Flash adaptation of flow temperature (only when CO11 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0)
11	Four-point characteristic	0	All	CO11 -> F11 - 1: Four-point characteristic (only when CO11 -> F08 - 0) CO11 -> F11 - 0: Gradient characteristic
12	Three-step control mode	1	All	CO11 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25,, 240 s (35 s) CO11 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min)
13	Damping	0	All	CO11 -> F13 - 1: OPEN signal damping (only when CO11 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C)
28	Variable night set-back	0	All	CO11 -> F28 - 1: variable night set-back (only when CO11 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to +20.0 °C (+5.0 °C) OTL day 0 %: -50.0 to +5.0 °C (-15.0 °C)

F Function block number, WE Default setting, Anl System code number

16-262 EB 5578 EN

CO12: RK12 \cdot Heating circuit 12

				Comments
F	Function	WE	Anl	Function block parameters: value range (default setting)
01	Room sensor	0	All	CO12 -> F01 - 1: Room sensor RF12; temperature reading active
02	Outdoor sensor	0	All	CO12 -> F02 - 1: Use of measured value AF1; outdoor-temperature-compensated control active
03	Return flow sensor	1	All	CO12 -> F03 - 1: return flow sensor RüF12; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0)
05	Underfloor heating	0	All	CO12 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction
07	Optimization	0	All	CO12 -> F07 - 1: Optimization of heating times (only when CO12 > F01 - 1 and CO12 -> F02 - 1)
08	Adaptation	0	All	CO12 -> F08 - 1: Heating characteristic adaptation (only when CO12 -> F01 - 1, CO12 -> F02 - 1 and CO12 -> F11 - 0)
09	Flash adaptation	0	All	CO12 -> F09 - 1: Flash adaptation of flow temperature (only when CO12 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0)
11	Four-point characteristic	0	All	CO12 -> F11 - 1: Four-point characteristic (only when CO11 -> F08 - 0) CO12 -> F11 - 0: Gradient characteristic

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
12	Three-step control mode	1	All	CO12 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25,, 240 s (35 s)
				CO12 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min)
13	Damping	0	All	CO12 -> F13 - 1: OPEN signal damping (only when CO11 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C)
28	Variable night set-back	0	All	CO12 -> F28 - 1: variable night set-back (only when CO12 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to +20.0 °C (+5.0 °C) OTL day 0 %: -50.0 to +5.0 °C (-15.0 °C)

F Function block number, WE Default setting, Anl System code number

16-264 EB 5578 EN

CO13: RK13 \cdot Heating circuit 13

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
01	Room sensor	0	All	CO13 -> F01 - 1: Room sensor RF13; temperature reading active
02	Outdoor sensor	0	All	CO13 -> F02 - 1: Use of measured value AF1; outdoor-temperature-compensated control active
03	Return flow sensor	1	All	CO13 -> F03 - 1: Return flow sensor RüF13; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0)
05	Underfloor heating	0	All	CO13 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction
07	Optimization	0	All	CO13 -> F07 - 1: Optimization of heating times (only when CO13 > F01 - 1 and CO13 -> F02 - 1)
08	Adaptation	0	All	CO13 -> F08 - 1: Heating characteristic adaptation (only when CO13 -> F01 - 1, CO13 -> F02 - 1 and CO13 -> F11 - 0)
09	Flash adaptation	0	All	CO13 -> F09 - 1: Flash adaptation of flow temperature (only when CO13 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0)
11	Four-point characteristic	0	All	CO13 -> F11 - 1: Four-point characteristic (only when CO13 -> F08 - 0) CO13 -> F11 - 0: Gradient characteristic

F	Function	WE	Anl	Comments Function block parameters: value range (default setting)
12	Three-step control mode	1	All	CO13 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25,, 240 s (35 s)
				CO13 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min)
13	Damping	0	All	CO13 -> F13 - 1: OPEN signal damping (only when CO11 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C)
28	Variable night set-back	0	All	CO13 -> F28 - 1: variable night set-back (only when CO13 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to +20.0 °C (+5.0 °C) OTL day 0 %: -50.0 to +5.0 °C (-15.0 °C)

F Function block number, WE Default setting, Anl System code number

16-266 EB 5578 EN

16.7 Parameter lists

PA1: Heating circuit HC1

P	Reading	Parameter: Value range (default setting)
01	P01 <u>™</u> .⁺⊞ 1.2	Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO1 -> F05 - 1
02	P02 <u>+</u> • <u>·</u> 0.0°C	Level (parallel shift): −30.0 to 30.0 °C (0.0 °C)
03	P03 50.0°C	Flow set point (day) (only when CO1 -> F02 - 0 and CO1 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C)
04	P04 30.0°C	Flow set point (night) (only when CO1 -> F02 - 0 and CO1 -> F09 - 1): -5.0 to 150.0 °C (30.0 °C)
05	P05	Four-point characteristic Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) -50.0 to 50.0 °C (5.0 °C, 15.0 °C, 25.0 °C, 35.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) -5.0 to 150.0 °C (20.0 °C, 15.0 °C, 10.0 °C, 50 °C) Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) -5.0 to 150.0 °C (30.0 °C, 25.0 °C, 20.0 °C, 15.0 °C) Return flow temperature:
	○ # -15° -5° 5° 15° ○ 0.00 0.00 m³/h	5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C) Flow rate: 0.01 to 650 m³/h (0.00 m³/h, 0.00 m³/h, 0.00 m³/h)
	P 0.0 0.0 kW	Capacity: 0.1 to 6500 kW (with CO6 -> F12 - 1) or 1 to 800 pulse/h (with CO5 -> F10 - 1) (0.0 kW, 0.0 kW, 0.0 kW, 0.0 kW) or (0.0 pulse/h, 0.0 pulse/h, 0.0 pulse/h, 0.0 pulse/h)

Р	Reading	Parameter: Value range (default setting)
06	P06 .↓⁺⊞ 20.0°C	Min. flow temperature: -5.0 to 150.0 °C (20.0 °C)
07	P07 [⁺ <u>m</u> 70.0°C	Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO1 -> F05 - 1
09	P09 - 1 0.** -15.0°C	Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C)
10	P10 ↓ 5 40.0°C	Minimum flow temperature set point HC for binary demand processing: 5.0 to 150.0 °C (40.0 °C)
11	P11 <u> ∕√</u>	Return flow gradient (only when CO1 -> F03 - 1): 0.2 to 3.2 (1.2)
12	P12 _	Return flow level (only when CO1 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C)
13	P13 . ↓ +Ø 65.0°C	Base point for return flow temperature (only when CO1 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C)
14	P14 [⁻+Ø 65.0°C	Max. return flow temperature (only when CO1 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C)
15	P15 - ∦ →Ø 5.0°C	Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C)
16	P16 L og Auto	Minimum set point to charge buffer tank: AUTO to 90.0 °C (AUTO)
17	P17 ↓ Seg AUTO	Stop charging of the buffer tank: AUTO to 90.0 °C (AUTO)
18	P18 -∦ () 6.0°C	Charging temperature boost: 0.0 to 50.0 °C (6.0 °C)
19	P19 grop ⊘() 1.0	Lag time of charging pump 0.0 to 10.0 (1.0)

¹⁾ With cooling control with or without outdoor sensor

16-268 EB 5578 EN

PA2: Heating circuit HC2

P	Reading	Parameter: Value range (default setting)
01	P01 <u>™</u> .⁺ <u>m</u> 1.2	Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO2 -> F05 - 1
02	P02 <u>+</u> • <u>·</u> 0.0°C	Level (parallel shift): −30.0 to 30.0 °C (0.0 °C)
03	P03 50.0°C	Flow set point (day) (only when CO1, CO2 -> F02 - 0 and CO2 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C)
04	P04 30.0°C	Flow set point (night) (only with CO1, CO2 -> F02 - 0 and CO2 > F09 - 1): -5.0 to 150.0 °C (30.0 °C)
05	P05 🔀	Four-point characteristic
	☐ ♣ <mark>-15° -5° 5° 15°</mark> Ⅲ ♣ 70° 55° 40° 25°	Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) -50.0 to 50.0 °C (5.0 °C, 15.0 °C, 25.0 °C, 35.0 °C) ¹⁾
	#∅ 60° 40° 20° 20° #∅ 65° 65° 65°	Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) -5.0 to 150.0 °C (20.0 °C, 15.0 °C, 10.0 °C, 5.0 °C)
		Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) -5.0 to 150.0 °C (30.0 °C, 25.0 °C, 20.0 °C, 15.0 °C)
		Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C)
06	P06 .₄⁺⊞ 20.0°C	Min. flow temperature: -5.0 to 150.0 °C (20.0 °C)
07	P07 ∤ ⁺ <u>=</u> 70.0°C	Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO2 -> F05 - 1
09	P09 - 1 5.0°C	Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C)
11	P11 <u> ∕√</u>	Return flow gradient (only when CO2 -> F03 - 1): 0.2 to 3.2 (1.2)
12	P12 <u>†</u> -¢ø 0.0℃	Return flow level (only when CO2 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C)

Р	Reading	Parameter: Value range (default setting)
13	P13 . ↓ +Ø 65.0°C	Base point for return flow temperature (only when CO2 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C)
14	P14 『 ←Ø 65.0°C	Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C)
15	P15 - ↓ →Ø 5.0°C	Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C)

¹⁾ With cooling control with or without outdoor sensor

PA3: Heating circuit HC3

P	Reading	Parameter: Value range (default setting)
01	PO1 <u>™</u> . • <u>m</u> 1.2	Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO3 -> F05 - 1
02	P02 <u>†</u> ±• <u>·</u> • 0.0°C	Level (parallel shift): -30.0 to 30.0 °C (0.0 °C)
03	P03 50.0°C	Flow set point (day) (only when CO1, CO3 -> F02 - 0 and CO3 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C)
04	P04 30.0°C	Flow set point (night) (only with CO1, CO3 -> F02 - 0 and CO3 > F09 - 1): -5.0 to 150.0 °C (30.0 °C)
05	P05 🔀	Four-point characteristic
	↑ 1-15° -5° 5° 15° Ⅲ 1 70° 55° 40° 25° Ⅲ 2 60° 40° 20° 20° 1 □ 65° 65° 65° 65°	Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) -50.0 to 50.0 °C (5.0 °C, 15.0 °C, 25.0 °C, 35.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) -5.0 to 150.0 °C (20.0 °C, 15.0 °C, 10.0 °C, 5.0 °C)
		Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) -5.0 to 150.0 °C (30.0 °C, 25.0 °C, 20.0 °C, 15.0 °C) Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C)
06	P06 ₄⁺⊞ 20.0°C	Min. flow temperature: -5.0 to 150.0 °C (20.0 °C)

16-270 EB 5578 EN

Р	Reading	Parameter: Value range (default setting)
07	P07 [⁺ <u>m</u> 70.0°C	Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO3 -> F05 - 1
09	P09 - ₽ ☐.* -15.0°C	Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C)
11	P11 <u>1×</u> •Ø 1.2	Return flow gradient (only when CO3 -> F03 - 1): 0.2 to 3.2 (1.2)
12	P12 _ +Ø 0.0°C	Return flow level (only when CO3 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C)
13	P13 . ↓ +Ø 65.0°C	Base point for return flow temperature (only when CO3 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C)
14	P14 ∤ ⁻-Ø 65.0°C	Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C)
15	P15 - ∦ →Ø 5.0°C	Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C)

With cooling control with or without outdoor sensor

PA4: Domestic hot water heating (DHW)

Р	Reading	Parameter: Value range (default setting)
01	P01 - 1	Min. adjustable DHW set point: 5.0 to 90.0 °C (40.0 °C)
02	POS №0 60.0°C	Max. adjustable DHW set point: 5.0 to 90.0 °C (90.0 °C)
03	P03 ¼0 5.0°C	Hysteresis: 1.0 to 30.0 °C (5.0 °C)
04	P04 - 1 0 10.0°C	Charging temperature boost: 0.0 to 50.0 °C (10.0 °C)
05	P05 80.0°C	Max. charging temperature (only when CO4 -> F05 - 1): 20.0 to 150.0 $^{\circ}$ C (80.0 $^{\circ}$ C)
07	P07 65.0°C	Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C)
10	P10 :₄•€ 10.0°C	Solar circuit pump ON: 1.0 to 30.0 °C (10.0 °C)

Р	Reading	Parameter: Value range (default setting)
11	P11 : ∤ •€ 3.0°C	Solar circuit pump OFF: 0.0 to 30.0 °C (3.0 °C)
12	P12 80.0°C	Max. storage tank temperature: 20.0 to 90.0 °C (80.0 °C)
13	P13 ∰ 80.0°C	Maximum buffer tank temperature: 20.0 to 90.0 °C (80.0 °C)
14	P14 🔬 () 100%	Control signal DHW for storage tank charging: 5 to 100 % (100 %)
19	P19 ^{STOP} ⊗() 1.0	Lag time for storage tank charging pump (= Valve transit time x P19):
		0.0 to 10.0 (1.0)
21	P21 [°+Ø 25.0°C	Return flow temperature limit, layering at top: 5.0 to 90.0 °C (25.0 °C)

PA5: System-wide parameters

Р	Reading	Parameter: Value range (default setting)
01	PO1 <u>Î</u> 60.0°C	Start temperature for boiler pump (only systems Anl 14.1, 14.2, 15.1, 15.2, 16.2, 16.4, 16.5, 16.7): 20.0 to 90.0 °C (60.0 °C)
02	P02 ¼∰ 5.0°C	Boiler pump hysteresis (only system Anl 14.1, 14.2, 15.1, 15.2, 16.2, 16.4, 16.5, 16.7): 0.0 to 30.0 °C (5.0 °C)

PA6: Modbus

Р	Reading	Parameter: Value range (default setting)
01	P01 - ADR 1	Modbus station address (8 bit): 1 to 246 (255) 1 to 3200 (255) with CO6 > F02 - 1

PA11: Heating circuit HC11

Р	Reading	Parameter: Value range (default setting)
01		Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO11 -> F05 - 1

16-272 EB 5578 EN

P	Reading	Parameter: Value range (default setting)
02	P02 <u>+</u> • <u> </u>	Level (parallel shift): −30.0 to 30.0 °C (0.0 °C)
03	P03 50.0°C	Flow set point (day) (only when CO11 -> F02 - 0 and CO11 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C)
04	P04 30.0°C	Flow set point (night) (only with CO11 -> F02 - 0 and CO11 > F09 - 1): -5.0 to 150.0 °C (30.0 °C)
05	P05 <u> </u>	Four-point characteristic
	□ ↓ -15° -5° 5° 15° □ ↓ 70° 55° 40° 25° □ ↓ 60° 40° 20° 20°	Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C)
	1 □ 65° 65° 65° 65°	Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C)
		Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C)
06	P06 .∦⁺⊞ 20.0°C	Min. flow temperature: -5.0 to 150.0 °C (20.0 °C)
07	P07 ↓ * <u> </u>	Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO11 -> F05 - 1
09	P09 - 1 15.0°C	Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C)
11	P11 <u> %</u> ←Ø 1.2	Return flow gradient (only when CO11 -> F03 - 1): 0.2 to 3.2 (1.2)
12	P12 [1 .	Return flow level (only when CO11 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C)
13	P13 . ↓ +Ø 65.0°C	Base point for return flow temperature (only when CO11 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C)
14	P14 『 ←Ø 65.0°C	Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C)

PA12: Heating circuit HC12

Р	Reading	Parameter: Value range (default setting)
01	P01 <u>X</u> · <u>·</u> 1.2	Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO12 -> F05 - 1
02	P02 <u>+</u> • <u>·</u>	Level (parallel shift): -30.0 to 30.0 °C (0.0 °C)
03	P03 50.0°C	Flow set point (day) (only when CO12 -> F02 - 0 and CO12 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C)
04	P04 30.0°C	Flow set point (night) (only with CO12 -> F02 - 0 and CO12 > F09 - 1): -5.0 to 150.0 °C (30.0 °C)
05	P05 🔀	Four-point characteristic
	15. -5° 5° 15° 15. -5° 5° 15° 15. -5° 40° 25° 15. -5° 40° 20° 20° 15. -5° 65° 65° 65° 15. -5° 65° 65° 65° 15. -5° 65° 65° 65°	Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C)
		Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C)
06	P06 .↓· <u> </u>	Min. flow temperature: -5.0 to 150.0 °C (20.0 °C)
07	P07 [*± 70.0°C	Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO12 -> F05 - 1
09	P09 - 1 15.0°C	Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C)
11	P11 <u>1</u> ∕√ø 1.2	Return flow gradient (only when CO12 -> F03 - 1): 0.2 to 3.2 (1.2)
12	P12 [←Ø 0.0°C	Return flow level (only when CO12 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C)
13	P13 . ↓ +Ø 65.0°C	Base point for return flow temperature (only when CO12 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C)
14	P14 [⁻+Ø 65.0°C	Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C)

16-274 EB 5578 EN

PA13: Heating circuit HC13

Р	Reading	Parameter: Value range (default setting)
01	PO1 <u>™</u> .• <u>m</u> 1.2	Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO13 -> F05 - 1
02	P02 <u>+</u> • <u> </u>	Level (parallel shift): −30.0 to 30.0 °C (0.0 °C)
03	P03 50.0°C	Flow set point (day) (only when CO13 -> F02 - 0 and CO13 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C)
04	P04 30.0°C	Flow set point (night) (only with CO13 -> F02 - 0 and CO13 > F09 - 1): -5.0 to 150.0 °C (30.0 °C)
05	P05 🔀	Four-point characteristic
	□ ↓ -15° -5° 5° 15° □ ↓ 70° 55° 40° 25° □ ↓ 60° 40° 20° 20° ↓ □ 65° 65° 65° 65°	Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C) Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C)
06	P06 .↓⁺⊞ 20.0°C	Min. flow temperature: -5.0 to 150.0 °C (20.0 °C)
07	P07 ↓ * <u> </u>	Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO13 -> F05 - 1
09	P09 - 1 15.0°C	Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C)
11	P11 <u>⊠</u> ←Ø 1.2	Return flow gradient (only when CO13 -> F03 - 1): 0.2 to 3.2 (1.2)
12	P12 [<u>+</u> -ø 0.0°C	Return flow level (only when CO13 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C)
13	P13 . ↓	Base point for return flow temperature (only when CO13 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C)
14	P14 [⁻←Ø 65.0°C	Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C)

16.8 Customer-specific data

Station	
Operator	
SAMSON office	
System code number	

Function block settings in configuration levels

	CO1	CO2	CO3	CO4	CO5	CO6	CO7	CO8	CO11	CO12	CO13
F01											
F02											
F03											
F04											
F05											
F06											
F07											
F08											
F09											
F10											
F11											
F12											
F13											
F14											
F15											
F16											
F17											
F18											
F19											
F20											
F21											
F22											
F23											
F24											
F25											
F26											
F27											
F28											
F31											
F32											
F33											
F34											
F35											

16-276 EB 5578 EN

Settings at the rotary switch · Set points

Parameters	Switch position ♣☆	Value range
HC1 room temperature	-	
HC2 room temperature		
HC3 room temperature		0.01-40.096
HC11 room temperature		0.0 to 40.0 °C
HC12 room temperature		
HC13 room temperature		
DHW temperature		Min. to max. DHW tempera- ture
HC1 OT deactivation value		
HC2 OT deactivation value		
HC3 OT deactivation value		-50.0 to
HC11 OT deactivation value		+50.0 °C
HC12 OT deactivation value		
HC13 OT deactivation value		
Parameters	Switch position 🖟 🤇	Value range
HC1 room temperature	•	

Parameters	Switch position & (Value range
HC1 room temperature		
HC2 room temperature		
HC3 room temperature		0.0 to 40.0 °C
HC11 room temperature		0.0 10 40.0 C
HC12 room temperature		
HC13 room temperature		
DHW temperature		Min. to max. DHW tempera- ture
HC1 OT deactivation value		
HC2 OT deactivation value		
HC3 OT deactivation value		-50.0 to
HC11 OT deactivation value		+50.0 °C
HC12 OT deactivation value		
HC13 OT deactivation value		

Settings at the rotary	switch · Times-of-use	· Switch position	e F
------------------------	-----------------------	-------------------	--------

Settings at the rotary switc	h · Times-c	of-use	 Switc 	h posi	tion e) <u>특</u>			
Times-of-use HC1	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range	
Start first time-of-use									
Stop first time-of-use									
Start second time-of-use								00:00 to 24:00	
Stop second time-of-use								h	
Start third time-of-use									
Stop third time-of-use									
Times-of-use HC2	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range	
Start first time-of-use									
Stop first time-of-use								-	
Start second time-of-use								00:00 to 24:00	
Stop second time-of-use								h	
Start third time-of-use								-	
Stop third time-of-use									
Times-of-use HC3	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range	
Start first time-of-use									
Stop first time-of-use]	
Start second time-of-use								00:00 to 24:00	
Stop second time-of-use								h	
Start third time-of-use									
Stop third time-of-use									
Times-of-use HC11	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range	
Start first time-of-use									
Stop first time-of-use									
Start second time-of-use								00:00 to 24:00	
Stop second time-of-use								h	
Start third time-of-use									
Stop third time-of-use									
Times-of-use HC12	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range	
Start first time-of-use									
Stop first time-of-use									
Start second time-of-use								00:00 to 24:00	
Stop second time-of-use								h	
Start third time-of-use									
Stop third time-of-use									

16-278 **EB 5578 EN**

Times-of-use HC13	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range
Start first time-of-use								
Stop first time-of-use								
Start second time-of-use								00:00 to 24:00
Stop second time-of-use								h
Start third time-of-use								
Stop third time-of-use								
Times-of-use DHW	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range
Start first time-of-use								
Stop first time-of-use								
Start second time-of-use								00:00 to 24:00
Stop second time-of-use								h
Start third time-of-use								
Stop third time-of-use								
Times-of-use ZP	Mon	Tue	Wed	Thu	Fri	Sat	Sun	Value range
Start first time-of-use								
Stop first time-of-use								
Start second time-of-use								00:00 to 24:00
Stop second time-of-use								h
Start third time-of-use								
Stop third time-of-use								

PA1 parameters (heating circuit HC1), PA2 parameters (heating circuit HC2) and PA3 parameters (heating circuit HC3)

P	Parameters	PA1 (HC1)	PA2 (HC2)	PA3 (HC3)	Value range
01	Flow gradient				0.2 to 3.2
02	Level (parallel shift)				-30.0 to +30.0 °C
03	Flow set point (day)				−5.0 to +150.0 °C
04	Flow set point (night)				−5.0 to +150.0 °C
05	Four-point characteristic				
	Outdoor temperature, point 1				-50.0 to +50.0 °C
	Outdoor temperature, point 2				−50.0 to +50.0 °C
	Outdoor temperature, point 3				−50.0 to +50.0 °C
	Outdoor temperature, point 4				−50.0 to +50.0 °C
05	Flow temperature, point 1				−5.0 to +150.0 °C
	Flow temperature, point 2				−5.0 to +150.0 °C
	Flow temperature, point 3				−5.0 to +150.0 °C
	Flow temperature, point 4				−5.0 to +150.0 °C
	Reduced flow temperature, point 1				−5.0 to +150.0 °C
	Reduced flow temperature, point 2				−5.0 to +150.0 °C
	Reduced flow temperature, point 3				−5.0 to +150.0 °C
	Reduced flow temperature, point 4				−5.0 to +150.0 °C
	Return flow temperature, point 1				5.0 to 90.0 °C
	Return flow temperature, point 2				5.0 to 90.0 °C
	Return flow temperature, point 3				5.0 to 90.0 °C
	Return flow temperature, point 4				5.0 to 90.0 °C
	Flow rate, point 1		-	-	0.01 to 650 m ³ /h
	Flow rate, point 2		-	-	0.01 to 650 m ³ /h
	Flow rate, point 3		-	-	0.01 to 650 m ³ /h
	Flow rate, point 4		ı	Ī	0.01 to 650 m ³ /h
	Capacity, point 1		-	-	
	Capacity, point 2		_	_	0.1 to 6500 kW
	Capacity, point 3		-	-	or 1 to 800 pulses/h
	Capacity, point 4		-	-	
06	Min. flow temperature				−5.0 to +150.0 °C
07	Max. flow temperature				−5.0 to +150.0 °C
09	Outdoor temperature for continuous day mode				-50.0 to +5.0 °C

16-280 EB 5578 EN

Р	Parameters	PA1 (HC1)	PA2 (HC2)	PA3 (HC3)	Value range
10	Minimum flow temperature set point HC for binary demand processing				5.0 to 150.0 °C
11	Return flow gradient				0.2 to 3.2
12	Return flow level				-30.0 to +30.0 °C
13	Base point for return flow temperature:				5.0 to 90.0 °C
14	Max. return flow temperature				5.0 to 90.0 °C
15	Set point boost (pre-control circuit)				0.0 to 50.0 °C
16	Minimum set point to charge buffer tank		-	-	OT to 90.0 °C
17	Stop charging of the buffer tank		-	ı	OT to 90.0 °C
18	Charging temperature boost		_	_	0.0 to 50.0 °C
19	Lag time of charging pump		_	_	0.0 to 10.0

PA11 parameters (heating circuit HC11), PA12 parameters (heating circuit HC12) and PA13 parameters (heating circuit HC13)

P	Parameters	PA11 (HC11)	PA12 (HC12)	PA13 (HC13)	Value range
01	Flow gradient				0.2 to 3.2
02	Level (parallel shift)				-30.0 to 30.0 °C
03	Flow set point (day)				−5.0 to 150.0 °C
04	Flow set point (night)				−5.0 to 150.0 °C
05	Four-point characteristic				
	Outdoor temperature, point 1				−50.0 to 50.0 °C
	Outdoor temperature, point 2				-50.0 to 50.0 °C
	Outdoor temperature, point 3				-50.0 to 50.0 °C
	Outdoor temperature, point 4				−50.0 to 50.0 °C
	Flow temperature, point 1				−5.0 to 150.0 °C
	Flow temperature, point 2				−5.0 to 150.0 °C
	Flow temperature, point 3				−5.0 to 150.0 °C
	Flow temperature, point 4				−5.0 to 150.0 °C
	Reduced flow temperature, point 1				−5.0 to 150.0 °C
	Reduced flow temperature, point 2				−5.0 to 150.0 °C
	Reduced flow temperature, point 3				−5.0 to 150.0 °C
	Reduced flow temperature, point 4				−5.0 to 150.0 °C
	Return flow temperature, point 1				5.0 to 90.0 °C
	Return flow temperature, point 2				5.0 to 90.0 °C
	Return flow temperature, point 3				5.0 to 90.0 °C
	Return flow temperature, point 4				5.0 to 90.0 °C
06	Min. flow temperature				-5.0 to 150.0 °C
07	Max. flow temperature				−5.0 to 150.0 °C
09	Outdoor temperature for continuous day mode				-50.0 to 5.0 °C
11	Return flow gradient				0.2 to 3.2
12	Return flow level				-30.0 to 30.0 °C
13	Base point for return flow temperature:				5.0 to 90.0 °C
14	Max. return flow temperature				5.0 to 90.0 °C

16-282 EB 5578 EN

CO1 function block parameters (heating circuit HC1), CO2 function block parameters (heating circuit HC2) and CO3 function block parameters (heating circuit HC3)

F	Function block parameters	CO1 (HC1)	CO2 (HC2)	CO3 (HC3)	Value range
03	KP (limiting factor)				0.1 to 10.0
05	Start temperature				20.0 to 60.0 °C
	Hold (days)				0 to 10 days
	Temp. rise/day				0.0 to 10.0 °C
	Maximum temperature				25.0 to 60.0 °C
	Hold (days)				0 to 10 days
	Temp. reduction/day				0.0 to 10.0 °C
	Start condition				Stop, Start, Hold, Reduction
09	Cycle time				0 to 100 min
	KP (gain)				0.0 to 25.0
12	KP (gain)				0.1 to 50.0
	Tn (reset time)				1 to 999 s
	TV (derivative-action time)				0 to 999 s
	TY (valve transit time)				15 to 240 s
	Hysteresis				1.0 to 30.0 °C
	Min. ON time				0 to 10 min
	Min. OFF time				0 to 10 min
	Max. system deviation				3.0 to 10.0 °C
14	Active when BI =				ON, OFF
17	Active when BI =		_	_	ON, OFF
18	Lower transmission range		_	_	0.0 to 150.0 °C
	Upper transmission range		_	_	0.0 to 150.0 °C
	Boost		-	_	0.0 to 30.0 °C
21	Start speed reduction, limit		_	_	5.0 to 90.0 °C
	Stop speed reduction, limit		_	_	5.0 to 90.0 °C
	Minimum speed		-	-	0 to 50 %0 to 50 %
23	Set point of differential temperature control		_	_	0.0 to 50.0 °C
	KP (influence factor)		-	_	0.1 to 10.0
	Minimum speed		_	_	0 to 100 %
25	Temperature limit		_	_	0.0 to 50.0 °C
26	Sensor		_	_	AF1 to SF3 (RüF2)

F	Function block parameters	CO1 (HC1)	CO2 (HC2)	CO3 (HC3)	Value range
28	Variable night set-back, OTL night 100 %				-50.0 to +20.0 °C
	Variable night set-back, OTL day 0 %				−50.0 to +5.0 °C

CO11 function block parameters (heating circuit HC11), CO12 function block parameters (heating circuit HC12) and CO13 function block parameters (heating circuit HC13)

F	Function block parameters	CO11 (HC11)	CO12 (HC12)	CO13 (HC13)	Value range
03	KP (limiting factor)				0.1 to 10.0
05	Boost				0.0 to 50.0 °C
	Start temperature				20.0 to 60.0 °C
	Hold (days)				0 to 10 days
	Temp. rise/day				0.0 to 10.0 °C
	Maximum temperature				25.0 to 60.0 °C
	Hold (days)				0 to 30 days
	Temp. reduction/day				0.0 to 10.0 °C
	Start condition				Stop, Start, Hold, Reduction
09	Cycle time				0 to 100 min
	KP (gain)				0.0 to 25.0
12	KP (gain)				0.1 to 50.0
	Tn (reset time)				1 to 999 s
	TV (derivative-action time)				0 to 999 s
	TY (valve transit time)				15 to 240 s
	Hysteresis				1.0 to 30.0 °C
	Min. ON time				0 to 10 min
	Min. OFF time				0 to 10 min
13	Max. system deviation				3.0 to 10.0 °C
28	Variable night set-back, OTL night 100 %				-50.0 to +20.0 °C
	Variable night set-back, OTL day 0 %				-50.0 to +5.0 °C

16-284 EB 5578 EN

PA4 parameters (domestic hot water heating)

Р	Parameters	PA4 (DHW)	Value range
01	Min. adjustable DHW set point		5.0 to 90.0 °C
02	Max. adjustable DHW set point		5.0 to 90.0 °C
03	Hysteresis		1.0 to 30.0 °C
04	Charging temperature boost		0.0 to 50.0 °C
05	Max. charging temperature		20.0 to 150.0 °C
06	Lag time for storage tank charging		0.0 to 10.0 x valve transit time
	pump		
07	Max. return flow temperature		5.0 to 90.0 °C
10	Solar circuit pump ON		1.0 to 30.0 °C
11	Solar circuit pump OFF		0.0 to 90.0 °C
12	Max. storage tank temperature		20.0 to 90.0 °C
19	Lag time for storage tank charging		0.0 to 10
	ритр		

CO4 function block parameters (domestic hot water heating)

F	Function block parameters	CO4 (DHW)	Value range
03	KP (limiting factor)		0.1 to 10.0
04	Select		Analog, binary
06	Cancel		0 to 10 min
	Temperature limit		20.0 to 90.0 °C
08	Start		0 to 10 min
	KP (influence factor)		0.1 to 10.0
	Control circuit		HC1, HC2, HC3, HC1+HC2, HC1+HC3
09	Start		0 to 10 min
	Control circuit		HC1, HC2, HC3, HC1+HC2, HC1+HC3
12	Minimum speed		5 to 50 %
	KP (gain)		0.1 to 50.0
	Tn (reset time)		1 to 999 s
	TV (derivative-action time)		0 to 999 s
	TY (valve transit time)		15 to 240 s
	Hysteresis		1.0 to 30.0 °C
	Min. ON time		0 to 10 min
	Min. OFF time	<u> </u>	0 to 10 min
13	Max. system deviation		3.0 to 10.0 °C

F	Function block parameters	CO4 (DHW)	Value range
14	Day of the week		Monday to Sunday, daily
	Time		Adjustable as required
	Disinfection temperature		60.0 to 90.0 °C
	Set point boost		0.0 to 50.0 °C
	Duration		0 to 255 min
	Active when BI =		ON, OFF
21	Start speed reduction		5.0 to 90.0 °C
	Stop speed reduction		5.0 to 90.0 °C
	Minimum speed		0 to 50 %0 to 50 %
22	Valve position when cold charging protection is active		1 to 100 %
25	Return flow set point		5.0 to 90.0 °C
	KP (gain)		0.1 to 50.0
	Tn (reset time)		30 to 2000 s
	Minimum speed		5 to 50 %
26	Sensor		AF1 to SF3 (RüF2)

PA5 parameters (system-wide parameters)

Р	Parameters	PA5	Value range
01	Start temperature for boiler pump		20.0 to 90.0 °C
02	Boiler pump hysteresis		0.0 to 30.0 °C

CO5 function block parameters (system-wide functions)

F	Function block parameters	CO5	Value range
04	Date		Adjustable as required
	No. days until activation		1 to 3
	No. days until deactivation		1 to 3
	Limit		0.0 to 30.0 °C
05	Delay/h		1.0 to 6.0 °C
06	Delay/h		1.0 to 6.0 °C
07	Relay contact		NC contact, NO contact
09	Limit		−15.0 to +3.0 °C

16-286 EB 5578 EN

F	Function block parameters	CO5	Value range
10	Max. limit		OT to 800 pulses/h
	Max. limit (heating)		OT to 800 pulses/h
	Max. limit (DHW)		1 to 800 pulses/h
	Limiting factor		0.1 to 10.0
12	Switching mode		Binary, analog
	Active when BI =		ON, OFF
13	Maximum buffer tank temperature		20.0 to 90.0 °C
15	Active when BI =		ON, OFF
21	Return flow temperature limit, layering at top		5.0 to 90.0 °C
23	Direction		Input, Output
	Lower transmission range		-50.0 to +100.0 °C
	Upper transmission range		-50.0 to +100.0 °C
25	Zero point		0 to 50 %0 to 50 %
26	Zero point		0 to 50 %0 to 50 %
31	Zero point		5 to 20 %
	Lower transmission range		0 to 150 °C
	Upper transmission range		0 to 150 °C
34	Output AA1		Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (Y1)
35	Output AA2		Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (Y2)

PA6 parameters (Modbus)

P	Parameters	PA6	Value range
01	Modbus station address (8 bit)		1 to 246

CO6 function block parameters (Modbus)

F	Function block parameters	CO6	Value range
10	Heat meter 1 address		0 to 255
	HM 1 model		1434, CAL3, APA I O, SLS
	Heat meter 1 mode		24 h, Continuous, CoiL
	Heat meter 2 address		0 to 255
	HM 2 model		1434, CAL3, APA+O, SLS
	Heat meter 3 mode		24 h, Continuous, CoiL
	Heat meter 3 address		0 to 255
	HM 3 model		1434, CAL3, APA t O, SLS
	Heat meter 3 mode		24 h, Continuous, CoiL
11	Max. limit		OT to 650 m ³ /h
	Max. limit (heating)		OT to 650 m ³ /h
	Max. limit (DHW)		0.01 to 650 m³/h
	Limiting factor		0.1 to 10
12	Max. limit		OT to 6500 kW
	Max. limit (heating)		OT to 6500 kW
	Max. limit (DHW)		0.1 to 6500 kW
	Limiting factor		0.1 to 10
13	Max. limit		0.01 to 650 m ³ /h
	Limiting factor		0.1 to 10
14	Max. limit		0.1 to 6500 kW
	Limiting factor		0.1 to 10
15	Max. limit		0.01 to 650 m³/h
	Limiting factor		0.1 to 10
16	Max. limit		0.1 to 6500 kW
	Limiting factor		0.1 to 10

16-288 EB 5578 EN

CO7 function block parameters (device bus)

F	Function block parameters	CO7	Value range
1	Device bus address		Auto, 1 to 32
3	Device bus address		Auto, 1 to 32
4	Device bus address		Auto, 1 to 32
5	Device bus address		Auto, 1 to 32
6	Register number		1 to 4
7	Register number		1 to 4
8	Register number		1 to 4
9	Register number		1 to 4
10	Register number		5 to 65
11	Register number		5 to 65
12	Register number		5 to 65
13	Register number		5 to 65
15	Register number		5 to 65
17	Register number		5 to 65
18	Register number		5 to 65
19	Register number		5 to 65
20	Register number		5 to 65
21	Register number		5 to 65
22	Register number		5 to 65
23	Register number		5 to 65

CO8 function block parameters (initialization of BI1 and BI2)

F	Function block parameters	CO8	Value range
1	Error message when		BI = 0, BI = 1, none (1)
2	Error message when		BI = 0, $BI = 1$, none (1)
3	Error message when		BI = 0, BI = 1, none (1)
4	Error message when		BI = 0, $BI = 1$, none (1)
5	Error message when		BI = 0, $BI = 1$, none (1)
6	Error message when		BI = 0, BI = 1, none (1)
9	Error message when		BI = 0, $BI = 1$, none (1)
10	Error message when		BI = 0, $BI = 1$, none (1)
11	Error message when		BI = 0, $BI = 1$, none (1)
12	Error message when		BI = 0, BI = 1, none (1)
13	Error message when		BI = 0, BI = 1, none (1)

F	Function block parameters	CO8	Value range
15	Error message when		BI = 0, $BI = 1$, none (1)
16	Error message when		BI = 0, $BI = 1$, none (1)
17	Error message when		BI = 0, BI = 1, none (1)

16-290 EB 5578 EN

17 Annex B

17.1 Accessories

TROVIS I/O (expansion module)	Order no. 1000062999		
Memory module	Order no. 1400-9379		
Mini module	Order no. 1400-7436		
Data logging module	Order no. 1400-9378		
USB converter 3	Order no. 1400-9377		
TROVIS-VIEW software (free of charge)	www.samsongroup.com > SERVICE & SUPPORT > Downloads > TROVIS-VIEW		
RS-485 communication module	Order no. 8812-2002		
Surge arrester SA 5000	Order no. 1400-9868		
SAM HOME Gateway	Type 5660		
SAM MOBILE Gateway	Type 5655		
SAM LAN Gateway	Type 5650		
Water flow sensor with extension cable	Order no. 1400-9246		

17.2 After-sales service

After-sales service

Contact our after-sales service for support concerning service or repair work or when malfunctions or defects arise.

You can reach our after-sales service at aftersalesservice@samsongroup.com.

Addresses of SAMSON AG and its subsidiaries

The addresses of SAMSON AG, its subsidiaries, representatives and service facilities worldwide can be found on our website (www.samsongroup.com) or in all SAMSON product catalogs.

Required specifications

Please submit the following details:

- Model number
- Firmware version
- Serial number

17-2 EB 5578 EN

Key number 1732

EB 5578 EN

